

STORMWATER MANAGEMENT ANALYSIS

For

Renard Management, Inc.

Proposed Self-Storage Facility

*Block 29002, Lots 49 & 50
1026 Georgetown Franklin Turnpike (C.R. 518)
Township of Montgomery
Somerset County, NJ*

Prepared by:



1904 Main Street
Lake Como, NJ 07719
(732) 974-0198

A handwritten signature in black ink, appearing to read 'Joshua M. Sewald', is positioned above a horizontal line.

Joshua M. Sewald, PE, PP
NJ Professional Engineer License #52908

June 2023
Revised March 2024
DEC# 2334-22-00894

TABLE OF CONTENTS

	<u>Page No.</u>
I. Site Description.....	2
II. Design Overview	2
III. Existing Site Conditions	3
IV. Proposed Site Conditions	3
V. Design Methodology	4
VI. Runoff Rate Reduction Performance	4
VII. Water Quality	5
VIII. Groundwater Recharge	5
IX. Conclusion.....	6

APPENDIX

- NRCS Web Soil Survey
- HydroCAD Summary Reports – Existing Conditions 2 yr. 10 yr. & 100 yr.
- HydroCAD Summary Reports – Proposed Conditions 2 yr. 10 yr. & 100 yr.
- HydroCAD Summary Reports – Pre vs Post Conditions 2 yr. 10 yr. & 100 yr.
- New Jersey Groundwater Recharge Spreadsheet (NJGRS) – Version 2
- Stormwater Collection System Calculations (Pipe Sizing)
- Attachment D – Major Development Stormwater Summary
- Drainage Area Maps

I. SITE DESCRIPTION

The project area is comprised of Lots 49 and 50, Block 29002 in the Township of Montgomery, Somerset County, New Jersey. The property is located at 1026 Georgetown Franklin Turnpike (C.R. 518). The subject parcel previously consisted of a dilapidated building, which has since been demolished with associated driveways, parking areas and open space areas. The site presently contains approximately 1.95 AC of impervious coverage and 1.31 AC of motor vehicle surfaces. Stormwater runoff from the existing development ultimately drains to the existing stormwater conveyance system within Georgetown Franklin Turnpike (C.R. 518) and the existing conveyance system to the North.

The proposed development includes the construction of two (2) two-story self-storage buildings (22,846 SF & 84,904 SF) with driveways, parking areas, utilities, lighting, and accommodating site improvements as shown on the Use Variance & Preliminary & Final Major Site Plan drawings, prepared by Dynamic Engineering Consultants, PC. The proposed development will result in a total amount of impervious coverage of approximately 1.74 Acres and 0.49 AC of motor vehicle surface (0.82 AC reduction in motor vehicle surfaces). The total disturbance area is approximately 2.80 Acres. The project will utilize existing drainage patterns on-site to address applicable aspects of NJAC 7:8.

The existing conditions of the tract have been verified by the ALTA/NSPS Land Title Survey, as prepared by Dynamic Survey, LLC dated 08/11/2022.

II. DESIGN OVERVIEW

This report has been prepared to define and analyze the stormwater drainage conditions that would occur as a result of the redevelopment of the above referenced site in the Township of Montgomery, Somerset County, New Jersey.

The proposed development includes the construction of two (2) two-story self-storage buildings (22,846 SF & 84,904 SF) and the associated site improvements as shown on the accompanying Site Plans.

The proposed redevelopment within the limit of disturbance proposes a net decrease in impervious coverage and therefore, reduces and does not exceed at any time the stormwater runoff volume and peak rate of runoff from the development for the 2, 10 and 100-year storm events. Runoff peak flows and peak volumes will be reduced to the existing stormwater conveyance systems. The water quantity rates and volumes are demonstrated to meet the requirements of NJAC 7:8.

A hydrological evaluation is provided for the 2, 10, and 100-year storm events utilizing the Urban Hydrology for Small Watershed TR55 method. It is the intention of the design of this site to comply with the Stormwater Management Best Management Practices.

II. EXISTING SITE CONDITIONS

The existing conditions of the tract have been verified by the ALTA/NSPS Land Title Survey, as prepared by Dynamic Survey, LLC dated 08/11/2022. This information has been utilized to establish the Existing Conditions Drainage Area Map which is included within the Appendix of this Report.

The tract has been evaluated with the following existing drainage sub-watershed areas:

Study Area North: This area consists of a majority of the previously existing building, impervious areas, open space and wooded areas that will be disturbed as part of the proposed site improvements. Stormwater runoff generated by this area is tributary to the existing stormwater conveyance system to the north.

Study Area South: This area consists of a portion of the existing building, along with impervious, open space, and wooded areas that will be disturbed as part of the proposed site improvements. Stormwater runoff generated by this area is tributary to the existing stormwater conveyance system located within Georgetown Franklin Turnpike (C.R. 518).

Based on Somerset County soils survey information, the soil types native to the site include:

SOMERSET COUNTY SOIL SURVEY INFORMATION		
SOIL TYPE (SYMBOL)	SOIL TYPE (NAME)	HYDROLOGIC SOIL GROUP
BhnB	Birdsboro silt loam, 2 to 6 percent slopes	B

III. PROPOSED SITE CONDITIONS

The proposed development includes the construction of two (2) two-story self-storage buildings (22,846 SF & 84,904 SF). Additional site improvements include constructing driveways, parking areas, landscaping, lighting and other associated site improvements. The proposed development will maintain and utilize existing drainage patterns.

The tract has been evaluated with the following drainage sub-watershed areas as depicted on the Proposed Drainage Area Map included within the Appendix of this report.

Study Area North: This area consists of the roof area of the 22,846 SF building and half of the roof area of the larger building and the northern portion of the impervious areas on site, as well as the open space area and

wooded areas within the northern portion of the property. The stormwater runoff from this study area drains via overland flow to existing and proposed inlets which route the runoff to the existing stormwater conveyance system to the north.

Study Area South: This area consists of half of the roof area for the 84,904 SF building, and the southern portion of impervious areas on-site, as well as the open space, and wooded areas within the southern portion of the property. The stormwater runoff from this study area is tributary to the existing stormwater conveyance system located within Georgetown Franklin Turnpike (C.R. 518).

IV. DESIGN METHODOLOGY

The intention of the design of the proposed stormwater management facilities for this project is to provide measures as required to address applicable aspects of the Township of Montgomery Land Use Ordinance and NJAC 7:8. In order to prepare the stormwater calculations for the subject project, initial investigation of the property and topography was performed. On-site review of the tract was initially performed by Dynamic Engineering Consultants, PC to verify existing site conditions and land cover characteristics. Dynamic Survey, LLC was contracted to prepare an ALTA/NSPS Land Title Survey depicting the boundary, location and topography for the existing site and surrounding watershed areas.

Based on our review of the existing site conditions and the ALTA/NSPS Land Title Survey, the Drainage Area Maps for the existing and proposed site conditions as defined within this report were established. A grading plan was developed for the proposed site improvements with considerations to the existing drainage patterns.

The overall stormwater management report for the subject tract has been evaluated by Dynamic Engineering Consultants to ensure that the overall development satisfies the applicable stormwater criteria set forth in the Township of Montgomery Land Use Ordinance and NJAC 7:8.

V. RUNOFF RATE REDUCTION PERFORMANCE

The following is a comparison of the existing and proposed runoff rates:

Pre-Development and Post-Development Peak Runoff Results **Summary for Study Area North Total**

	EXISTING RUNOFF RATE (CFS)	PROPOSED RUNOFF RATE (CFS)	TOTAL REDUCTION (CFS)
2 Year	4.39	4.01	0.38
10 Year	6.86	6.47	0.39
100 Year	11.90	11.35	0.55

Pre-Development and Post-Development Peak Runoff Results
Summary for Study Area South Total

	EXISTING RUNOFF RATE (CFS)	PROPOSED RUNOFF RATE (CFS)	TOTAL REDUCTION (CFS)
2 Year	3.55	2.96	0.59
10 Year	5.61	4.77	0.84
100 Year	9.77	8.51	1.26

The proposed redevelopment will reduce the overall impervious coverage and motor vehicle impervious coverage; therefore, reduces the stormwater runoff volume and peak rate of runoff from the development for the 2, 10, and 100-year storm events. As shown in the Hydrograph Summary Reports within the appendix of this report, the post development runoff hydrographs for all drainage areas do not exceed at any point in time, the pre-development runoff hydrographs for the 2, 10, and 100-year storms. Therefore, the overall development satisfies the applicable stormwater criteria set forth in the Township of Montgomery Land Use Ordinance and NJAC 7:8.

VI. WATER QUALITY

The subject development does not result in a ¼ acre or more of new regulated motor vehicle surfaces; therefore, the State's Stormwater Runoff Water Quality Standards, set forth by NJAC 7:8, would not be applicable to this project.

In addition, the redevelopment of the site is proposing to reconstruct approximately 0.49 acres of existing motor vehicle surface. It should be noted that the proposed motor vehicle surface on the site is being reduced from 1.31 acres to 0.49 acres. In the existing condition, the 1.31 acres did not receive any water quality treatment. As a result, the project would be credited with 0.82 acres of water quality that would not require water quality treatment in accordance with DRCC regulations (N.J.A.C. 7:45-8.7).

VII. GROUNDWATER RECHARGE

As previously stated within this report, under proposed conditions, overall impervious coverage will be reduced; therefore, the proposed project meets groundwater recharge requirements. The New Jersey Groundwater Recharge Spreadsheet (NJGRS) – Version 2 has been utilized to verify satisfaction of the groundwater recharge requirement. The NJ Groundwater Recharge Spreadsheet is included in the appendix of this report.

VIII. CONCLUSION

The proposed overall development has been designed with provisions for the safe and efficient control of stormwater runoff in a manner that will not adversely impact the existing drainage patterns, adjacent roadways, or adjacent parcels.

The proposed redevelopment reduces the overall impervious coverage and motor vehicle impervious coverage; therefore, reduces the stormwater runoff volume and peak rate of runoff from the development for the 2, 10 and 100-year storm events. With this stated, it is evident that the proposed development will not have a negative impact on the existing drainage patterns, water quality, or groundwater recharge on site or within the vicinity of the subject parcel.

APPENDIX

NRCS WEB SOIL SURVEY



United States
Department of
Agriculture

NRCS

Natural
Resources
Conservation
Service

A product of the National
Cooperative Soil Survey,
a joint effort of the United
States Department of
Agriculture and other
Federal agencies, State
agencies including the
Agricultural Experiment
Stations, and local
participants

Custom Soil Resource Report for **Somerset County, New Jersey**



May 24, 2023

Preface

Soil surveys contain information that affects land use planning in survey areas. They highlight soil limitations that affect various land uses and provide information about the properties of the soils in the survey areas. Soil surveys are designed for many different users, including farmers, ranchers, foresters, agronomists, urban planners, community officials, engineers, developers, builders, and home buyers. Also, conservationists, teachers, students, and specialists in recreation, waste disposal, and pollution control can use the surveys to help them understand, protect, or enhance the environment.

Various land use regulations of Federal, State, and local governments may impose special restrictions on land use or land treatment. Soil surveys identify soil properties that are used in making various land use or land treatment decisions. The information is intended to help the land users identify and reduce the effects of soil limitations on various land uses. The landowner or user is responsible for identifying and complying with existing laws and regulations.

Although soil survey information can be used for general farm, local, and wider area planning, onsite investigation is needed to supplement this information in some cases. Examples include soil quality assessments (<http://www.nrcs.usda.gov/wps/portal/nrcs/main/soils/health/>) and certain conservation and engineering applications. For more detailed information, contact your local USDA Service Center (<https://offices.sc.egov.usda.gov/locator/app?agency=nrcs>) or your NRCS State Soil Scientist (http://www.nrcs.usda.gov/wps/portal/nrcs/detail/soils/contactus/?cid=nrcs142p2_053951).

Great differences in soil properties can occur within short distances. Some soils are seasonally wet or subject to flooding. Some are too unstable to be used as a foundation for buildings or roads. Clayey or wet soils are poorly suited to use as septic tank absorption fields. A high water table makes a soil poorly suited to basements or underground installations.

The National Cooperative Soil Survey is a joint effort of the United States Department of Agriculture and other Federal agencies, State agencies including the Agricultural Experiment Stations, and local agencies. The Natural Resources Conservation Service (NRCS) has leadership for the Federal part of the National Cooperative Soil Survey.

Information about soils is updated periodically. Updated information is available through the NRCS Web Soil Survey, the site for official soil survey information.

The U.S. Department of Agriculture (USDA) prohibits discrimination in all its programs and activities on the basis of race, color, national origin, age, disability, and where applicable, sex, marital status, familial status, parental status, religion, sexual orientation, genetic information, political beliefs, reprisal, or because all or a part of an individual's income is derived from any public assistance program. (Not all prohibited bases apply to all programs.) Persons with disabilities who require

alternative means for communication of program information (Braille, large print, audiotape, etc.) should contact USDA's TARGET Center at (202) 720-2600 (voice and TDD). To file a complaint of discrimination, write to USDA, Director, Office of Civil Rights, 1400 Independence Avenue, S.W., Washington, D.C. 20250-9410 or call (800) 795-3272 (voice) or (202) 720-6382 (TDD). USDA is an equal opportunity provider and employer.

Contents

Preface	2
How Soil Surveys Are Made	5
Soil Map	8
Soil Map.....	9
Legend.....	10
Map Unit Legend.....	11
Map Unit Descriptions.....	11
Somerset County, New Jersey.....	13
BhnB—Birdsboro silt loam, 2 to 6 percent slopes.....	13
Soil Information for All Uses	15
Soil Properties and Qualities.....	15
Soil Qualities and Features.....	15
Hydrologic Soil Group.....	15
Water Features.....	19
Depth to Water Table.....	19
References	24

How Soil Surveys Are Made

Soil surveys are made to provide information about the soils and miscellaneous areas in a specific area. They include a description of the soils and miscellaneous areas and their location on the landscape and tables that show soil properties and limitations affecting various uses. Soil scientists observed the steepness, length, and shape of the slopes; the general pattern of drainage; the kinds of crops and native plants; and the kinds of bedrock. They observed and described many soil profiles. A soil profile is the sequence of natural layers, or horizons, in a soil. The profile extends from the surface down into the unconsolidated material in which the soil formed or from the surface down to bedrock. The unconsolidated material is devoid of roots and other living organisms and has not been changed by other biological activity.

Currently, soils are mapped according to the boundaries of major land resource areas (MLRAs). MLRAs are geographically associated land resource units that share common characteristics related to physiography, geology, climate, water resources, soils, biological resources, and land uses (USDA, 2006). Soil survey areas typically consist of parts of one or more MLRA.

The soils and miscellaneous areas in a survey area occur in an orderly pattern that is related to the geology, landforms, relief, climate, and natural vegetation of the area. Each kind of soil and miscellaneous area is associated with a particular kind of landform or with a segment of the landform. By observing the soils and miscellaneous areas in the survey area and relating their position to specific segments of the landform, a soil scientist develops a concept, or model, of how they were formed. Thus, during mapping, this model enables the soil scientist to predict with a considerable degree of accuracy the kind of soil or miscellaneous area at a specific location on the landscape.

Commonly, individual soils on the landscape merge into one another as their characteristics gradually change. To construct an accurate soil map, however, soil scientists must determine the boundaries between the soils. They can observe only a limited number of soil profiles. Nevertheless, these observations, supplemented by an understanding of the soil-vegetation-landscape relationship, are sufficient to verify predictions of the kinds of soil in an area and to determine the boundaries.

Soil scientists recorded the characteristics of the soil profiles that they studied. They noted soil color, texture, size and shape of soil aggregates, kind and amount of rock fragments, distribution of plant roots, reaction, and other features that enable them to identify soils. After describing the soils in the survey area and determining their properties, the soil scientists assigned the soils to taxonomic classes (units). Taxonomic classes are concepts. Each taxonomic class has a set of soil characteristics with precisely defined limits. The classes are used as a basis for comparison to classify soils systematically. Soil taxonomy, the system of taxonomic classification used in the United States, is based mainly on the kind and character of soil properties and the arrangement of horizons within the profile. After the soil

scientists classified and named the soils in the survey area, they compared the individual soils with similar soils in the same taxonomic class in other areas so that they could confirm data and assemble additional data based on experience and research.

The objective of soil mapping is not to delineate pure map unit components; the objective is to separate the landscape into landforms or landform segments that have similar use and management requirements. Each map unit is defined by a unique combination of soil components and/or miscellaneous areas in predictable proportions. Some components may be highly contrasting to the other components of the map unit. The presence of minor components in a map unit in no way diminishes the usefulness or accuracy of the data. The delineation of such landforms and landform segments on the map provides sufficient information for the development of resource plans. If intensive use of small areas is planned, onsite investigation is needed to define and locate the soils and miscellaneous areas.

Soil scientists make many field observations in the process of producing a soil map. The frequency of observation is dependent upon several factors, including scale of mapping, intensity of mapping, design of map units, complexity of the landscape, and experience of the soil scientist. Observations are made to test and refine the soil-landscape model and predictions and to verify the classification of the soils at specific locations. Once the soil-landscape model is refined, a significantly smaller number of measurements of individual soil properties are made and recorded. These measurements may include field measurements, such as those for color, depth to bedrock, and texture, and laboratory measurements, such as those for content of sand, silt, clay, salt, and other components. Properties of each soil typically vary from one point to another across the landscape.

Observations for map unit components are aggregated to develop ranges of characteristics for the components. The aggregated values are presented. Direct measurements do not exist for every property presented for every map unit component. Values for some properties are estimated from combinations of other properties.

While a soil survey is in progress, samples of some of the soils in the area generally are collected for laboratory analyses and for engineering tests. Soil scientists interpret the data from these analyses and tests as well as the field-observed characteristics and the soil properties to determine the expected behavior of the soils under different uses. Interpretations for all of the soils are field tested through observation of the soils in different uses and under different levels of management. Some interpretations are modified to fit local conditions, and some new interpretations are developed to meet local needs. Data are assembled from other sources, such as research information, production records, and field experience of specialists. For example, data on crop yields under defined levels of management are assembled from farm records and from field or plot experiments on the same kinds of soil.

Predictions about soil behavior are based not only on soil properties but also on such variables as climate and biological activity. Soil conditions are predictable over long periods of time, but they are not predictable from year to year. For example, soil scientists can predict with a fairly high degree of accuracy that a given soil will have a high water table within certain depths in most years, but they cannot predict that a high water table will always be at a specific level in the soil on a specific date.

After soil scientists located and identified the significant natural bodies of soil in the survey area, they drew the boundaries of these bodies on aerial photographs and

Custom Soil Resource Report

identified each as a specific map unit. Aerial photographs show trees, buildings, fields, roads, and rivers, all of which help in locating boundaries accurately.

Soil Map

The soil map section includes the soil map for the defined area of interest, a list of soil map units on the map and extent of each map unit, and cartographic symbols displayed on the map. Also presented are various metadata about data used to produce the map, and a description of each soil map unit.

Custom Soil Resource Report Soil Map



Map Scale: 1:1,040 if printed on A landscape (11" x 8.5") sheet.

0 15 30 60 90 Meters

0 50 100 200 300 Feet

Map projection: Web Mercator Corner coordinates: WGS84 Edge tics: UTM Zone 18N WGS84

Custom Soil Resource Report

MAP LEGEND

Area of Interest (AOI)

 Area of Interest (AOI)

Soils

 Soil Map Unit Polygons

 Soil Map Unit Lines

 Soil Map Unit Points

Special Point Features

 Blowout

 Borrow Pit

 Clay Spot

 Closed Depression

 Gravel Pit

 Gravelly Spot

 Landfill

 Lava Flow

 Marsh or swamp

 Mine or Quarry

 Miscellaneous Water

 Perennial Water

 Rock Outcrop

 Saline Spot

 Sandy Spot

 Severely Eroded Spot

 Sinkhole

 Slide or Slip

 Sodic Spot

 Spoil Area

 Stony Spot

 Very Stony Spot

 Wet Spot

 Other

 Special Line Features

Water Features

 Streams and Canals

Transportation

 Rails

 Interstate Highways

 US Routes

 Major Roads

 Local Roads

Background

 Aerial Photography

MAP INFORMATION

The soil surveys that comprise your AOI were mapped at 1:24,000.

Warning: Soil Map may not be valid at this scale.

Enlargement of maps beyond the scale of mapping can cause misunderstanding of the detail of mapping and accuracy of soil line placement. The maps do not show the small areas of contrasting soils that could have been shown at a more detailed scale.

Please rely on the bar scale on each map sheet for map measurements.

Source of Map: Natural Resources Conservation Service
Web Soil Survey URL:
Coordinate System: Web Mercator (EPSG:3857)

Maps from the Web Soil Survey are based on the Web Mercator projection, which preserves direction and shape but distorts distance and area. A projection that preserves area, such as the Albers equal-area conic projection, should be used if more accurate calculations of distance or area are required.

This product is generated from the USDA-NRCS certified data as of the version date(s) listed below.

Soil Survey Area: Somerset County, New Jersey
Survey Area Data: Version 20, Aug 30, 2022

Soil map units are labeled (as space allows) for map scales 1:50,000 or larger.

Date(s) aerial images were photographed: Mar 13, 2021—Sep 14, 2021

The orthophoto or other base map on which the soil lines were compiled and digitized probably differs from the background imagery displayed on these maps. As a result, some minor shifting of map unit boundaries may be evident.

Map Unit Legend

Map Unit Symbol	Map Unit Name	Acres in AOI	Percent of AOI
BhnB	Birdsboro silt loam, 2 to 6 percent slopes	3.3	100.0%
Totals for Area of Interest		3.3	100.0%

Map Unit Descriptions

The map units delineated on the detailed soil maps in a soil survey represent the soils or miscellaneous areas in the survey area. The map unit descriptions, along with the maps, can be used to determine the composition and properties of a unit.

A map unit delineation on a soil map represents an area dominated by one or more major kinds of soil or miscellaneous areas. A map unit is identified and named according to the taxonomic classification of the dominant soils. Within a taxonomic class there are precisely defined limits for the properties of the soils. On the landscape, however, the soils are natural phenomena, and they have the characteristic variability of all natural phenomena. Thus, the range of some observed properties may extend beyond the limits defined for a taxonomic class. Areas of soils of a single taxonomic class rarely, if ever, can be mapped without including areas of other taxonomic classes. Consequently, every map unit is made up of the soils or miscellaneous areas for which it is named and some minor components that belong to taxonomic classes other than those of the major soils.

Most minor soils have properties similar to those of the dominant soil or soils in the map unit, and thus they do not affect use and management. These are called noncontrasting, or similar, components. They may or may not be mentioned in a particular map unit description. Other minor components, however, have properties and behavioral characteristics divergent enough to affect use or to require different management. These are called contrasting, or dissimilar, components. They generally are in small areas and could not be mapped separately because of the scale used. Some small areas of strongly contrasting soils or miscellaneous areas are identified by a special symbol on the maps. If included in the database for a given area, the contrasting minor components are identified in the map unit descriptions along with some characteristics of each. A few areas of minor components may not have been observed, and consequently they are not mentioned in the descriptions, especially where the pattern was so complex that it was impractical to make enough observations to identify all the soils and miscellaneous areas on the landscape.

The presence of minor components in a map unit in no way diminishes the usefulness or accuracy of the data. The objective of mapping is not to delineate pure taxonomic classes but rather to separate the landscape into landforms or landform segments that have similar use and management requirements. The delineation of such segments on the map provides sufficient information for the development of resource plans. If intensive use of small areas is planned, however, onsite investigation is needed to define and locate the soils and miscellaneous areas.

An identifying symbol precedes the map unit name in the map unit descriptions. Each description includes general facts about the unit and gives important soil properties and qualities.

Soils that have profiles that are almost alike make up a *soil series*. Except for differences in texture of the surface layer, all the soils of a series have major horizons that are similar in composition, thickness, and arrangement.

Soils of one series can differ in texture of the surface layer, slope, stoniness, salinity, degree of erosion, and other characteristics that affect their use. On the basis of such differences, a soil series is divided into *soil phases*. Most of the areas shown on the detailed soil maps are phases of soil series. The name of a soil phase commonly indicates a feature that affects use or management. For example, Alpha silt loam, 0 to 2 percent slopes, is a phase of the Alpha series.

Some map units are made up of two or more major soils or miscellaneous areas. These map units are complexes, associations, or undifferentiated groups.

A *complex* consists of two or more soils or miscellaneous areas in such an intricate pattern or in such small areas that they cannot be shown separately on the maps. The pattern and proportion of the soils or miscellaneous areas are somewhat similar in all areas. Alpha-Beta complex, 0 to 6 percent slopes, is an example.

An *association* is made up of two or more geographically associated soils or miscellaneous areas that are shown as one unit on the maps. Because of present or anticipated uses of the map units in the survey area, it was not considered practical or necessary to map the soils or miscellaneous areas separately. The pattern and relative proportion of the soils or miscellaneous areas are somewhat similar. Alpha-Beta association, 0 to 2 percent slopes, is an example.

An *undifferentiated group* is made up of two or more soils or miscellaneous areas that could be mapped individually but are mapped as one unit because similar interpretations can be made for use and management. The pattern and proportion of the soils or miscellaneous areas in a mapped area are not uniform. An area can be made up of only one of the major soils or miscellaneous areas, or it can be made up of all of them. Alpha and Beta soils, 0 to 2 percent slopes, is an example.

Some surveys include *miscellaneous areas*. Such areas have little or no soil material and support little or no vegetation. Rock outcrop is an example.

Somerset County, New Jersey

BhnB—Birdsboro silt loam, 2 to 6 percent slopes

Map Unit Setting

National map unit symbol: 1j514
Elevation: 200 to 1,000 feet
Mean annual precipitation: 30 to 64 inches
Mean annual air temperature: 46 to 79 degrees F
Frost-free period: 131 to 178 days
Farmland classification: All areas are prime farmland

Map Unit Composition

Birdsboro and similar soils: 85 percent
Minor components: 15 percent
Estimates are based on observations, descriptions, and transects of the mapunit.

Description of Birdsboro

Setting

Landform: Stream terraces
Landform position (two-dimensional): Backslope
Landform position (three-dimensional): Tread
Down-slope shape: Linear
Across-slope shape: Linear
Parent material: Old alluvium derived from sandstone and siltstone and/or shale

Typical profile

Ap - 0 to 8 inches: silt loam
BA - 8 to 13 inches: silt loam
Bt - 13 to 29 inches: silt loam
BC - 29 to 40 inches: silt loam
C - 40 to 60 inches: stratified sand to silty clay loam
2C - 60 to 80 inches: stratified sand to fine sand

Properties and qualities

Slope: 2 to 6 percent
Depth to restrictive feature: More than 80 inches
Drainage class: Well drained
Runoff class: Low
Capacity of the most limiting layer to transmit water (Ksat): Moderately high to high
(0.60 to 2.00 in/hr)
Depth to water table: More than 80 inches
Frequency of flooding: None
Frequency of ponding: None
Available water supply, 0 to 60 inches: High (about 10.0 inches)

Interpretive groups

Land capability classification (irrigated): None specified
Land capability classification (nonirrigated): 2e
Hydrologic Soil Group: B
Ecological site: F148XY025PA - Moist, Triassic, Upland, Mixed Oak - Hardwood -
Conifer Forest
Hydric soil rating: No

Minor Components

Duffield

Percent of map unit: 5 percent
Landform: Hills
Landform position (three-dimensional): Side slope
Down-slope shape: Linear
Across-slope shape: Linear
Hydric soil rating: No

Bucks

Percent of map unit: 5 percent
Landform: Hills
Landform position (two-dimensional): Backslope
Landform position (three-dimensional): Side slope
Down-slope shape: Linear
Across-slope shape: Convex
Hydric soil rating: No

Raritan, rarely flooded

Percent of map unit: 5 percent
Landform: Stream terraces
Landform position (three-dimensional): Rise
Down-slope shape: Linear
Across-slope shape: Linear
Hydric soil rating: No

Soil Information for All Uses

Soil Properties and Qualities

The Soil Properties and Qualities section includes various soil properties and qualities displayed as thematic maps with a summary table for the soil map units in the selected area of interest. A single value or rating for each map unit is generated by aggregating the interpretive ratings of individual map unit components. This aggregation process is defined for each property or quality.

Soil Qualities and Features

Soil qualities are behavior and performance attributes that are not directly measured, but are inferred from observations of dynamic conditions and from soil properties. Example soil qualities include natural drainage, and frost action. Soil features are attributes that are not directly part of the soil. Example soil features include slope and depth to restrictive layer. These features can greatly impact the use and management of the soil.

Hydrologic Soil Group

Hydrologic soil groups are based on estimates of runoff potential. Soils are assigned to one of four groups according to the rate of water infiltration when the soils are not protected by vegetation, are thoroughly wet, and receive precipitation from long-duration storms.

The soils in the United States are assigned to four groups (A, B, C, and D) and three dual classes (A/D, B/D, and C/D). The groups are defined as follows:

Group A. Soils having a high infiltration rate (low runoff potential) when thoroughly wet. These consist mainly of deep, well drained to excessively drained sands or gravelly sands. These soils have a high rate of water transmission.

Group B. Soils having a moderate infiltration rate when thoroughly wet. These consist chiefly of moderately deep or deep, moderately well drained or well drained soils that have moderately fine texture to moderately coarse texture. These soils have a moderate rate of water transmission.


Custom Soil Resource Report

Group C. Soils having a slow infiltration rate when thoroughly wet. These consist chiefly of soils having a layer that impedes the downward movement of water or soils of moderately fine texture or fine texture. These soils have a slow rate of water transmission.

Group D. Soils having a very slow infiltration rate (high runoff potential) when thoroughly wet. These consist chiefly of clays that have a high shrink-swell potential, soils that have a high water table, soils that have a claypan or clay layer at or near the surface, and soils that are shallow over nearly impervious material. These soils have a very slow rate of water transmission.

If a soil is assigned to a dual hydrologic group (A/D, B/D, or C/D), the first letter is for drained areas and the second is for undrained areas. Only the soils that in their natural condition are in group D are assigned to dual classes.

Custom Soil Resource Report
Map—Hydrologic Soil Group

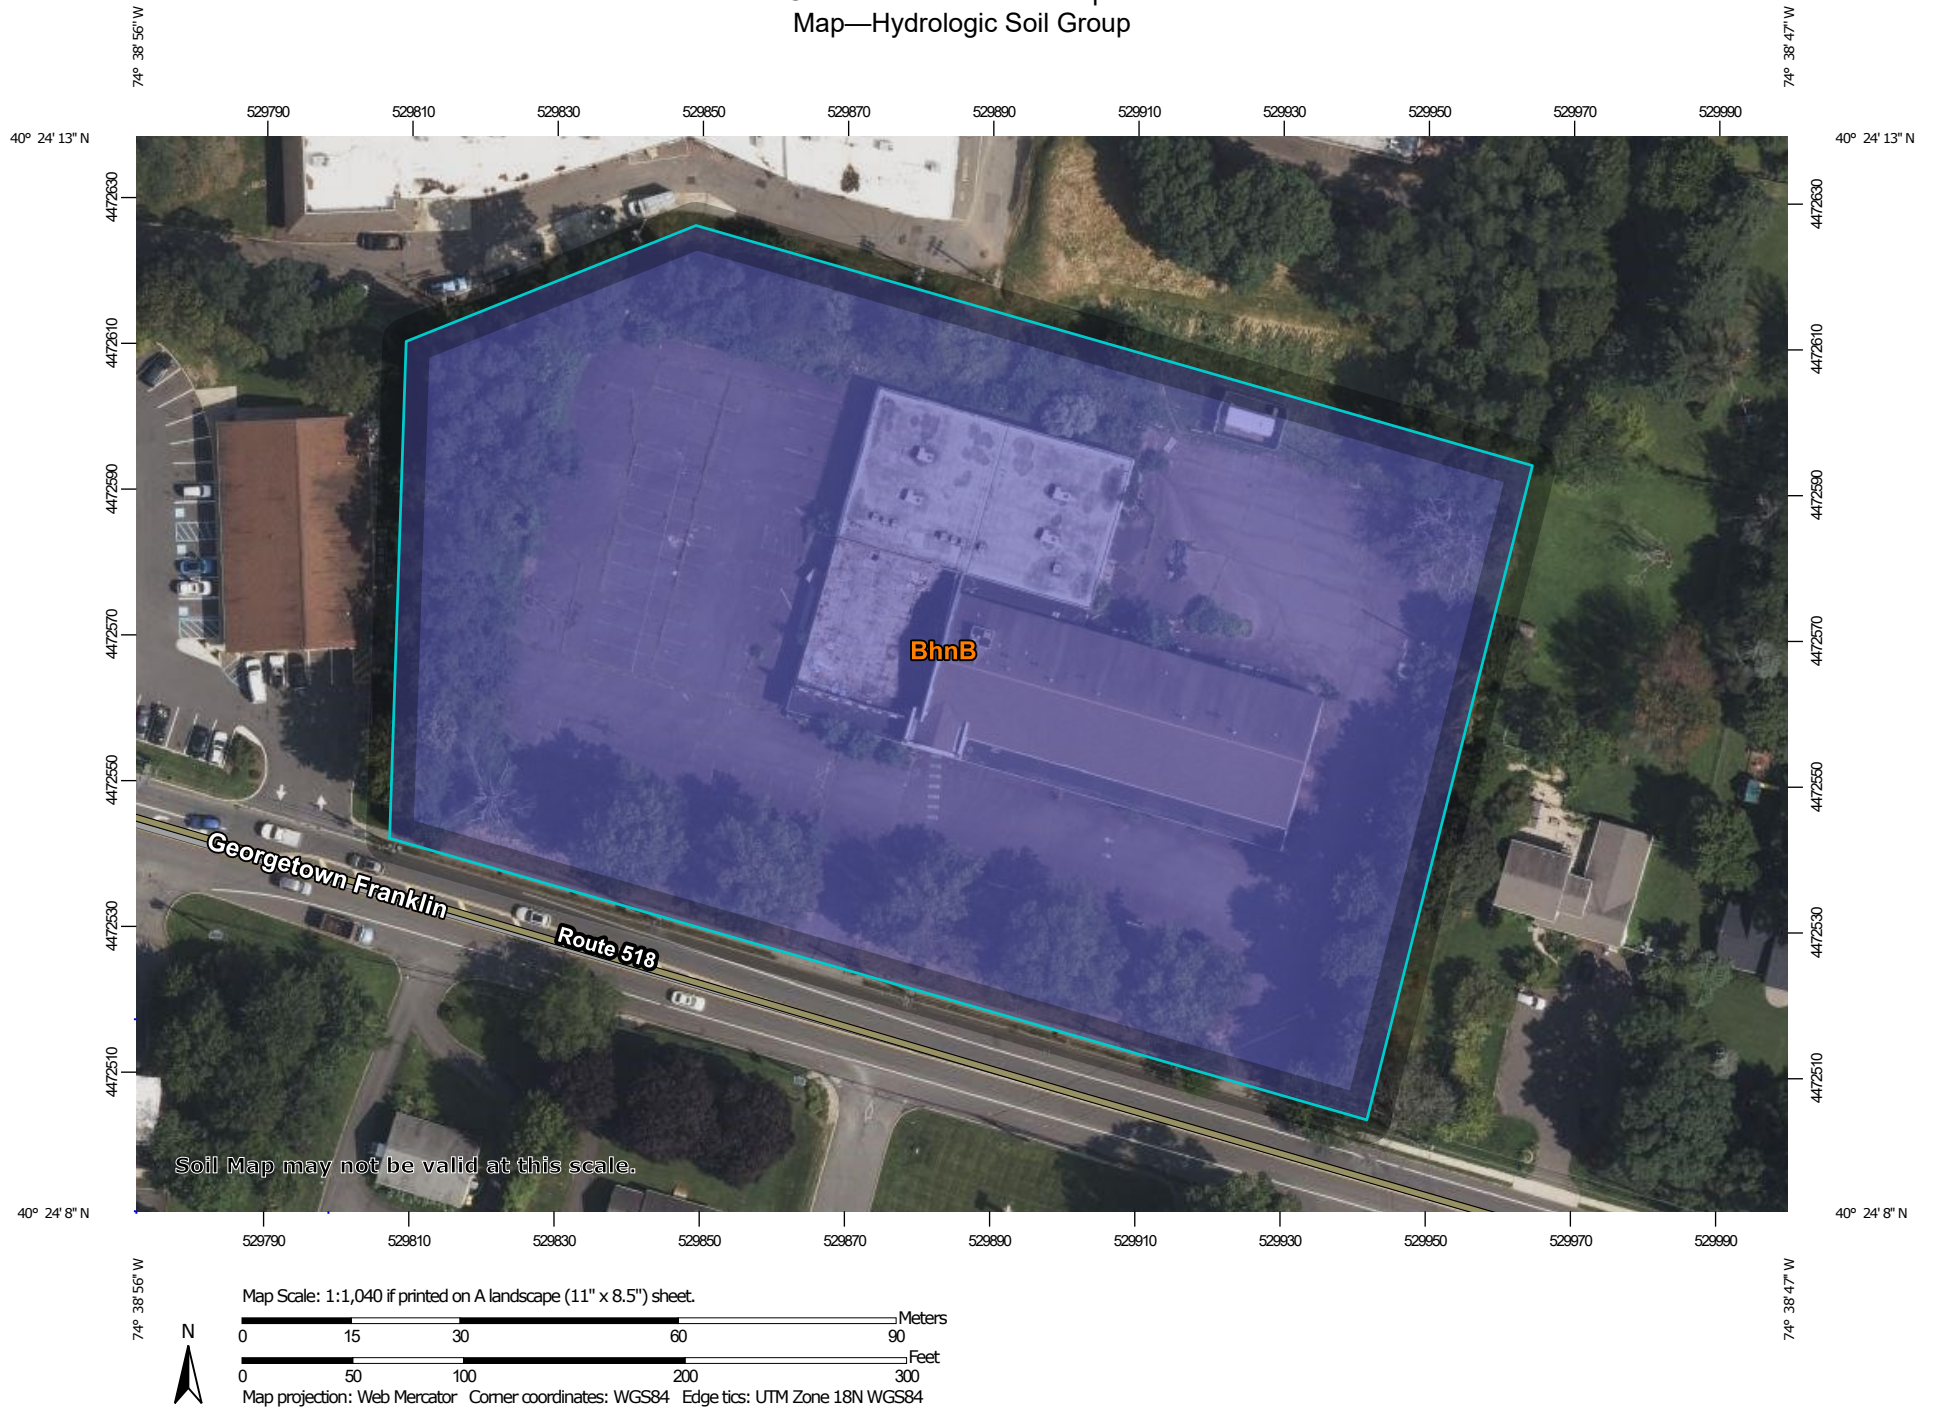

Custom Soil Resource Report

MAP LEGEND

Area of Interest (AOI)

 Area of Interest (AOI)

Soils

Soil Rating Polygons

 A
 A/D
 B
 B/D
 C
 C/D
 D
 Not rated or not available

Soil Rating Lines

 A
 A/D
 B
 B/D
 C
 C/D
 D
 Not rated or not available

Soil Rating Points

 A
 A/D
 B
 B/D

 C
 C/D
 D
 Not rated or not available

Water Features

 Streams and Canals

Transportation

 Rails
 Interstate Highways
 US Routes
 Major Roads
 Local Roads

Background

 Aerial Photography

MAP INFORMATION

The soil surveys that comprise your AOI were mapped at 1:24,000.

Warning: Soil Map may not be valid at this scale.

Enlargement of maps beyond the scale of mapping can cause misunderstanding of the detail of mapping and accuracy of soil line placement. The maps do not show the small areas of contrasting soils that could have been shown at a more detailed scale.

Please rely on the bar scale on each map sheet for map measurements.

Source of Map: Natural Resources Conservation Service
Web Soil Survey URL:
Coordinate System: Web Mercator (EPSG:3857)

Maps from the Web Soil Survey are based on the Web Mercator projection, which preserves direction and shape but distorts distance and area. A projection that preserves area, such as the Albers equal-area conic projection, should be used if more accurate calculations of distance or area are required.

This product is generated from the USDA-NRCS certified data as of the version date(s) listed below.

Soil Survey Area: Somerset County, New Jersey
Survey Area Data: Version 20, Aug 30, 2022

Soil map units are labeled (as space allows) for map scales 1:50,000 or larger.

Date(s) aerial images were photographed: Mar 13, 2021—Sep 14, 2021

The orthophoto or other base map on which the soil lines were compiled and digitized probably differs from the background imagery displayed on these maps. As a result, some minor shifting of map unit boundaries may be evident.

Table—Hydrologic Soil Group

Map unit symbol	Map unit name	Rating	Acres in AOI	Percent of AOI
BhnB	Birdsboro silt loam, 2 to 6 percent slopes	B	3.3	100.0%
Totals for Area of Interest			3.3	100.0%

Rating Options—Hydrologic Soil Group

Aggregation Method: Dominant Condition

Component Percent Cutoff: None Specified

Tie-break Rule: Higher

Water Features


Water Features include ponding frequency, flooding frequency, and depth to water table.

Depth to Water Table

"Water table" refers to a saturated zone in the soil. It occurs during specified months. Estimates of the upper limit are based mainly on observations of the water table at selected sites and on evidence of a saturated zone, namely grayish colors (redoximorphic features) in the soil. A saturated zone that lasts for less than a month is not considered a water table.

This attribute is actually recorded as three separate values in the database. A low value and a high value indicate the range of this attribute for the soil component. A "representative" value indicates the expected value of this attribute for the component. For this soil property, only the representative value is used.

Custom Soil Resource Report
Map—Depth to Water Table

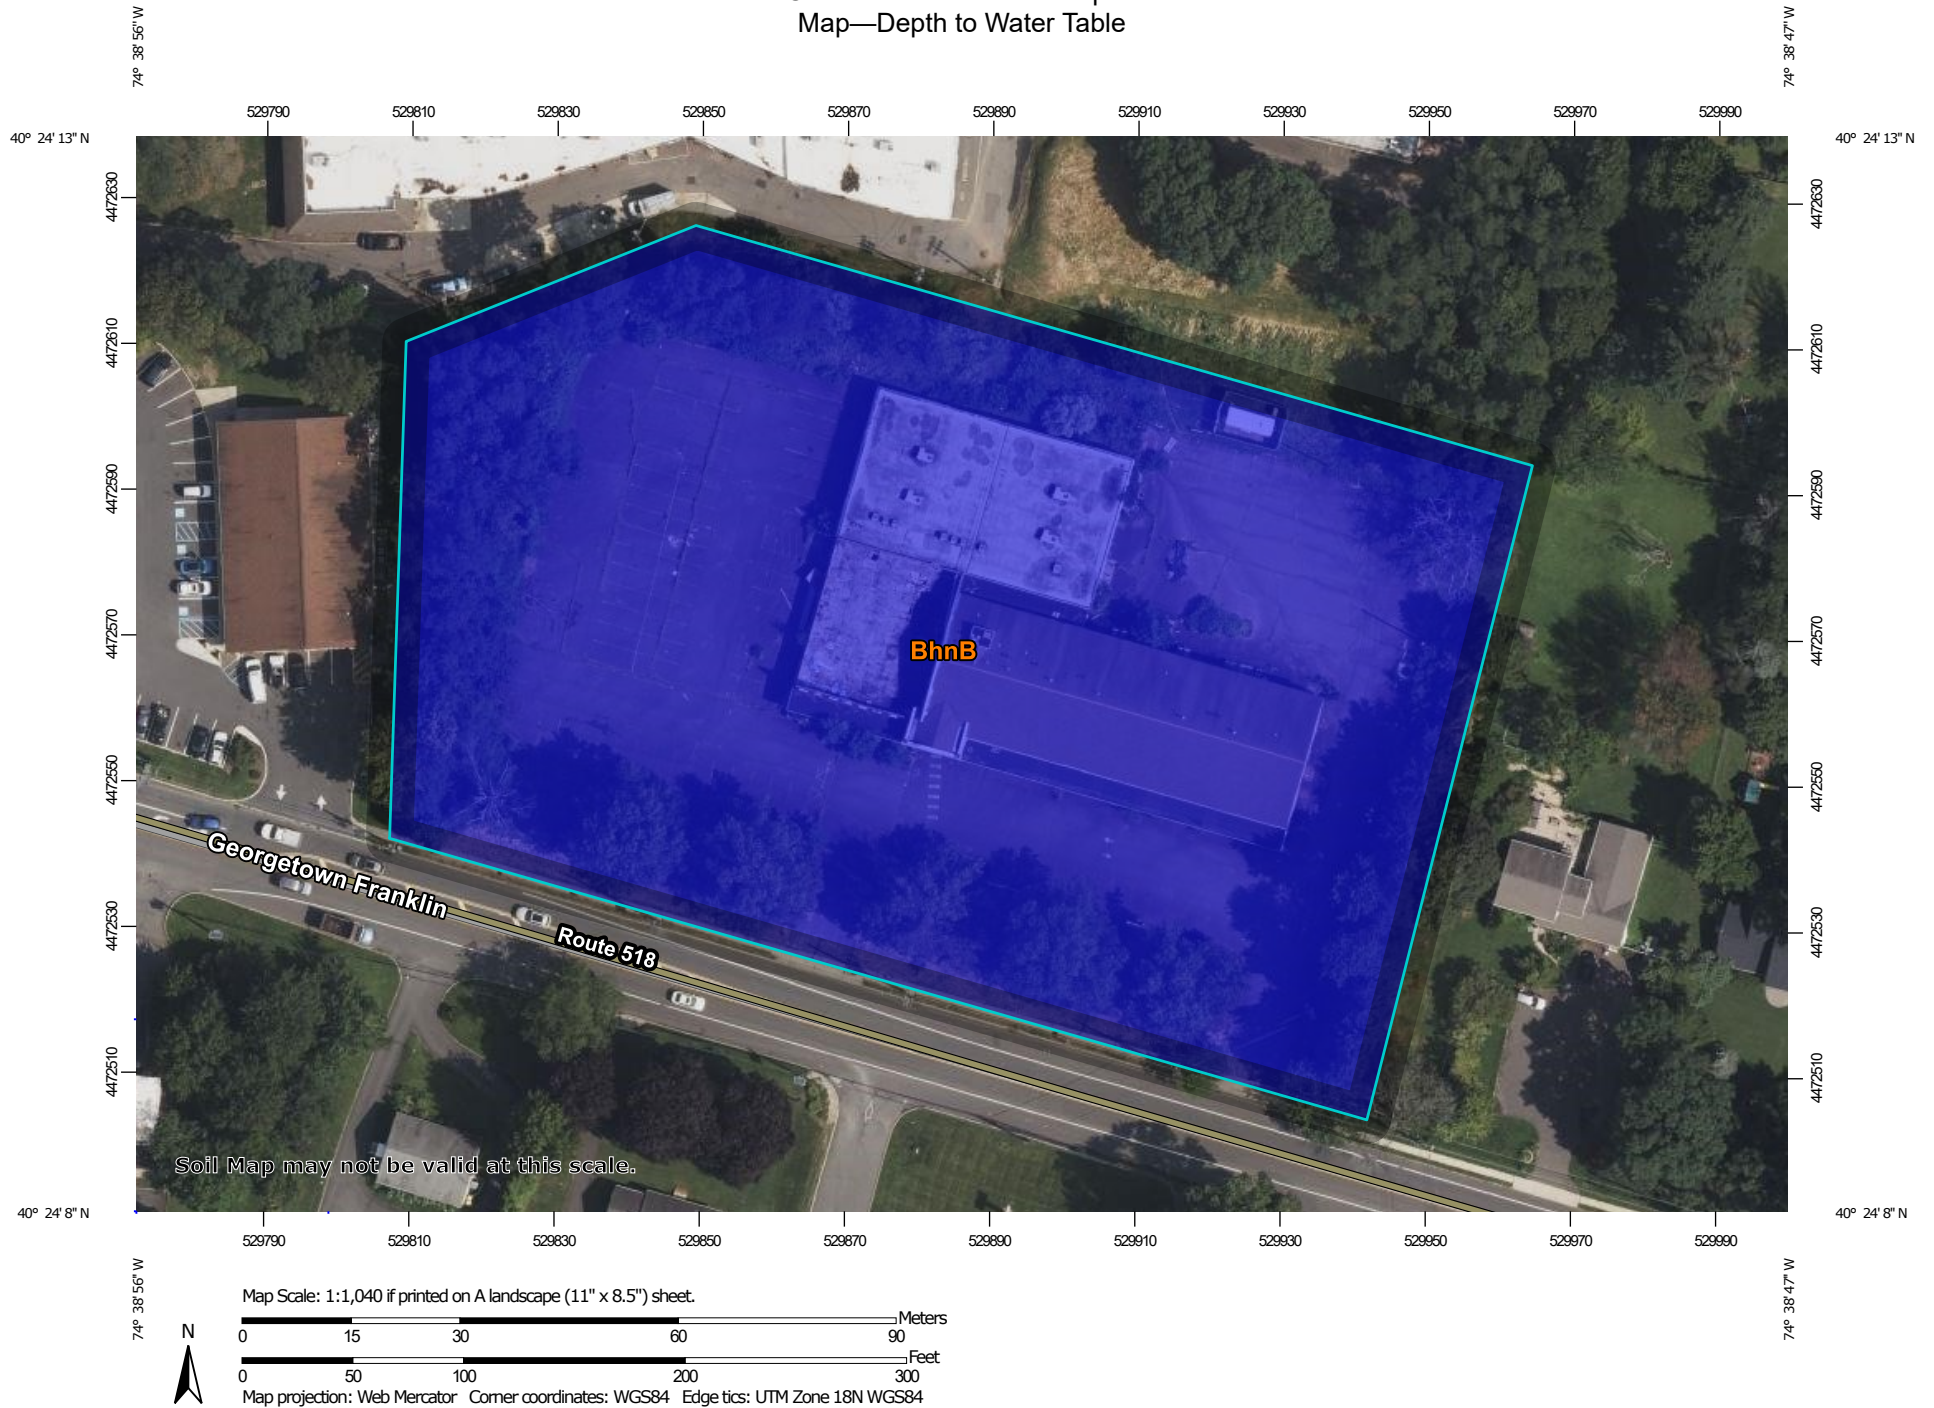

MAP LEGEND

Area of Interest (AOI)

 Area of Interest (AOI)

Soils

Soil Rating Polygons

-  0 - 25
-  25 - 50
-  50 - 100
-  100 - 150
-  150 - 200
-  > 200
-  Not rated or not available

Soil Rating Lines

-  0 - 25
-  25 - 50
-  50 - 100
-  100 - 150
-  150 - 200
-  > 200
-  Not rated or not available

Soil Rating Points

-  0 - 25
-  25 - 50
-  50 - 100
-  100 - 150
-  150 - 200
-  > 200

 Not rated or not available

Water Features

 Streams and Canals

Transportation

-  Rails
-  Interstate Highways
-  US Routes
-  Major Roads
-  Local Roads

Background

 Aerial Photography

MAP INFORMATION

The soil surveys that comprise your AOI were mapped at 1:24,000.

Warning: Soil Map may not be valid at this scale.

Enlargement of maps beyond the scale of mapping can cause misunderstanding of the detail of mapping and accuracy of soil line placement. The maps do not show the small areas of contrasting soils that could have been shown at a more detailed scale.

Please rely on the bar scale on each map sheet for map measurements.

Source of Map: Natural Resources Conservation Service
Web Soil Survey URL:
Coordinate System: Web Mercator (EPSG:3857)

Maps from the Web Soil Survey are based on the Web Mercator projection, which preserves direction and shape but distorts distance and area. A projection that preserves area, such as the Albers equal-area conic projection, should be used if more accurate calculations of distance or area are required.

This product is generated from the USDA-NRCS certified data as of the version date(s) listed below.

Soil Survey Area: Somerset County, New Jersey
Survey Area Data: Version 20, Aug 30, 2022

Soil map units are labeled (as space allows) for map scales 1:50,000 or larger.

Date(s) aerial images were photographed: Mar 13, 2021—Sep 14, 2021

The orthophoto or other base map on which the soil lines were compiled and digitized probably differs from the background imagery displayed on these maps. As a result, some minor shifting of map unit boundaries may be evident.

Table—Depth to Water Table

Map unit symbol	Map unit name	Rating (centimeters)	Acres in AOI	Percent of AOI
BhnB	Birdsboro silt loam, 2 to 6 percent slopes	>200	3.3	100.0%
Totals for Area of Interest			3.3	100.0%

Rating Options—Depth to Water Table

Units of Measure: centimeters

Aggregation Method: Dominant Component

Component Percent Cutoff: None Specified

Tie-break Rule: Lower

Interpret Nulls as Zero: No

Beginning Month: January

Ending Month: December

References

- American Association of State Highway and Transportation Officials (AASHTO). 2004. Standard specifications for transportation materials and methods of sampling and testing. 24th edition.
- American Society for Testing and Materials (ASTM). 2005. Standard classification of soils for engineering purposes. ASTM Standard D2487-00.
- Cowardin, L.M., V. Carter, F.C. Golet, and E.T. LaRoe. 1979. Classification of wetlands and deep-water habitats of the United States. U.S. Fish and Wildlife Service FWS/OBS-79/31.
- Federal Register. July 13, 1994. Changes in hydric soils of the United States.
- Federal Register. September 18, 2002. Hydric soils of the United States.
- Hurt, G.W., and L.M. Vasilas, editors. Version 6.0, 2006. Field indicators of hydric soils in the United States.
- National Research Council. 1995. Wetlands: Characteristics and boundaries.
- Soil Survey Division Staff. 1993. Soil survey manual. Soil Conservation Service. U.S. Department of Agriculture Handbook 18. http://www.nrcs.usda.gov/wps/portal/nrcs/detail/national/soils/?cid=nrcs142p2_054262
- Soil Survey Staff. 1999. Soil taxonomy: A basic system of soil classification for making and interpreting soil surveys. 2nd edition. Natural Resources Conservation Service, U.S. Department of Agriculture Handbook 436. http://www.nrcs.usda.gov/wps/portal/nrcs/detail/national/soils/?cid=nrcs142p2_053577
- Soil Survey Staff. 2010. Keys to soil taxonomy. 11th edition. U.S. Department of Agriculture, Natural Resources Conservation Service. http://www.nrcs.usda.gov/wps/portal/nrcs/detail/national/soils/?cid=nrcs142p2_053580
- Tiner, R.W., Jr. 1985. Wetlands of Delaware. U.S. Fish and Wildlife Service and Delaware Department of Natural Resources and Environmental Control, Wetlands Section.
- United States Army Corps of Engineers, Environmental Laboratory. 1987. Corps of Engineers wetlands delineation manual. Waterways Experiment Station Technical Report Y-87-1.
- United States Department of Agriculture, Natural Resources Conservation Service. National forestry manual. http://www.nrcs.usda.gov/wps/portal/nrcs/detail/soils/home/?cid=nrcs142p2_053374
- United States Department of Agriculture, Natural Resources Conservation Service. National range and pasture handbook. <http://www.nrcs.usda.gov/wps/portal/nrcs/detail/national/landuse/rangepasture/?cid=stelpdb1043084>

Custom Soil Resource Report

United States Department of Agriculture, Natural Resources Conservation Service. National soil survey handbook, title 430-VI. http://www.nrcs.usda.gov/wps/portal/nrcs/detail/soils/scientists/?cid=nrcs142p2_054242

United States Department of Agriculture, Natural Resources Conservation Service. 2006. Land resource regions and major land resource areas of the United States, the Caribbean, and the Pacific Basin. U.S. Department of Agriculture Handbook 296. http://www.nrcs.usda.gov/wps/portal/nrcs/detail/national/soils/?cid=nrcs142p2_053624

United States Department of Agriculture, Soil Conservation Service. 1961. Land capability classification. U.S. Department of Agriculture Handbook 210. http://www.nrcs.usda.gov/Internet/FSE_DOCUMENTS/nrcs142p2_052290.pdf

**HydroCAD SUMMARY REPORTS – EXISTING
CONDITIONS 2 YR 10 YR & 100 YR**

TABLE OF CONTENTS

Project Reports

- 1 Routing Diagram
- 2 Project Notes
- 3 Rainfall Events Listing (selected events)
- 4 Area Listing (all nodes)
- 5 Soil Listing (all nodes)
- 6 Ground Covers (all nodes)

2-Year Event



- 7 Node Listing
- 8 Subcat 1S: Ex SA North Imp
- 10 Subcat 2S: Ex SA North Perv
- 12 Subcat 4S: Ex SA South Imp
- 14 Subcat 5S: Ex SA South Perv
- 16 Link 3L: Ex SA North
- 18 Link 6L: EX SA South

10-Year Event

- 20 Node Listing
- 21 Subcat 1S: Ex SA North Imp
- 23 Subcat 2S: Ex SA North Perv
- 25 Subcat 4S: Ex SA South Imp
- 27 Subcat 5S: Ex SA South Perv
- 29 Link 3L: Ex SA North
- 31 Link 6L: EX SA South

100-Year Event


- 33 Node Listing
- 34 Subcat 1S: Ex SA North Imp
- 36 Subcat 2S: Ex SA North Perv
- 38 Subcat 4S: Ex SA South Imp
- 40 Subcat 5S: Ex SA South Perv
- 42 Link 3L: Ex SA North
- 44 Link 6L: EX SA South

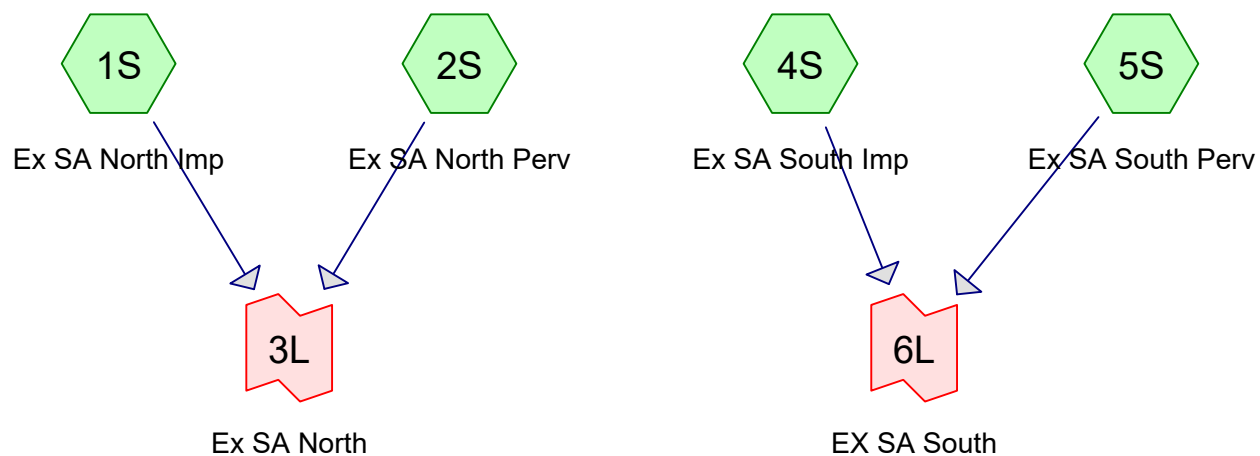

Subcat



Reach



Pond



Link

Routing Diagram for Ex 2 yr, 10 yr, 100 yr

Prepared by Dynamic Engineering, Printed 6/14/2023

HydroCAD® 10.20-3c s/n 08640 © 2023 HydroCAD Software Solutions LLC

Ex 2 yr, 10 yr, 100 yr

Prepared by Dynamic Engineering

HydroCAD® 10.20-3c s/n 08640 © 2023 HydroCAD Software Solutions LLC

Printed 6/14/2023

Page 2

Project Notes

Rainfall events imported from "NRCS-Rain.txt" for 6617 NJ Somerset-C

Ex 2 yr, 10 yr, 100 yr

Prepared by Dynamic Engineering

Printed 6/14/2023

HydroCAD® 10.20-3c s/n 08640 © 2023 HydroCAD Software Solutions LLC

Page 3

Rainfall Events Listing (selected events)

Event#	Event Name	Storm Type	Curve	Mode	Duration (hours)	B/B	Depth (inches)	AMC
1	2-Year	NOAA 24-hr	C	Default	24.00	1	3.34	2
2	10-Year	NOAA 24-hr	C	Default	24.00	1	5.01	2
3	100-Year	NOAA 24-hr	C	Default	24.00	1	8.21	2

Ex 2 yr, 10 yr, 100 yr

Prepared by Dynamic Engineering

HydroCAD® 10.20-3c s/n 08640 © 2023 HydroCAD Software Solutions LLC

Printed 6/14/2023

Page 4

Area Listing (all nodes)

Area (acres)	CN	Description (subcatchment-numbers)
0.588	61	>75% Grass cover, Good, HSG B (2S, 5S)
1.533	98	Paved parking, HSG B (1S, 4S)
0.462	98	Roofs, HSG B (1S, 4S)
0.406	55	Woods, Good, HSG B (2S, 5S)
2.990	85	TOTAL AREA

Ex 2 yr, 10 yr, 100 yr

Prepared by Dynamic Engineering

HydroCAD® 10.20-3c s/n 08640 © 2023 HydroCAD Software Solutions LLC

Printed 6/14/2023

Page 5

Soil Listing (all nodes)

Area (acres)	Soil Group	Subcatchment Numbers
0.000	HSG A	
2.990	HSG B	1S, 2S, 4S, 5S
0.000	HSG C	
0.000	HSG D	
0.000	Other	
2.990		TOTAL AREA

Ex 2 yr, 10 yr, 100 yr

Prepared by Dynamic Engineering

HydroCAD® 10.20-3c s/n 08640 © 2023 HydroCAD Software Solutions LLC

Printed 6/14/2023

Page 6

Ground Covers (all nodes)

HSG-A (acres)	HSG-B (acres)	HSG-C (acres)	HSG-D (acres)	Other (acres)	Total (acres)	Ground Cover	Subcatchment Numbers
0.000	0.588	0.000	0.000	0.000	0.588	>75% Grass cover, Good	2S, 5S
0.000	1.533	0.000	0.000	0.000	1.533	Paved parking	1S, 4S
0.000	0.462	0.000	0.000	0.000	0.462	Roofs	1S, 4S
0.000	0.406	0.000	0.000	0.000	0.406	Woods, Good	2S, 5S
0.000	2.990	0.000	0.000	0.000	2.990	TOTAL AREA	

Ex 2 yr, 10 yr, 100 yr

Prepared by Dynamic Engineering

HydroCAD® 10.20-3c s/n 08640 © 2023 HydroCAD Software Solutions LLC

NOAA 24-hr C 2-Year Rainfall=3.34"

Printed 6/14/2023

Page 7

Time span=0.00-36.00 hrs, dt=0.05 hrs, 721 points
Runoff by SCS TR-20 method, UH=SCS, Weighted-CN
Reach routing by Stor-Ind+Trans method - Pond routing by Stor-Ind method

Subcatchment1S: Ex SA North Imp Runoff Area=48,361 sf 100.00% Impervious Runoff Depth=3.11"
Flow Length=200' Tc=2.1 min CN=98 Runoff=4.38 cfs 0.287 af

Subcatchment2S: Ex SA North Perv Runoff Area=24,838 sf 0.00% Impervious Runoff Depth=0.36"
Flow Length=135' Slope=0.0300 '/' Tc=12.1 min CN=57 Runoff=0.11 cfs 0.017 af

Subcatchment4S: Ex SA South Imp Runoff Area=38,562 sf 100.00% Impervious Runoff Depth=3.11"
Flow Length=140' Slope=0.0090 '/' Tc=1.9 min CN=98 Runoff=3.50 cfs 0.229 af

Subcatchment5S: Ex SA South Perv Runoff Area=18,480 sf 0.00% Impervious Runoff Depth=0.46"
Flow Length=70' Slope=0.0250 '/' Tc=9.6 min CN=60 Runoff=0.15 cfs 0.016 af

Link 3L: Ex SA North Inflow=4.39 cfs 0.304 af
Primary=4.39 cfs 0.304 af

Link 6L: EX SA South Inflow=3.55 cfs 0.246 af
Primary=3.55 cfs 0.246 af

Total Runoff Area = 2.990 ac Runoff Volume = 0.550 af Average Runoff Depth = 2.21"
33.26% Pervious = 0.994 ac 66.74% Impervious = 1.995 ac

Ex 2 yr, 10 yr, 100 yr

Prepared by Dynamic Engineering

HydroCAD® 10.20-3c s/n 08640 © 2023 HydroCAD Software Solutions LLC

NOAA 24-hr C 2-Year Rainfall=3.34"

Printed 6/14/2023

Page 8

Summary for Subcatchment 1S: Ex SA North Imp[49] Hint: $T_c < 2dt$ may require smaller dt

Runoff = 4.38 cfs @ 12.08 hrs, Volume= 0.287 af, Depth= 3.11"
 Routed to Link 3L : Ex SA North


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, $dt=0.05$ hrs
 NOAA 24-hr C 2-Year Rainfall=3.34"

Area (sf)	CN	Description
33,877	98	Paved parking, HSG B
14,484	98	Roofs, HSG B
48,361	98	Weighted Average
48,361		100.00% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
1.5	100	0.0110	1.11		Sheet Flow, Sheet Flow
					Smooth surfaces $n=0.011$ $P2=3.34"$
0.6	100	0.0200	2.87		Shallow Concentrated Flow, Shallow Concentrated Flow
					Paved $K_v=20.3$ fps
2.1	200	Total			

Subcatchment 1S: Ex SA North Imp

Hydrograph

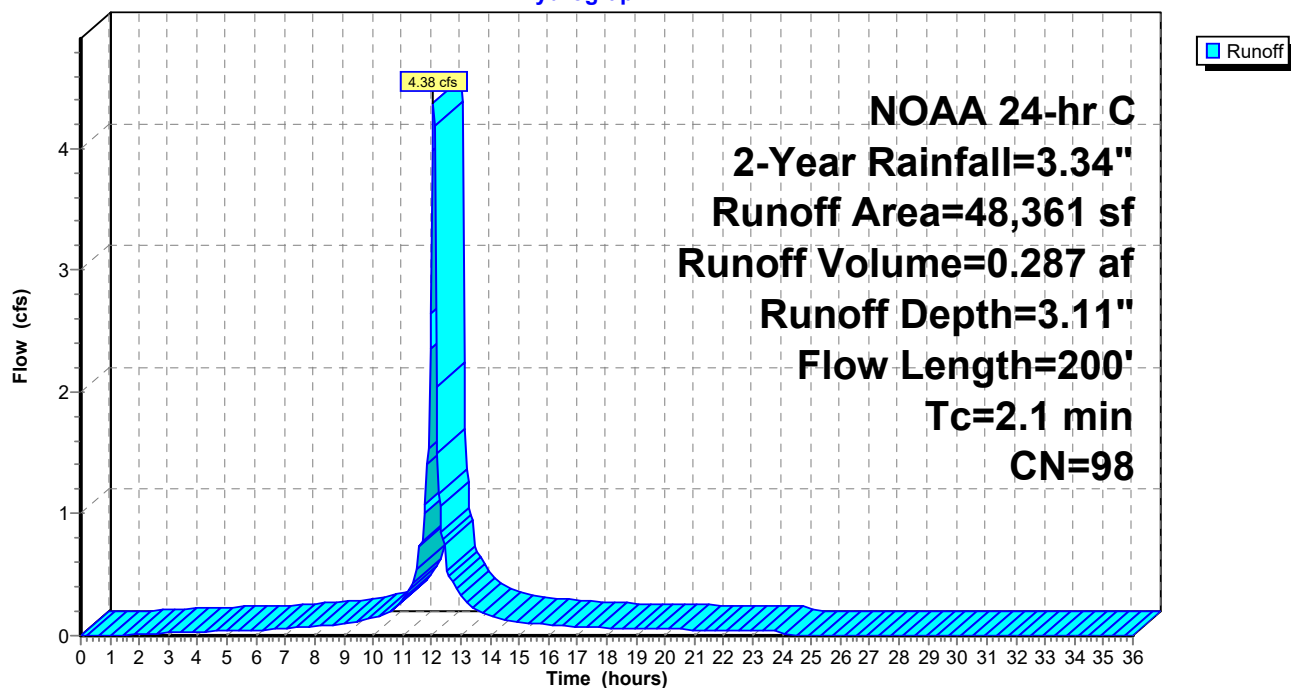

Ex 2 yr, 10 yr, 100 yr

Prepared by Dynamic Engineering

HydroCAD® 10.20-3c s/n 08640 © 2023 HydroCAD Software Solutions LLC

NOAA 24-hr C 2-Year Rainfall=3.34"

Printed 6/14/2023

Page 9

Hydrograph for Subcatchment 1S: Ex SA North Imp

Time (hours)	Precip. (inches)	Excess (inches)	Runoff (cfs)	Time (hours)	Precip. (inches)	Excess (inches)	Runoff (cfs)
0.00	0.00	0.00	0.00	26.00	3.34	3.11	0.00
0.50	0.02	0.00	0.00	26.50	3.34	3.11	0.00
1.00	0.04	0.00	0.00	27.00	3.34	3.11	0.00
1.50	0.06	0.00	0.01	27.50	3.34	3.11	0.00
2.00	0.08	0.01	0.01	28.00	3.34	3.11	0.00
2.50	0.10	0.01	0.02	28.50	3.34	3.11	0.00
3.00	0.12	0.02	0.02	29.00	3.34	3.11	0.00
3.50	0.14	0.03	0.03	29.50	3.34	3.11	0.00
4.00	0.16	0.05	0.03	30.00	3.34	3.11	0.00
4.50	0.19	0.06	0.04	30.50	3.34	3.11	0.00
5.00	0.21	0.08	0.04	31.00	3.34	3.11	0.00
5.50	0.24	0.10	0.04	31.50	3.34	3.11	0.00
6.00	0.26	0.12	0.05	32.00	3.34	3.11	0.00
6.50	0.29	0.14	0.05	32.50	3.34	3.11	0.00
7.00	0.33	0.17	0.06	33.00	3.34	3.11	0.00
7.50	0.36	0.20	0.07	33.50	3.34	3.11	0.00
8.00	0.40	0.23	0.08	34.00	3.34	3.11	0.00
8.50	0.44	0.27	0.09	34.50	3.34	3.11	0.00
9.00	0.49	0.31	0.09	35.00	3.34	3.11	0.00
9.50	0.54	0.36	0.12	35.50	3.34	3.11	0.00
10.00	0.61	0.42	0.15	36.00	3.34	3.11	0.00
10.50	0.69	0.49	0.18				
11.00	0.80	0.60	0.28				
11.50	0.99	0.78	0.48				
12.00	1.59	1.37	2.65				
12.50	2.35	2.12	0.74				
13.00	2.54	2.31	0.33				
13.50	2.65	2.42	0.21				
14.00	2.73	2.50	0.17				
14.50	2.80	2.57	0.14				
15.00	2.85	2.62	0.11				
15.50	2.90	2.67	0.10				
16.00	2.94	2.71	0.09				
16.50	2.98	2.75	0.08				
17.00	3.01	2.78	0.08				
17.50	3.05	2.81	0.07				
18.00	3.08	2.84	0.06				
18.50	3.10	2.87	0.06				
19.00	3.13	2.90	0.06				
19.50	3.15	2.92	0.05				
20.00	3.18	2.94	0.05				
20.50	3.20	2.97	0.05				
21.00	3.22	2.99	0.05				
21.50	3.24	3.01	0.05				
22.00	3.26	3.03	0.05				
22.50	3.28	3.05	0.04				
23.00	3.30	3.07	0.04				
23.50	3.32	3.09	0.04				
24.00	3.34	3.11	0.05				
24.50	3.34	3.11	0.00				
25.00	3.34	3.11	0.00				
25.50	3.34	3.11	0.00				

Ex 2 yr, 10 yr, 100 yr

Prepared by Dynamic Engineering

HydroCAD® 10.20-3c s/n 08640 © 2023 HydroCAD Software Solutions LLC

NOAA 24-hr C 2-Year Rainfall=3.34"

Printed 6/14/2023

Page 10

Summary for Subcatchment 2S: Ex SA North Perv

Runoff = 0.11 cfs @ 12.27 hrs, Volume= 0.017 af, Depth= 0.36"
 Routed to Link 3L : Ex SA North


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs
 NOAA 24-hr C 2-Year Rainfall=3.34"

Area (sf)	CN	Description
15,636	55	Woods, Good, HSG B
9,202	61	>75% Grass cover, Good, HSG B
24,838	57	Weighted Average
24,838		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
11.9	100	0.0300	0.14		Sheet Flow, Sheet Flow
					Grass: Dense n= 0.240 P2= 3.34"
0.2	35	0.0300	2.79		Shallow Concentrated Flow, Shallow Concentrated Flow
					Unpaved Kv= 16.1 fps
12.1	135	Total			

Subcatchment 2S: Ex SA North Perv

Hydrograph

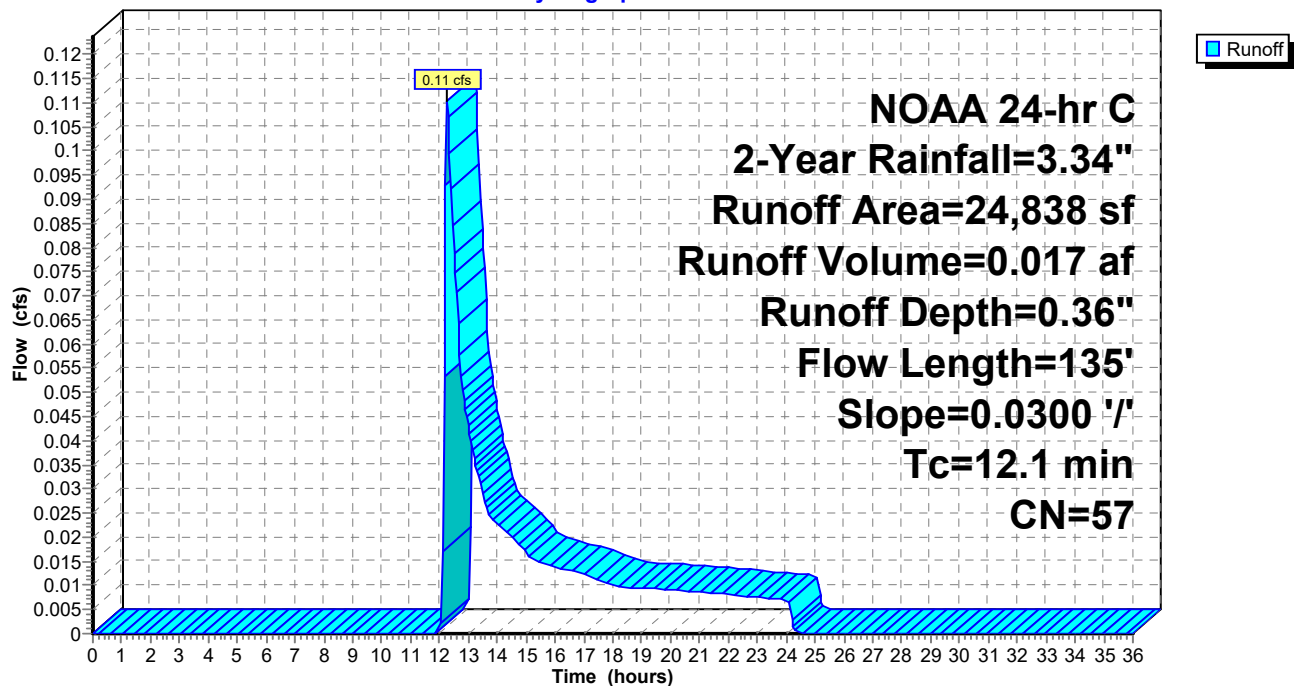

Ex 2 yr, 10 yr, 100 yr

Prepared by Dynamic Engineering

HydroCAD® 10.20-3c s/n 08640 © 2023 HydroCAD Software Solutions LLC

NOAA 24-hr C 2-Year Rainfall=3.34"

Printed 6/14/2023

Page 11

Hydrograph for Subcatchment 2S: Ex SA North Perv

Time (hours)	Precip. (inches)	Excess (inches)	Runoff (cfs)	Time (hours)	Precip. (inches)	Excess (inches)	Runoff (cfs)
0.00	0.00	0.00	0.00	26.00	3.34	0.36	0.00
0.50	0.02	0.00	0.00	26.50	3.34	0.36	0.00
1.00	0.04	0.00	0.00	27.00	3.34	0.36	0.00
1.50	0.06	0.00	0.00	27.50	3.34	0.36	0.00
2.00	0.08	0.00	0.00	28.00	3.34	0.36	0.00
2.50	0.10	0.00	0.00	28.50	3.34	0.36	0.00
3.00	0.12	0.00	0.00	29.00	3.34	0.36	0.00
3.50	0.14	0.00	0.00	29.50	3.34	0.36	0.00
4.00	0.16	0.00	0.00	30.00	3.34	0.36	0.00
4.50	0.19	0.00	0.00	30.50	3.34	0.36	0.00
5.00	0.21	0.00	0.00	31.00	3.34	0.36	0.00
5.50	0.24	0.00	0.00	31.50	3.34	0.36	0.00
6.00	0.26	0.00	0.00	32.00	3.34	0.36	0.00
6.50	0.29	0.00	0.00	32.50	3.34	0.36	0.00
7.00	0.33	0.00	0.00	33.00	3.34	0.36	0.00
7.50	0.36	0.00	0.00	33.50	3.34	0.36	0.00
8.00	0.40	0.00	0.00	34.00	3.34	0.36	0.00
8.50	0.44	0.00	0.00	34.50	3.34	0.36	0.00
9.00	0.49	0.00	0.00	35.00	3.34	0.36	0.00
9.50	0.54	0.00	0.00	35.50	3.34	0.36	0.00
10.00	0.61	0.00	0.00	36.00	3.34	0.36	0.00
10.50	0.69	0.00	0.00				
11.00	0.80	0.00	0.00				
11.50	0.99	0.00	0.00				
12.00	1.59	0.00	0.00				
12.50	2.35	0.08	0.08				
13.00	2.54	0.12	0.04				
13.50	2.65	0.15	0.03				
14.00	2.73	0.17	0.02				
14.50	2.80	0.19	0.02				
15.00	2.85	0.20	0.02				
15.50	2.90	0.22	0.01				
16.00	2.94	0.23	0.01				
16.50	2.98	0.24	0.01				
17.00	3.01	0.25	0.01				
17.50	3.05	0.26	0.01				
18.00	3.08	0.27	0.01				
18.50	3.10	0.28	0.01				
19.00	3.13	0.29	0.01				
19.50	3.15	0.29	0.01				
20.00	3.18	0.30	0.01				
20.50	3.20	0.31	0.01				
21.00	3.22	0.32	0.01				
21.50	3.24	0.32	0.01				
22.00	3.26	0.33	0.01				
22.50	3.28	0.34	0.01				
23.00	3.30	0.34	0.01				
23.50	3.32	0.35	0.01				
24.00	3.34	0.36	0.01				
24.50	3.34	0.36	0.00				
25.00	3.34	0.36	0.00				
25.50	3.34	0.36	0.00				

Ex 2 yr, 10 yr, 100 yr

Prepared by Dynamic Engineering

HydroCAD® 10.20-3c s/n 08640 © 2023 HydroCAD Software Solutions LLC

NOAA 24-hr C 2-Year Rainfall=3.34"

Printed 6/14/2023

Page 12


Summary for Subcatchment 4S: Ex SA South Imp[49] Hint: $T_c < 2dt$ may require smaller dt

Runoff = 3.50 cfs @ 12.08 hrs, Volume= 0.229 af, Depth= 3.11"
Routed to Link 6L : EX SA South

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, $dt=0.05$ hrs
NOAA 24-hr C 2-Year Rainfall=3.34"

Area (sf)	CN	Description
32,900	98	Paved parking, HSG B
5,662	98	Roofs, HSG B
38,562	98	Weighted Average
38,562		100.00% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
1.6	100	0.0090	1.02		Sheet Flow, Sheet Flow Smooth surfaces $n=0.011$ $P2=3.34"$
0.3	40	0.0090	1.93		Shallow Concentrated Flow, Shallow Concentrated Flow Paved $K_v=20.3$ fps
1.9	140	Total			

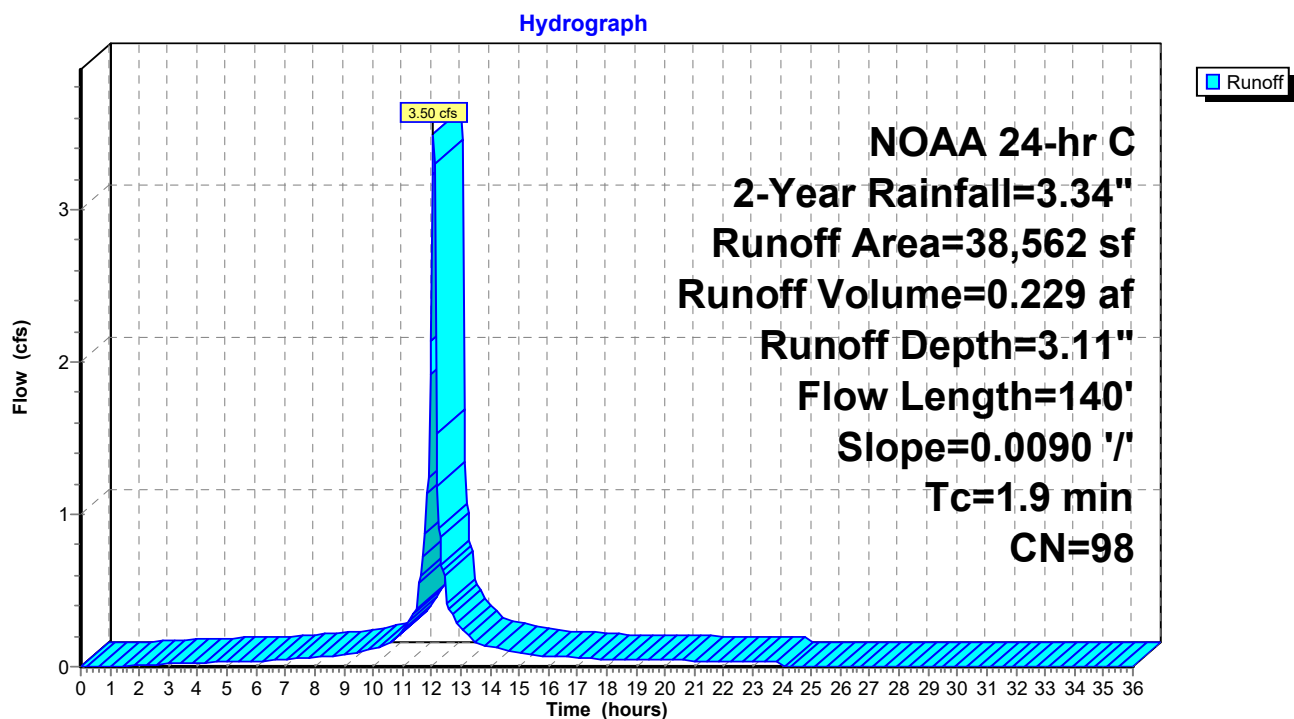Subcatchment 4S: Ex SA South Imp

Ex 2 yr, 10 yr, 100 yr

Prepared by Dynamic Engineering

HydroCAD® 10.20-3c s/n 08640 © 2023 HydroCAD Software Solutions LLC

NOAA 24-hr C 2-Year Rainfall=3.34"

Printed 6/14/2023

Page 13

Hydrograph for Subcatchment 4S: Ex SA South Imp

Time (hours)	Precip. (inches)	Excess (inches)	Runoff (cfs)	Time (hours)	Precip. (inches)	Excess (inches)	Runoff (cfs)
0.00	0.00	0.00	0.00	26.00	3.34	3.11	0.00
0.50	0.02	0.00	0.00	26.50	3.34	3.11	0.00
1.00	0.04	0.00	0.00	27.00	3.34	3.11	0.00
1.50	0.06	0.00	0.00	27.50	3.34	3.11	0.00
2.00	0.08	0.01	0.01	28.00	3.34	3.11	0.00
2.50	0.10	0.01	0.01	28.50	3.34	3.11	0.00
3.00	0.12	0.02	0.02	29.00	3.34	3.11	0.00
3.50	0.14	0.03	0.02	29.50	3.34	3.11	0.00
4.00	0.16	0.05	0.03	30.00	3.34	3.11	0.00
4.50	0.19	0.06	0.03	30.50	3.34	3.11	0.00
5.00	0.21	0.08	0.03	31.00	3.34	3.11	0.00
5.50	0.24	0.10	0.03	31.50	3.34	3.11	0.00
6.00	0.26	0.12	0.04	32.00	3.34	3.11	0.00
6.50	0.29	0.14	0.04	32.50	3.34	3.11	0.00
7.00	0.33	0.17	0.05	33.00	3.34	3.11	0.00
7.50	0.36	0.20	0.06	33.50	3.34	3.11	0.00
8.00	0.40	0.23	0.06	34.00	3.34	3.11	0.00
8.50	0.44	0.27	0.07	34.50	3.34	3.11	0.00
9.00	0.49	0.31	0.08	35.00	3.34	3.11	0.00
9.50	0.54	0.36	0.10	35.50	3.34	3.11	0.00
10.00	0.61	0.42	0.12	36.00	3.34	3.11	0.00
10.50	0.69	0.49	0.14				
11.00	0.80	0.60	0.23				
11.50	0.99	0.78	0.39				
12.00	1.59	1.37	2.14				
12.50	2.35	2.12	0.59				
13.00	2.54	2.31	0.26				
13.50	2.65	2.42	0.17				
14.00	2.73	2.50	0.13				
14.50	2.80	2.57	0.11				
15.00	2.85	2.62	0.09				
15.50	2.90	2.67	0.08				
16.00	2.94	2.71	0.07				
16.50	2.98	2.75	0.07				
17.00	3.01	2.78	0.06				
17.50	3.05	2.81	0.05				
18.00	3.08	2.84	0.05				
18.50	3.10	2.87	0.05				
19.00	3.13	2.90	0.05				
19.50	3.15	2.92	0.04				
20.00	3.18	2.94	0.04				
20.50	3.20	2.97	0.04				
21.00	3.22	2.99	0.04				
21.50	3.24	3.01	0.04				
22.00	3.26	3.03	0.04				
22.50	3.28	3.05	0.03				
23.00	3.30	3.07	0.03				
23.50	3.32	3.09	0.03				
24.00	3.34	3.11	0.04				
24.50	3.34	3.11	0.00				
25.00	3.34	3.11	0.00				
25.50	3.34	3.11	0.00				

Ex 2 yr, 10 yr, 100 yr

Prepared by Dynamic Engineering

HydroCAD® 10.20-3c s/n 08640 © 2023 HydroCAD Software Solutions LLC

NOAA 24-hr C 2-Year Rainfall=3.34"

Printed 6/14/2023

Page 14

Summary for Subcatchment 5S: Ex SA South Perv

Runoff = 0.15 cfs @ 12.21 hrs, Volume= 0.016 af, Depth= 0.46"
Routed to Link 6L : EX SA South


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs
NOAA 24-hr C 2-Year Rainfall=3.34"

Area (sf)	CN	Description
2,059	55	Woods, Good, HSG B
16,421	61	>75% Grass cover, Good, HSG B
18,480	60	Weighted Average
18,480		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
9.6	70	0.0250	0.12		Sheet Flow, Sheet Flow
Grass: Dense n= 0.240 P2= 3.34"					

Subcatchment 5S: Ex SA South Perv

Hydrograph

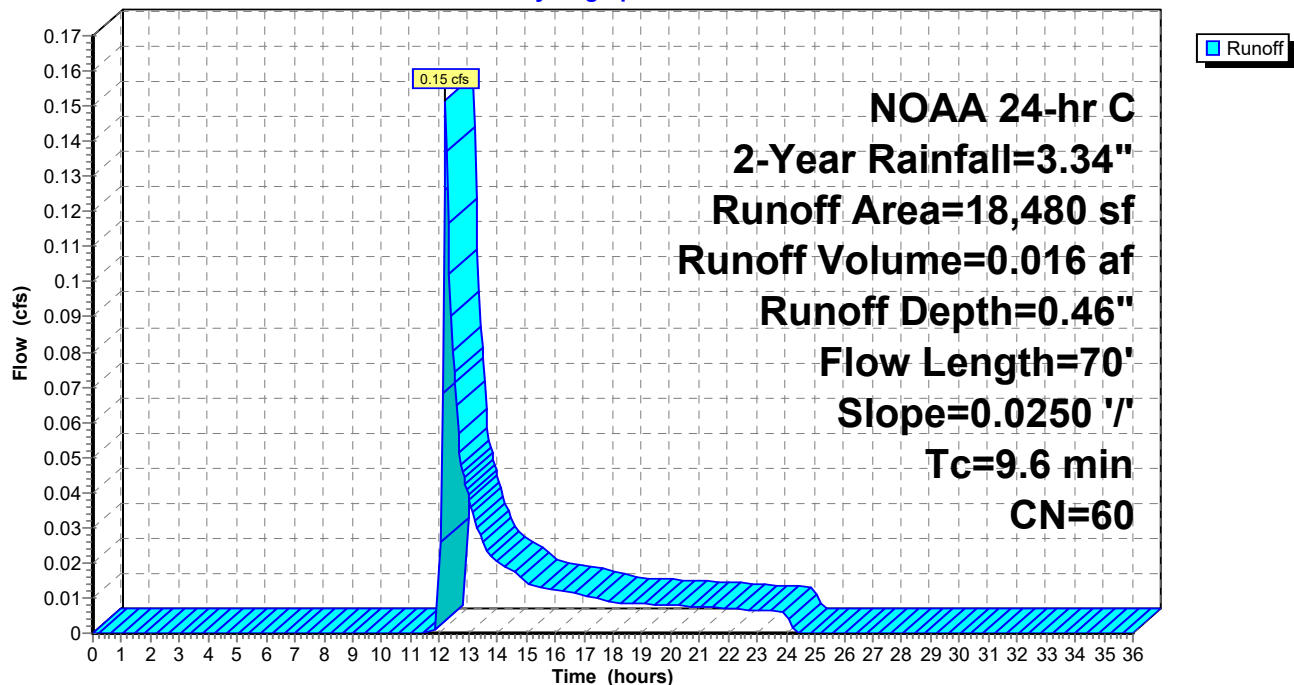

Ex 2 yr, 10 yr, 100 yr

Prepared by Dynamic Engineering

HydroCAD® 10.20-3c s/n 08640 © 2023 HydroCAD Software Solutions LLC

NOAA 24-hr C 2-Year Rainfall=3.34"

Printed 6/14/2023

Page 15


Hydrograph for Subcatchment 5S: Ex SA South Perv

Time (hours)	Precip. (inches)	Excess (inches)	Runoff (cfs)	Time (hours)	Precip. (inches)	Excess (inches)	Runoff (cfs)
0.00	0.00	0.00	0.00	26.00	3.34	0.46	0.00
0.50	0.02	0.00	0.00	26.50	3.34	0.46	0.00
1.00	0.04	0.00	0.00	27.00	3.34	0.46	0.00
1.50	0.06	0.00	0.00	27.50	3.34	0.46	0.00
2.00	0.08	0.00	0.00	28.00	3.34	0.46	0.00
2.50	0.10	0.00	0.00	28.50	3.34	0.46	0.00
3.00	0.12	0.00	0.00	29.00	3.34	0.46	0.00
3.50	0.14	0.00	0.00	29.50	3.34	0.46	0.00
4.00	0.16	0.00	0.00	30.00	3.34	0.46	0.00
4.50	0.19	0.00	0.00	30.50	3.34	0.46	0.00
5.00	0.21	0.00	0.00	31.00	3.34	0.46	0.00
5.50	0.24	0.00	0.00	31.50	3.34	0.46	0.00
6.00	0.26	0.00	0.00	32.00	3.34	0.46	0.00
6.50	0.29	0.00	0.00	32.50	3.34	0.46	0.00
7.00	0.33	0.00	0.00	33.00	3.34	0.46	0.00
7.50	0.36	0.00	0.00	33.50	3.34	0.46	0.00
8.00	0.40	0.00	0.00	34.00	3.34	0.46	0.00
8.50	0.44	0.00	0.00	34.50	3.34	0.46	0.00
9.00	0.49	0.00	0.00	35.00	3.34	0.46	0.00
9.50	0.54	0.00	0.00	35.50	3.34	0.46	0.00
10.00	0.61	0.00	0.00	36.00	3.34	0.46	0.00
10.50	0.69	0.00	0.00				
11.00	0.80	0.00	0.00				
11.50	0.99	0.00	0.00				
12.00	1.59	0.01	0.01				
12.50	2.35	0.14	0.07				
13.00	2.54	0.18	0.04				
13.50	2.65	0.22	0.03				
14.00	2.73	0.24	0.02				
14.50	2.80	0.26	0.02				
15.00	2.85	0.28	0.01				
15.50	2.90	0.30	0.01				
16.00	2.94	0.31	0.01				
16.50	2.98	0.33	0.01				
17.00	3.01	0.34	0.01				
17.50	3.05	0.35	0.01				
18.00	3.08	0.36	0.01				
18.50	3.10	0.37	0.01				
19.00	3.13	0.38	0.01				
19.50	3.15	0.39	0.01				
20.00	3.18	0.40	0.01				
20.50	3.20	0.41	0.01				
21.00	3.22	0.42	0.01				
21.50	3.24	0.43	0.01				
22.00	3.26	0.43	0.01				
22.50	3.28	0.44	0.01				
23.00	3.30	0.45	0.01				
23.50	3.32	0.46	0.01				
24.00	3.34	0.46	0.01				
24.50	3.34	0.46	0.00				
25.00	3.34	0.46	0.00				
25.50	3.34	0.46	0.00				

Summary for Link 3L: Ex SA North

Inflow Area = 1.680 ac, 66.07% Impervious, Inflow Depth = 2.17" for 2-Year event
Inflow = 4.39 cfs @ 12.08 hrs, Volume= 0.304 af
Primary = 4.39 cfs @ 12.08 hrs, Volume= 0.304 af, Atten= 0%, Lag= 0.0 min

Primary outflow = Inflow, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs

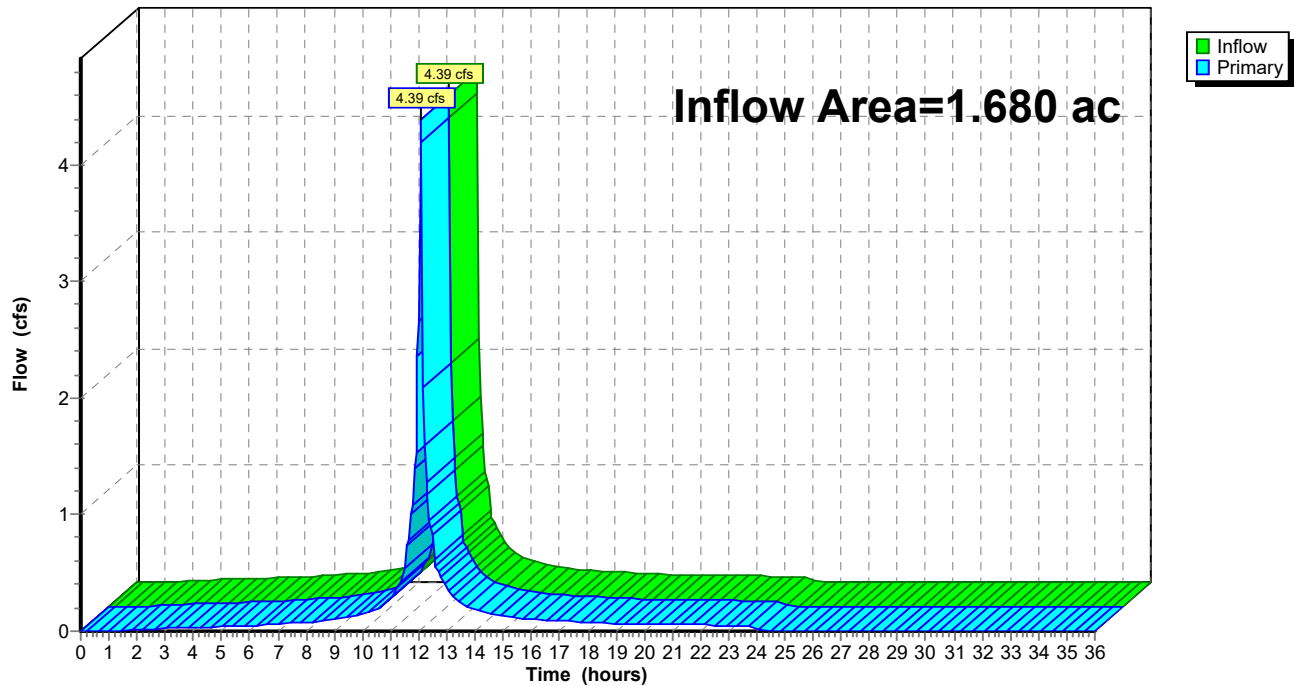Link 3L: Ex SA North**Hydrograph**

Ex 2 yr, 10 yr, 100 yr

Prepared by Dynamic Engineering

HydroCAD® 10.20-3c s/n 08640 © 2023 HydroCAD Software Solutions LLC

NOAA 24-hr C 2-Year Rainfall=3.34"

Printed 6/14/2023

Page 17


Hydrograph for Link 3L: Ex SA North

Time (hours)	Inflow (cfs)	Elevation (feet)	Primary (cfs)	Time (hours)	Inflow (cfs)	Elevation (feet)	Primary (cfs)
0.00	0.00	0.00	0.00	26.00	0.00	0.00	0.00
0.50	0.00	0.00	0.00	26.50	0.00	0.00	0.00
1.00	0.00	0.00	0.00	27.00	0.00	0.00	0.00
1.50	0.01	0.00	0.01	27.50	0.00	0.00	0.00
2.00	0.01	0.00	0.01	28.00	0.00	0.00	0.00
2.50	0.02	0.00	0.02	28.50	0.00	0.00	0.00
3.00	0.02	0.00	0.02	29.00	0.00	0.00	0.00
3.50	0.03	0.00	0.03	29.50	0.00	0.00	0.00
4.00	0.03	0.00	0.03	30.00	0.00	0.00	0.00
4.50	0.04	0.00	0.04	30.50	0.00	0.00	0.00
5.00	0.04	0.00	0.04	31.00	0.00	0.00	0.00
5.50	0.04	0.00	0.04	31.50	0.00	0.00	0.00
6.00	0.05	0.00	0.05	32.00	0.00	0.00	0.00
6.50	0.05	0.00	0.05	32.50	0.00	0.00	0.00
7.00	0.06	0.00	0.06	33.00	0.00	0.00	0.00
7.50	0.07	0.00	0.07	33.50	0.00	0.00	0.00
8.00	0.08	0.00	0.08	34.00	0.00	0.00	0.00
8.50	0.09	0.00	0.09	34.50	0.00	0.00	0.00
9.00	0.09	0.00	0.09	35.00	0.00	0.00	0.00
9.50	0.12	0.00	0.12	35.50	0.00	0.00	0.00
10.00	0.15	0.00	0.15	36.00	0.00	0.00	0.00
10.50	0.18	0.00	0.18				
11.00	0.28	0.00	0.28				
11.50	0.48	0.00	0.48				
12.00	2.65	0.00	2.65				
12.50	0.82	0.00	0.82				
13.00	0.38	0.00	0.38				
13.50	0.24	0.00	0.24				
14.00	0.19	0.00	0.19				
14.50	0.16	0.00	0.16				
15.00	0.13	0.00	0.13				
15.50	0.11	0.00	0.11				
16.00	0.10	0.00	0.10				
16.50	0.10	0.00	0.10				
17.00	0.09	0.00	0.09				
17.50	0.08	0.00	0.08				
18.00	0.07	0.00	0.07				
18.50	0.07	0.00	0.07				
19.00	0.07	0.00	0.07				
19.50	0.06	0.00	0.06				
20.00	0.06	0.00	0.06				
20.50	0.06	0.00	0.06				
21.00	0.06	0.00	0.06				
21.50	0.06	0.00	0.06				
22.00	0.05	0.00	0.05				
22.50	0.05	0.00	0.05				
23.00	0.05	0.00	0.05				
23.50	0.05	0.00	0.05				
24.00	0.05	0.00	0.05				
24.50	0.00	0.00	0.00				
25.00	0.00	0.00	0.00				
25.50	0.00	0.00	0.00				

Summary for Link 6L: EX SA South

Inflow Area = 1.310 ac, 67.60% Impervious, Inflow Depth = 2.25" for 2-Year event
Inflow = 3.55 cfs @ 12.08 hrs, Volume= 0.246 af
Primary = 3.55 cfs @ 12.08 hrs, Volume= 0.246 af, Atten= 0%, Lag= 0.0 min

Primary outflow = Inflow, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs

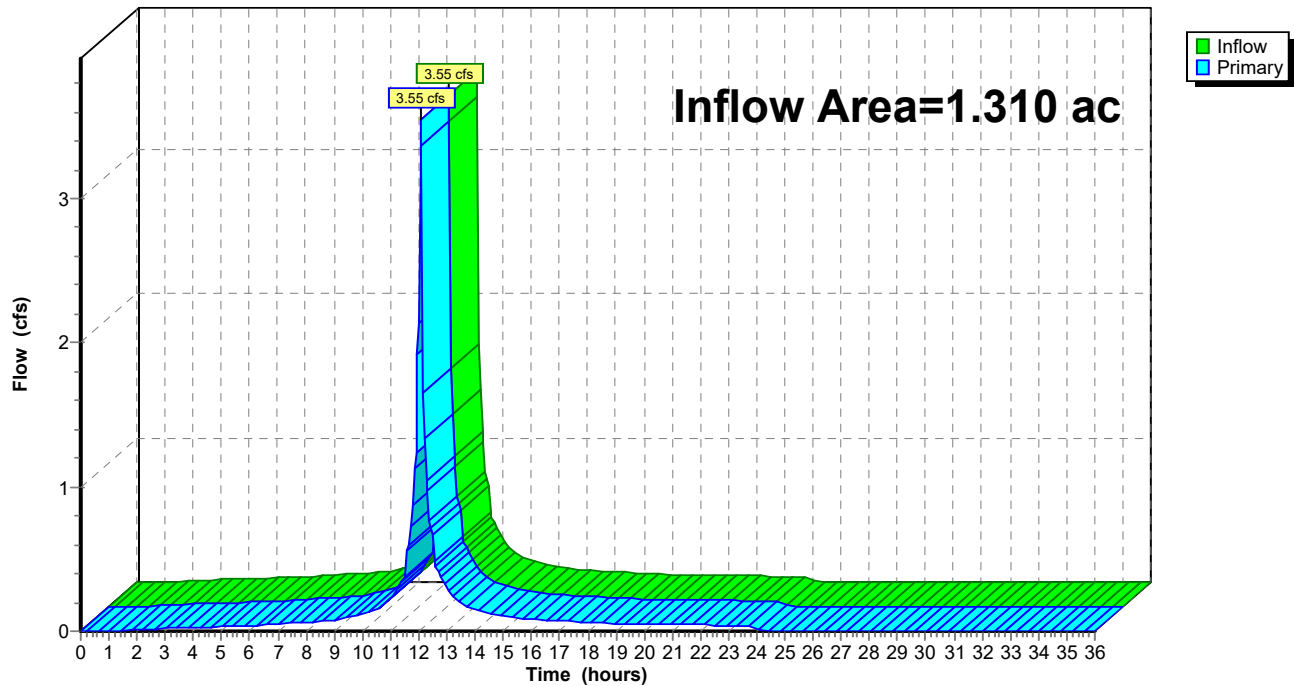Link 6L: EX SA South**Hydrograph**

Ex 2 yr, 10 yr, 100 yr

Prepared by Dynamic Engineering

HydroCAD® 10.20-3c s/n 08640 © 2023 HydroCAD Software Solutions LLC

NOAA 24-hr C 2-Year Rainfall=3.34"

Printed 6/14/2023

Page 19

Hydrograph for Link 6L: EX SA South

Time (hours)	Inflow (cfs)	Elevation (feet)	Primary (cfs)	Time (hours)	Inflow (cfs)	Elevation (feet)	Primary (cfs)
0.00	0.00	0.00	0.00	26.00	0.00	0.00	0.00
0.50	0.00	0.00	0.00	26.50	0.00	0.00	0.00
1.00	0.00	0.00	0.00	27.00	0.00	0.00	0.00
1.50	0.00	0.00	0.00	27.50	0.00	0.00	0.00
2.00	0.01	0.00	0.01	28.00	0.00	0.00	0.00
2.50	0.01	0.00	0.01	28.50	0.00	0.00	0.00
3.00	0.02	0.00	0.02	29.00	0.00	0.00	0.00
3.50	0.02	0.00	0.02	29.50	0.00	0.00	0.00
4.00	0.03	0.00	0.03	30.00	0.00	0.00	0.00
4.50	0.03	0.00	0.03	30.50	0.00	0.00	0.00
5.00	0.03	0.00	0.03	31.00	0.00	0.00	0.00
5.50	0.03	0.00	0.03	31.50	0.00	0.00	0.00
6.00	0.04	0.00	0.04	32.00	0.00	0.00	0.00
6.50	0.04	0.00	0.04	32.50	0.00	0.00	0.00
7.00	0.05	0.00	0.05	33.00	0.00	0.00	0.00
7.50	0.06	0.00	0.06	33.50	0.00	0.00	0.00
8.00	0.06	0.00	0.06	34.00	0.00	0.00	0.00
8.50	0.07	0.00	0.07	34.50	0.00	0.00	0.00
9.00	0.08	0.00	0.08	35.00	0.00	0.00	0.00
9.50	0.10	0.00	0.10	35.50	0.00	0.00	0.00
10.00	0.12	0.00	0.12	36.00	0.00	0.00	0.00
10.50	0.14	0.00	0.14				
11.00	0.23	0.00	0.23				
11.50	0.39	0.00	0.39				
12.00	2.14	0.00	2.14				
12.50	0.66	0.00	0.66				
13.00	0.30	0.00	0.30				
13.50	0.19	0.00	0.19				
14.00	0.15	0.00	0.15				
14.50	0.13	0.00	0.13				
15.00	0.10	0.00	0.10				
15.50	0.09	0.00	0.09				
16.00	0.08	0.00	0.08				
16.50	0.08	0.00	0.08				
17.00	0.07	0.00	0.07				
17.50	0.06	0.00	0.06				
18.00	0.06	0.00	0.06				
18.50	0.06	0.00	0.06				
19.00	0.05	0.00	0.05				
19.50	0.05	0.00	0.05				
20.00	0.05	0.00	0.05				
20.50	0.05	0.00	0.05				
21.00	0.05	0.00	0.05				
21.50	0.04	0.00	0.04				
22.00	0.04	0.00	0.04				
22.50	0.04	0.00	0.04				
23.00	0.04	0.00	0.04				
23.50	0.04	0.00	0.04				
24.00	0.04	0.00	0.04				
24.50	0.00	0.00	0.00				
25.00	0.00	0.00	0.00				
25.50	0.00	0.00	0.00				

Ex 2 yr, 10 yr, 100 yr

Prepared by Dynamic Engineering

HydroCAD® 10.20-3c s/n 08640 © 2023 HydroCAD Software Solutions LLC

NOAA 24-hr C 10-Year Rainfall=5.01"

Printed 6/14/2023

Page 20

Time span=0.00-36.00 hrs, dt=0.05 hrs, 721 points
Runoff by SCS TR-20 method, UH=SCS, Weighted-CN
Reach routing by Stor-Ind+Trans method - Pond routing by Stor-Ind method

Subcatchment1S: Ex SA North Imp Runoff Area=48,361 sf 100.00% Impervious Runoff Depth=4.77"
Flow Length=200' Tc=2.1 min CN=98 Runoff=6.61 cfs 0.442 af

Subcatchment2S: Ex SA North Perv Runoff Area=24,838 sf 0.00% Impervious Runoff Depth=1.11"
Flow Length=135' Slope=0.0300 '/' Tc=12.1 min CN=57 Runoff=0.58 cfs 0.053 af

Subcatchment4S: Ex SA South Imp Runoff Area=38,562 sf 100.00% Impervious Runoff Depth=4.77"
Flow Length=140' Slope=0.0090 '/' Tc=1.9 min CN=98 Runoff=5.28 cfs 0.352 af

Subcatchment5S: Ex SA South Perv Runoff Area=18,480 sf 0.00% Impervious Runoff Depth=1.31"
Flow Length=70' Slope=0.0250 '/' Tc=9.6 min CN=60 Runoff=0.57 cfs 0.046 af

Link 3L: Ex SA North Inflow=6.86 cfs 0.494 af
Primary=6.86 cfs 0.494 af

Link 6L: EX SA South Inflow=5.61 cfs 0.398 af
Primary=5.61 cfs 0.398 af

Total Runoff Area = 2.990 ac Runoff Volume = 0.893 af Average Runoff Depth = 3.58"
33.26% Pervious = 0.994 ac 66.74% Impervious = 1.995 ac

Ex 2 yr, 10 yr, 100 yr

Prepared by Dynamic Engineering

HydroCAD® 10.20-3c s/n 08640 © 2023 HydroCAD Software Solutions LLC

NOAA 24-hr C 10-Year Rainfall=5.01"

Printed 6/14/2023

Page 21

Summary for Subcatchment 1S: Ex SA North Imp[49] Hint: $T_c < 2dt$ may require smaller dt

Runoff = 6.61 cfs @ 12.08 hrs, Volume= 0.442 af, Depth= 4.77"
 Routed to Link 3L : Ex SA North


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, $dt=0.05$ hrs
 NOAA 24-hr C 10-Year Rainfall=5.01"

Area (sf)	CN	Description
33,877	98	Paved parking, HSG B
14,484	98	Roofs, HSG B
48,361	98	Weighted Average
48,361		100.00% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
1.5	100	0.0110	1.11		Sheet Flow, Sheet Flow
					Smooth surfaces $n=0.011$ $P2=3.34"$
0.6	100	0.0200	2.87		Shallow Concentrated Flow, Shallow Concentrated Flow
					Paved $K_v=20.3$ fps
2.1	200	Total			

Subcatchment 1S: Ex SA North Imp

Hydrograph

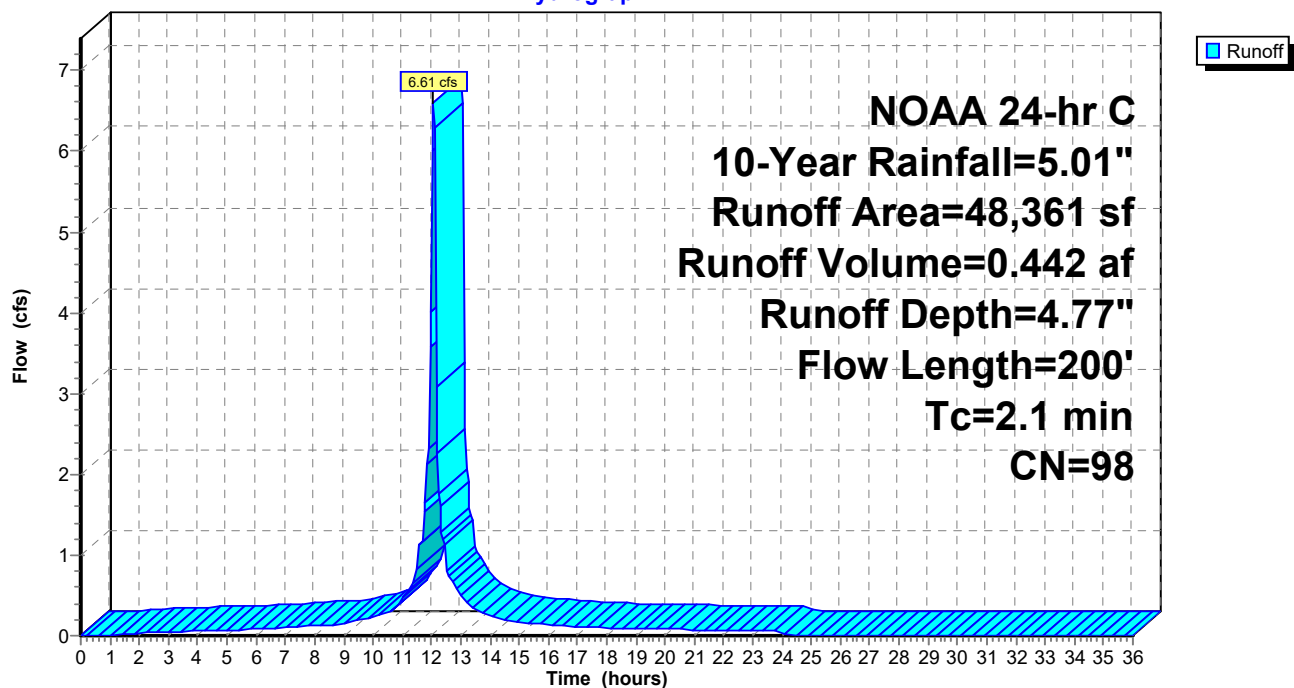

Ex 2 yr, 10 yr, 100 yr

Prepared by Dynamic Engineering

HydroCAD® 10.20-3c s/n 08640 © 2023 HydroCAD Software Solutions LLC

NOAA 24-hr C 10-Year Rainfall=5.01"

Printed 6/14/2023

Page 22

Hydrograph for Subcatchment 1S: Ex SA North Imp

Time (hours)	Precip. (inches)	Excess (inches)	Runoff (cfs)	Time (hours)	Precip. (inches)	Excess (inches)	Runoff (cfs)
0.00	0.00	0.00	0.00	26.00	5.01	4.77	0.00
0.50	0.03	0.00	0.00	26.50	5.01	4.77	0.00
1.00	0.05	0.00	0.01	27.00	5.01	4.77	0.00
1.50	0.08	0.01	0.02	27.50	5.01	4.77	0.00
2.00	0.11	0.02	0.03	28.00	5.01	4.77	0.00
2.50	0.14	0.03	0.04	28.50	5.01	4.77	0.00
3.00	0.18	0.05	0.05	29.00	5.01	4.77	0.00
3.50	0.21	0.08	0.05	29.50	5.01	4.77	0.00
4.00	0.25	0.10	0.06	30.00	5.01	4.77	0.00
4.50	0.28	0.13	0.06	30.50	5.01	4.77	0.00
5.00	0.32	0.16	0.07	31.00	5.01	4.77	0.00
5.50	0.36	0.19	0.07	31.50	5.01	4.77	0.00
6.00	0.40	0.23	0.08	32.00	5.01	4.77	0.00
6.50	0.44	0.26	0.09	32.50	5.01	4.77	0.00
7.00	0.49	0.31	0.10	33.00	5.01	4.77	0.00
7.50	0.54	0.36	0.11	33.50	5.01	4.77	0.00
8.00	0.60	0.41	0.13	34.00	5.01	4.77	0.00
8.50	0.66	0.47	0.14	34.50	5.01	4.77	0.00
9.00	0.73	0.53	0.15	35.00	5.01	4.77	0.00
9.50	0.81	0.61	0.19	35.50	5.01	4.77	0.00
10.00	0.91	0.71	0.23	36.00	5.01	4.77	0.00
10.50	1.03	0.82	0.28				
11.00	1.20	0.99	0.44				
11.50	1.48	1.26	0.74				
12.00	2.39	2.16	4.01				
12.50	3.53	3.30	1.11				
13.00	3.81	3.57	0.50				
13.50	3.98	3.74	0.31				
14.00	4.10	3.86	0.25				
14.50	4.20	3.96	0.21				
15.00	4.28	4.04	0.16				
15.50	4.35	4.11	0.15				
16.00	4.41	4.17	0.14				
16.50	4.47	4.23	0.13				
17.00	4.52	4.29	0.11				
17.50	4.57	4.33	0.10				
18.00	4.61	4.38	0.09				
18.50	4.65	4.42	0.09				
19.00	4.69	4.46	0.09				
19.50	4.73	4.49	0.08				
20.00	4.76	4.53	0.08				
20.50	4.80	4.56	0.08				
21.00	4.83	4.60	0.07				
21.50	4.87	4.63	0.07				
22.00	4.90	4.66	0.07				
22.50	4.93	4.69	0.07				
23.00	4.96	4.72	0.06				
23.50	4.98	4.75	0.06				
24.00	5.01	4.77	0.07				
24.50	5.01	4.77	0.00				
25.00	5.01	4.77	0.00				
25.50	5.01	4.77	0.00				

Ex 2 yr, 10 yr, 100 yr

Prepared by Dynamic Engineering

HydroCAD® 10.20-3c s/n 08640 © 2023 HydroCAD Software Solutions LLC

NOAA 24-hr C 10-Year Rainfall=5.01"

Printed 6/14/2023

Page 23

Summary for Subcatchment 2S: Ex SA North Perv

Runoff = 0.58 cfs @ 12.22 hrs, Volume= 0.053 af, Depth= 1.11"
 Routed to Link 3L : Ex SA North


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs
 NOAA 24-hr C 10-Year Rainfall=5.01"

Area (sf)	CN	Description
15,636	55	Woods, Good, HSG B
9,202	61	>75% Grass cover, Good, HSG B
24,838	57	Weighted Average
24,838		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
11.9	100	0.0300	0.14		Sheet Flow, Sheet Flow
					Grass: Dense n= 0.240 P2= 3.34"
0.2	35	0.0300	2.79		Shallow Concentrated Flow, Shallow Concentrated Flow
					Unpaved Kv= 16.1 fps
12.1	135	Total			

Subcatchment 2S: Ex SA North Perv

Hydrograph

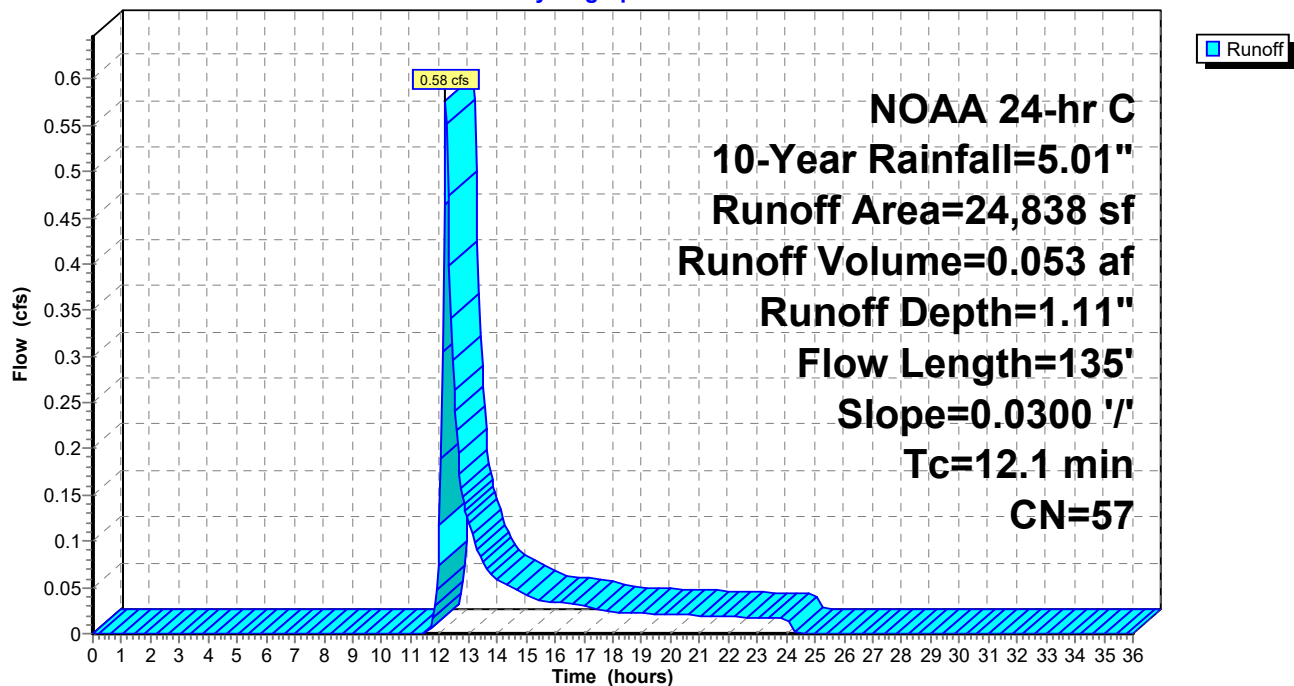

Ex 2 yr, 10 yr, 100 yr

Prepared by Dynamic Engineering

HydroCAD® 10.20-3c s/n 08640 © 2023 HydroCAD Software Solutions LLC

NOAA 24-hr C 10-Year Rainfall=5.01"

Printed 6/14/2023

Page 24

Hydrograph for Subcatchment 2S: Ex SA North Perv

Time (hours)	Precip. (inches)	Excess (inches)	Runoff (cfs)	Time (hours)	Precip. (inches)	Excess (inches)	Runoff (cfs)
0.00	0.00	0.00	0.00	26.00	5.01	1.11	0.00
0.50	0.03	0.00	0.00	26.50	5.01	1.11	0.00
1.00	0.05	0.00	0.00	27.00	5.01	1.11	0.00
1.50	0.08	0.00	0.00	27.50	5.01	1.11	0.00
2.00	0.11	0.00	0.00	28.00	5.01	1.11	0.00
2.50	0.14	0.00	0.00	28.50	5.01	1.11	0.00
3.00	0.18	0.00	0.00	29.00	5.01	1.11	0.00
3.50	0.21	0.00	0.00	29.50	5.01	1.11	0.00
4.00	0.25	0.00	0.00	30.00	5.01	1.11	0.00
4.50	0.28	0.00	0.00	30.50	5.01	1.11	0.00
5.00	0.32	0.00	0.00	31.00	5.01	1.11	0.00
5.50	0.36	0.00	0.00	31.50	5.01	1.11	0.00
6.00	0.40	0.00	0.00	32.00	5.01	1.11	0.00
6.50	0.44	0.00	0.00	32.50	5.01	1.11	0.00
7.00	0.49	0.00	0.00	33.00	5.01	1.11	0.00
7.50	0.54	0.00	0.00	33.50	5.01	1.11	0.00
8.00	0.60	0.00	0.00	34.00	5.01	1.11	0.00
8.50	0.66	0.00	0.00	34.50	5.01	1.11	0.00
9.00	0.73	0.00	0.00	35.00	5.01	1.11	0.00
9.50	0.81	0.00	0.00	35.50	5.01	1.11	0.00
10.00	0.91	0.00	0.00	36.00	5.01	1.11	0.00
10.50	1.03	0.00	0.00				
11.00	1.20	0.00	0.00				
11.50	1.48	0.00	0.00				
12.00	2.39	0.09	0.12				
12.50	3.53	0.43	0.26				
13.00	3.81	0.54	0.12				
13.50	3.98	0.61	0.08				
14.00	4.10	0.66	0.06				
14.50	4.20	0.71	0.05				
15.00	4.28	0.74	0.04				
15.50	4.35	0.78	0.04				
16.00	4.41	0.81	0.03				
16.50	4.47	0.83	0.03				
17.00	4.52	0.86	0.03				
17.50	4.57	0.88	0.03				
18.00	4.61	0.90	0.02				
18.50	4.65	0.92	0.02				
19.00	4.69	0.94	0.02				
19.50	4.73	0.96	0.02				
20.00	4.76	0.98	0.02				
20.50	4.80	1.00	0.02				
21.00	4.83	1.02	0.02				
21.50	4.87	1.03	0.02				
22.00	4.90	1.05	0.02				
22.50	4.93	1.07	0.02				
23.00	4.96	1.08	0.02				
23.50	4.98	1.10	0.02				
24.00	5.01	1.11	0.02				
24.50	5.01	1.11	0.00				
25.00	5.01	1.11	0.00				
25.50	5.01	1.11	0.00				

Ex 2 yr, 10 yr, 100 yr

Prepared by Dynamic Engineering

HydroCAD® 10.20-3c s/n 08640 © 2023 HydroCAD Software Solutions LLC

NOAA 24-hr C 10-Year Rainfall=5.01"

Printed 6/14/2023

Page 25

Summary for Subcatchment 4S: Ex SA South Imp[49] Hint: $T_c < 2dt$ may require smaller dt

Runoff = 5.28 cfs @ 12.08 hrs, Volume= 0.352 af, Depth= 4.77"
 Routed to Link 6L : EX SA South


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, $dt=0.05$ hrs
 NOAA 24-hr C 10-Year Rainfall=5.01"

Area (sf)	CN	Description
32,900	98	Paved parking, HSG B
5,662	98	Roofs, HSG B
38,562	98	Weighted Average
38,562		100.00% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
1.6	100	0.0090	1.02		Sheet Flow, Sheet Flow
					Smooth surfaces $n=0.011$ $P2=3.34"$
0.3	40	0.0090	1.93		Shallow Concentrated Flow, Shallow Concentrated Flow
					Paved $K_v=20.3$ fps
1.9	140	Total			

Subcatchment 4S: Ex SA South Imp

Hydrograph

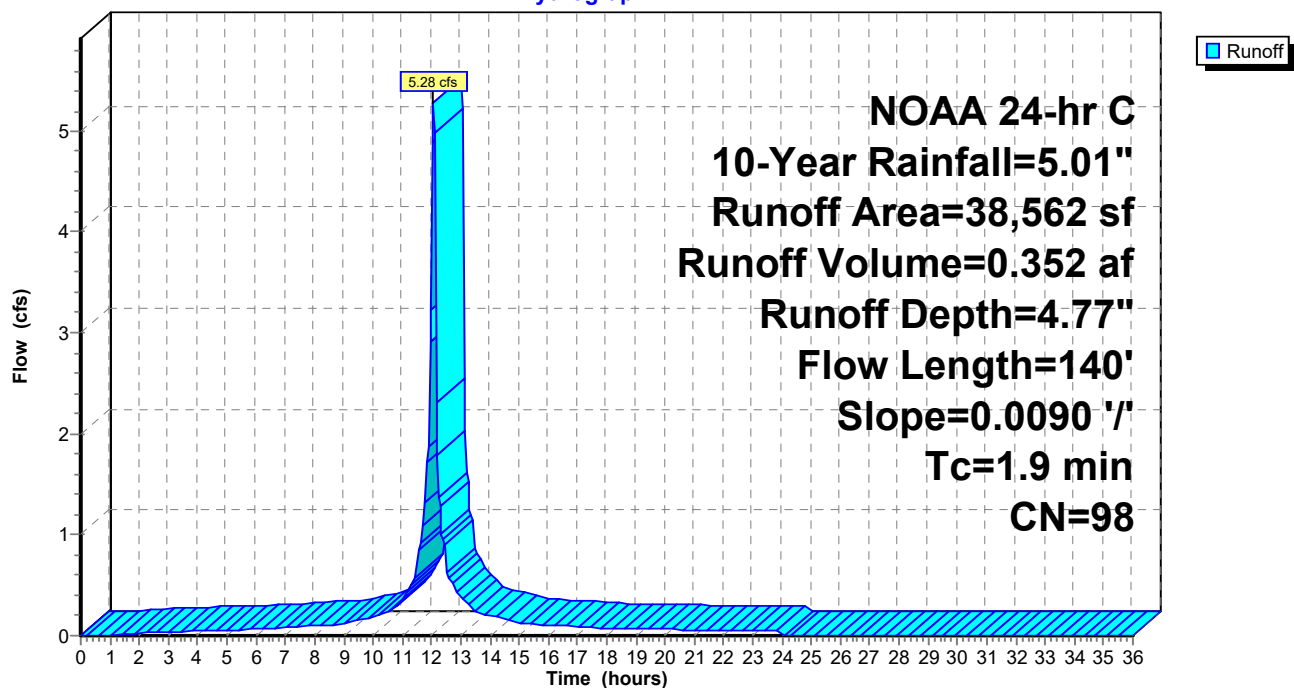

Ex 2 yr, 10 yr, 100 yr

Prepared by Dynamic Engineering

HydroCAD® 10.20-3c s/n 08640 © 2023 HydroCAD Software Solutions LLC

NOAA 24-hr C 10-Year Rainfall=5.01"

Printed 6/14/2023

Page 26

Hydrograph for Subcatchment 4S: Ex SA South Imp

Time (hours)	Precip. (inches)	Excess (inches)	Runoff (cfs)	Time (hours)	Precip. (inches)	Excess (inches)	Runoff (cfs)
0.00	0.00	0.00	0.00	26.00	5.01	4.77	0.00
0.50	0.03	0.00	0.00	26.50	5.01	4.77	0.00
1.00	0.05	0.00	0.01	27.00	5.01	4.77	0.00
1.50	0.08	0.01	0.02	27.50	5.01	4.77	0.00
2.00	0.11	0.02	0.02	28.00	5.01	4.77	0.00
2.50	0.14	0.03	0.03	28.50	5.01	4.77	0.00
3.00	0.18	0.05	0.04	29.00	5.01	4.77	0.00
3.50	0.21	0.08	0.04	29.50	5.01	4.77	0.00
4.00	0.25	0.10	0.05	30.00	5.01	4.77	0.00
4.50	0.28	0.13	0.05	30.50	5.01	4.77	0.00
5.00	0.32	0.16	0.06	31.00	5.01	4.77	0.00
5.50	0.36	0.19	0.06	31.50	5.01	4.77	0.00
6.00	0.40	0.23	0.06	32.00	5.01	4.77	0.00
6.50	0.44	0.26	0.07	32.50	5.01	4.77	0.00
7.00	0.49	0.31	0.08	33.00	5.01	4.77	0.00
7.50	0.54	0.36	0.09	33.50	5.01	4.77	0.00
8.00	0.60	0.41	0.10	34.00	5.01	4.77	0.00
8.50	0.66	0.47	0.11	34.50	5.01	4.77	0.00
9.00	0.73	0.53	0.12	35.00	5.01	4.77	0.00
9.50	0.81	0.61	0.15	35.50	5.01	4.77	0.00
10.00	0.91	0.71	0.19	36.00	5.01	4.77	0.00
10.50	1.03	0.82	0.22				
11.00	1.20	0.99	0.35				
11.50	1.48	1.26	0.59				
12.00	2.39	2.16	3.23				
12.50	3.53	3.30	0.88				
13.00	3.81	3.57	0.40				
13.50	3.98	3.74	0.25				
14.00	4.10	3.86	0.20				
14.50	4.20	3.96	0.17				
15.00	4.28	4.04	0.13				
15.50	4.35	4.11	0.12				
16.00	4.41	4.17	0.11				
16.50	4.47	4.23	0.10				
17.00	4.52	4.29	0.09				
17.50	4.57	4.33	0.08				
18.00	4.61	4.38	0.07				
18.50	4.65	4.42	0.07				
19.00	4.69	4.46	0.07				
19.50	4.73	4.49	0.07				
20.00	4.76	4.53	0.06				
20.50	4.80	4.56	0.06				
21.00	4.83	4.60	0.06				
21.50	4.87	4.63	0.06				
22.00	4.90	4.66	0.05				
22.50	4.93	4.69	0.05				
23.00	4.96	4.72	0.05				
23.50	4.98	4.75	0.05				
24.00	5.01	4.77	0.05				
24.50	5.01	4.77	0.00				
25.00	5.01	4.77	0.00				
25.50	5.01	4.77	0.00				

Ex 2 yr, 10 yr, 100 yr

Prepared by Dynamic Engineering

HydroCAD® 10.20-3c s/n 08640 © 2023 HydroCAD Software Solutions LLC

NOAA 24-hr C 10-Year Rainfall=5.01"

Printed 6/14/2023

Page 27

Summary for Subcatchment 5S: Ex SA South Perv

Runoff = 0.57 cfs @ 12.18 hrs, Volume= 0.046 af, Depth= 1.31"
Routed to Link 6L : EX SA South


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs
NOAA 24-hr C 10-Year Rainfall=5.01"

Area (sf)	CN	Description
2,059	55	Woods, Good, HSG B
16,421	61	>75% Grass cover, Good, HSG B
18,480	60	Weighted Average
18,480		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
9.6	70	0.0250	0.12		Sheet Flow, Sheet Flow Grass: Dense n= 0.240 P2= 3.34"

Subcatchment 5S: Ex SA South Perv

Hydrograph

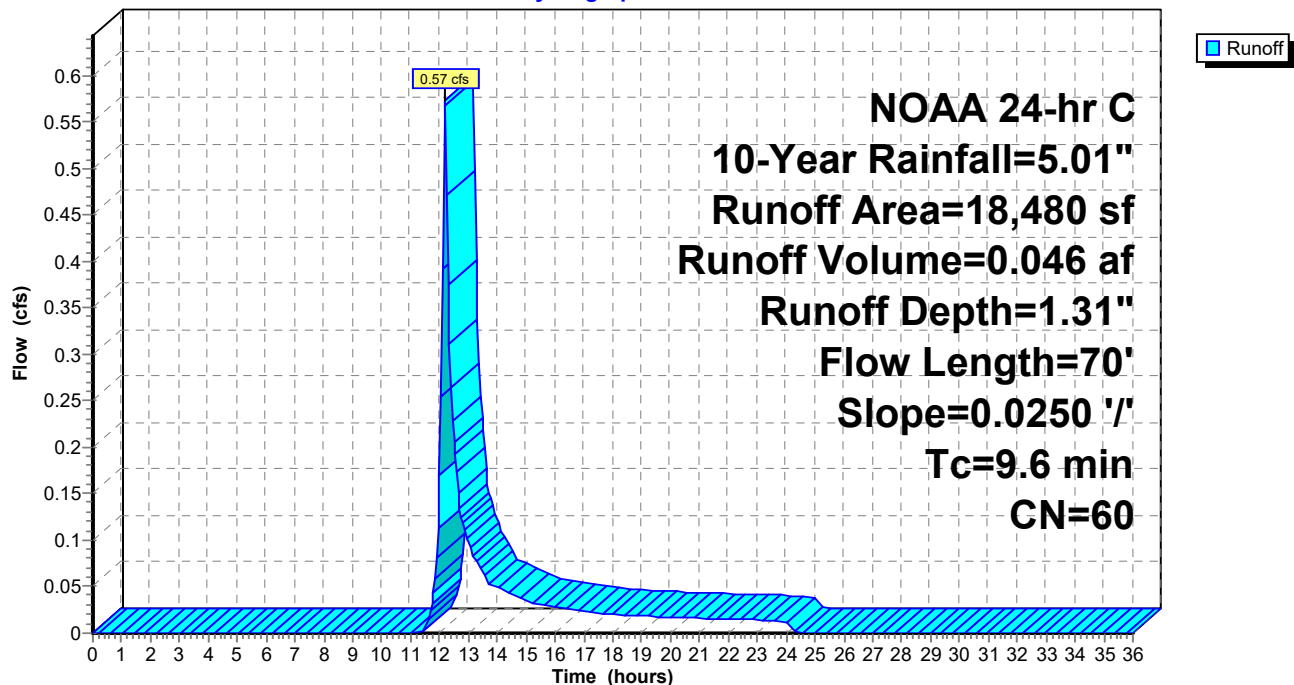

Ex 2 yr, 10 yr, 100 yr

Prepared by Dynamic Engineering

HydroCAD® 10.20-3c s/n 08640 © 2023 HydroCAD Software Solutions LLC

NOAA 24-hr C 10-Year Rainfall=5.01"

Printed 6/14/2023

Page 28

Hydrograph for Subcatchment 5S: Ex SA South Perv

Time (hours)	Precip. (inches)	Excess (inches)	Runoff (cfs)	Time (hours)	Precip. (inches)	Excess (inches)	Runoff (cfs)
0.00	0.00	0.00	0.00	26.00	5.01	1.31	0.00
0.50	0.03	0.00	0.00	26.50	5.01	1.31	0.00
1.00	0.05	0.00	0.00	27.00	5.01	1.31	0.00
1.50	0.08	0.00	0.00	27.50	5.01	1.31	0.00
2.00	0.11	0.00	0.00	28.00	5.01	1.31	0.00
2.50	0.14	0.00	0.00	28.50	5.01	1.31	0.00
3.00	0.18	0.00	0.00	29.00	5.01	1.31	0.00
3.50	0.21	0.00	0.00	29.50	5.01	1.31	0.00
4.00	0.25	0.00	0.00	30.00	5.01	1.31	0.00
4.50	0.28	0.00	0.00	30.50	5.01	1.31	0.00
5.00	0.32	0.00	0.00	31.00	5.01	1.31	0.00
5.50	0.36	0.00	0.00	31.50	5.01	1.31	0.00
6.00	0.40	0.00	0.00	32.00	5.01	1.31	0.00
6.50	0.44	0.00	0.00	32.50	5.01	1.31	0.00
7.00	0.49	0.00	0.00	33.00	5.01	1.31	0.00
7.50	0.54	0.00	0.00	33.50	5.01	1.31	0.00
8.00	0.60	0.00	0.00	34.00	5.01	1.31	0.00
8.50	0.66	0.00	0.00	34.50	5.01	1.31	0.00
9.00	0.73	0.00	0.00	35.00	5.01	1.31	0.00
9.50	0.81	0.00	0.00	35.50	5.01	1.31	0.00
10.00	0.91	0.00	0.00	36.00	5.01	1.31	0.00
10.50	1.03	0.00	0.00				
11.00	1.20	0.00	0.00				
11.50	1.48	0.00	0.00				
12.00	2.39	0.14	0.17				
12.50	3.53	0.54	0.21				
13.00	3.81	0.67	0.10				
13.50	3.98	0.75	0.06				
14.00	4.10	0.81	0.05				
14.50	4.20	0.86	0.04				
15.00	4.28	0.90	0.03				
15.50	4.35	0.94	0.03				
16.00	4.41	0.97	0.03				
16.50	4.47	1.00	0.03				
17.00	4.52	1.03	0.02				
17.50	4.57	1.06	0.02				
18.00	4.61	1.08	0.02				
18.50	4.65	1.10	0.02				
19.00	4.69	1.12	0.02				
19.50	4.73	1.15	0.02				
20.00	4.76	1.17	0.02				
20.50	4.80	1.19	0.02				
21.00	4.83	1.20	0.02				
21.50	4.87	1.22	0.02				
22.00	4.90	1.24	0.02				
22.50	4.93	1.26	0.01				
23.00	4.96	1.28	0.01				
23.50	4.98	1.29	0.01				
24.00	5.01	1.31	0.01				
24.50	5.01	1.31	0.00				
25.00	5.01	1.31	0.00				
25.50	5.01	1.31	0.00				

Ex 2 yr, 10 yr, 100 yr

Prepared by Dynamic Engineering

HydroCAD® 10.20-3c s/n 08640 © 2023 HydroCAD Software Solutions LLC

NOAA 24-hr C 10-Year Rainfall=5.01"

Printed 6/14/2023

Page 29


Summary for Link 3L: Ex SA North

Inflow Area = 1.680 ac, 66.07% Impervious, Inflow Depth = 3.53" for 10-Year event
Inflow = 6.86 cfs @ 12.08 hrs, Volume= 0.494 af
Primary = 6.86 cfs @ 12.08 hrs, Volume= 0.494 af, Atten= 0%, Lag= 0.0 min

Primary outflow = Inflow, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs

Link 3L: Ex SA North

Hydrograph

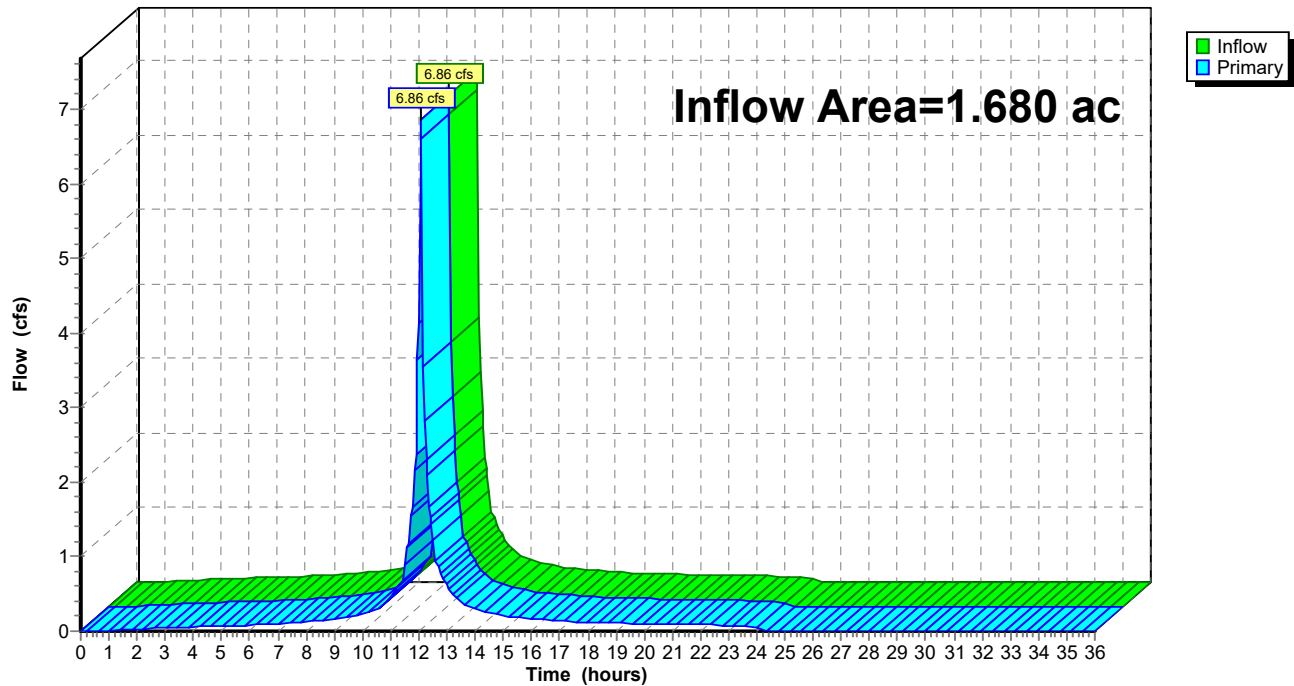

Ex 2 yr, 10 yr, 100 yr

Prepared by Dynamic Engineering

HydroCAD® 10.20-3c s/n 08640 © 2023 HydroCAD Software Solutions LLC

NOAA 24-hr C 10-Year Rainfall=5.01"

Printed 6/14/2023

Page 30

Hydrograph for Link 3L: Ex SA North

Time (hours)	Inflow (cfs)	Elevation (feet)	Primary (cfs)	Time (hours)	Inflow (cfs)	Elevation (feet)	Primary (cfs)
0.00	0.00	0.00	0.00	26.00	0.00	0.00	0.00
0.50	0.00	0.00	0.00	26.50	0.00	0.00	0.00
1.00	0.01	0.00	0.01	27.00	0.00	0.00	0.00
1.50	0.02	0.00	0.02	27.50	0.00	0.00	0.00
2.00	0.03	0.00	0.03	28.00	0.00	0.00	0.00
2.50	0.04	0.00	0.04	28.50	0.00	0.00	0.00
3.00	0.05	0.00	0.05	29.00	0.00	0.00	0.00
3.50	0.05	0.00	0.05	29.50	0.00	0.00	0.00
4.00	0.06	0.00	0.06	30.00	0.00	0.00	0.00
4.50	0.06	0.00	0.06	30.50	0.00	0.00	0.00
5.00	0.07	0.00	0.07	31.00	0.00	0.00	0.00
5.50	0.07	0.00	0.07	31.50	0.00	0.00	0.00
6.00	0.08	0.00	0.08	32.00	0.00	0.00	0.00
6.50	0.09	0.00	0.09	32.50	0.00	0.00	0.00
7.00	0.10	0.00	0.10	33.00	0.00	0.00	0.00
7.50	0.11	0.00	0.11	33.50	0.00	0.00	0.00
8.00	0.13	0.00	0.13	34.00	0.00	0.00	0.00
8.50	0.14	0.00	0.14	34.50	0.00	0.00	0.00
9.00	0.15	0.00	0.15	35.00	0.00	0.00	0.00
9.50	0.19	0.00	0.19	35.50	0.00	0.00	0.00
10.00	0.23	0.00	0.23	36.00	0.00	0.00	0.00
10.50	0.28	0.00	0.28				
11.00	0.44	0.00	0.44				
11.50	0.74	0.00	0.74				
12.00	4.13	0.00	4.13				
12.50	1.37	0.00	1.37				
13.00	0.62	0.00	0.62				
13.50	0.39	0.00	0.39				
14.00	0.31	0.00	0.31				
14.50	0.26	0.00	0.26				
15.00	0.21	0.00	0.21				
15.50	0.18	0.00	0.18				
16.00	0.17	0.00	0.17				
16.50	0.16	0.00	0.16				
17.00	0.14	0.00	0.14				
17.50	0.13	0.00	0.13				
18.00	0.12	0.00	0.12				
18.50	0.11	0.00	0.11				
19.00	0.11	0.00	0.11				
19.50	0.10	0.00	0.10				
20.00	0.10	0.00	0.10				
20.50	0.10	0.00	0.10				
21.00	0.09	0.00	0.09				
21.50	0.09	0.00	0.09				
22.00	0.09	0.00	0.09				
22.50	0.08	0.00	0.08				
23.00	0.08	0.00	0.08				
23.50	0.08	0.00	0.08				
24.00	0.08	0.00	0.08				
24.50	0.00	0.00	0.00				
25.00	0.00	0.00	0.00				
25.50	0.00	0.00	0.00				

Ex 2 yr, 10 yr, 100 yr

Prepared by Dynamic Engineering

HydroCAD® 10.20-3c s/n 08640 © 2023 HydroCAD Software Solutions LLC

NOAA 24-hr C 10-Year Rainfall=5.01"

Printed 6/14/2023

Page 31


Summary for Link 6L: EX SA South

Inflow Area = 1.310 ac, 67.60% Impervious, Inflow Depth = 3.65" for 10-Year event
Inflow = 5.61 cfs @ 12.08 hrs, Volume= 0.398 af
Primary = 5.61 cfs @ 12.08 hrs, Volume= 0.398 af, Atten= 0%, Lag= 0.0 min

Primary outflow = Inflow, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs

Link 6L: EX SA South

Hydrograph

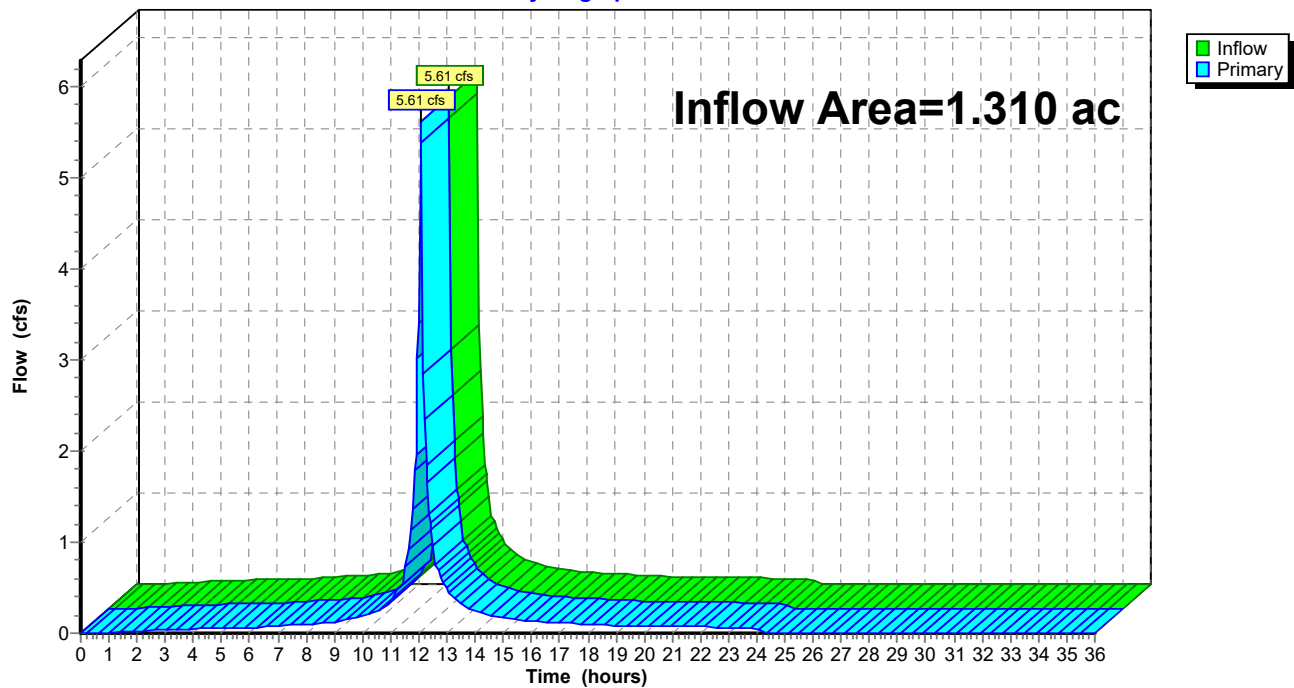

Ex 2 yr, 10 yr, 100 yr

Prepared by Dynamic Engineering

HydroCAD® 10.20-3c s/n 08640 © 2023 HydroCAD Software Solutions LLC

NOAA 24-hr C 10-Year Rainfall=5.01"

Printed 6/14/2023

Page 32

Hydrograph for Link 6L: EX SA South

Time (hours)	Inflow (cfs)	Elevation (feet)	Primary (cfs)	Time (hours)	Inflow (cfs)	Elevation (feet)	Primary (cfs)
0.00	0.00	0.00	0.00	26.00	0.00	0.00	0.00
0.50	0.00	0.00	0.00	26.50	0.00	0.00	0.00
1.00	0.01	0.00	0.01	27.00	0.00	0.00	0.00
1.50	0.02	0.00	0.02	27.50	0.00	0.00	0.00
2.00	0.02	0.00	0.02	28.00	0.00	0.00	0.00
2.50	0.03	0.00	0.03	28.50	0.00	0.00	0.00
3.00	0.04	0.00	0.04	29.00	0.00	0.00	0.00
3.50	0.04	0.00	0.04	29.50	0.00	0.00	0.00
4.00	0.05	0.00	0.05	30.00	0.00	0.00	0.00
4.50	0.05	0.00	0.05	30.50	0.00	0.00	0.00
5.00	0.06	0.00	0.06	31.00	0.00	0.00	0.00
5.50	0.06	0.00	0.06	31.50	0.00	0.00	0.00
6.00	0.06	0.00	0.06	32.00	0.00	0.00	0.00
6.50	0.07	0.00	0.07	32.50	0.00	0.00	0.00
7.00	0.08	0.00	0.08	33.00	0.00	0.00	0.00
7.50	0.09	0.00	0.09	33.50	0.00	0.00	0.00
8.00	0.10	0.00	0.10	34.00	0.00	0.00	0.00
8.50	0.11	0.00	0.11	34.50	0.00	0.00	0.00
9.00	0.12	0.00	0.12	35.00	0.00	0.00	0.00
9.50	0.15	0.00	0.15	35.50	0.00	0.00	0.00
10.00	0.19	0.00	0.19	36.00	0.00	0.00	0.00
10.50	0.22	0.00	0.22				
11.00	0.35	0.00	0.35				
11.50	0.60	0.00	0.60				
12.00	3.40	0.00	3.40				
12.50	1.09	0.00	1.09				
13.00	0.50	0.00	0.50				
13.50	0.31	0.00	0.31				
14.00	0.25	0.00	0.25				
14.50	0.21	0.00	0.21				
15.00	0.17	0.00	0.17				
15.50	0.15	0.00	0.15				
16.00	0.14	0.00	0.14				
16.50	0.13	0.00	0.13				
17.00	0.12	0.00	0.12				
17.50	0.10	0.00	0.10				
18.00	0.09	0.00	0.09				
18.50	0.09	0.00	0.09				
19.00	0.09	0.00	0.09				
19.50	0.08	0.00	0.08				
20.00	0.08	0.00	0.08				
20.50	0.08	0.00	0.08				
21.00	0.08	0.00	0.08				
21.50	0.07	0.00	0.07				
22.00	0.07	0.00	0.07				
22.50	0.07	0.00	0.07				
23.00	0.06	0.00	0.06				
23.50	0.06	0.00	0.06				
24.00	0.07	0.00	0.07				
24.50	0.00	0.00	0.00				
25.00	0.00	0.00	0.00				
25.50	0.00	0.00	0.00				

Ex 2 yr, 10 yr, 100 yr

NOAA 24-hr C 100-Year Rainfall=8.21"

Prepared by Dynamic Engineering

Printed 6/14/2023

HydroCAD® 10.20-3c s/n 08640 © 2023 HydroCAD Software Solutions LLC

Page 33

Time span=0.00-36.00 hrs, dt=0.05 hrs, 721 points
Runoff by SCS TR-20 method, UH=SCS, Weighted-CN
Reach routing by Stor-Ind+Trans method - Pond routing by Stor-Ind method

Subcatchment1S: Ex SA North Imp Runoff Area=48,361 sf 100.00% Impervious Runoff Depth=7.97"
Flow Length=200' Tc=2.1 min CN=98 Runoff=10.86 cfs 0.737 af

Subcatchment2S: Ex SA North Perv Runoff Area=24,838 sf 0.00% Impervious Runoff Depth=3.15"
Flow Length=135' Slope=0.0300 '/' Tc=12.1 min CN=57 Runoff=1.85 cfs 0.150 af

Subcatchment4S: Ex SA South Imp Runoff Area=38,562 sf 100.00% Impervious Runoff Depth=7.97"
Flow Length=140' Slope=0.0090 '/' Tc=1.9 min CN=98 Runoff=8.68 cfs 0.588 af

Subcatchment5S: Ex SA South Perv Runoff Area=18,480 sf 0.00% Impervious Runoff Depth=3.49"
Flow Length=70' Slope=0.0250 '/' Tc=9.6 min CN=60 Runoff=1.66 cfs 0.123 af

Link 3L: Ex SA North Inflow=11.90 cfs 0.887 af
Primary=11.90 cfs 0.887 af

Link 6L: EX SA South Inflow=9.77 cfs 0.711 af
Primary=9.77 cfs 0.711 af

Total Runoff Area = 2.990 ac Runoff Volume = 1.599 af Average Runoff Depth = 6.42"
33.26% Pervious = 0.994 ac 66.74% Impervious = 1.995 ac

Ex 2 yr, 10 yr, 100 yr

Prepared by Dynamic Engineering

HydroCAD® 10.20-3c s/n 08640 © 2023 HydroCAD Software Solutions LLC

NOAA 24-hr C 100-Year Rainfall=8.21"

Printed 6/14/2023

Page 34

Summary for Subcatchment 1S: Ex SA North Imp[49] Hint: $T_c < 2dt$ may require smaller dt

Runoff = 10.86 cfs @ 12.08 hrs, Volume= 0.737 af, Depth= 7.97"
 Routed to Link 3L : Ex SA North


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, $dt=0.05$ hrs
 NOAA 24-hr C 100-Year Rainfall=8.21"

Area (sf)	CN	Description
33,877	98	Paved parking, HSG B
14,484	98	Roofs, HSG B
48,361	98	Weighted Average
48,361		100.00% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
1.5	100	0.0110	1.11		Sheet Flow, Sheet Flow
					Smooth surfaces $n=0.011$ $P2=3.34"$
0.6	100	0.0200	2.87		Shallow Concentrated Flow, Shallow Concentrated Flow
					Paved $K_v=20.3$ fps
2.1	200	Total			

Subcatchment 1S: Ex SA North Imp

Hydrograph

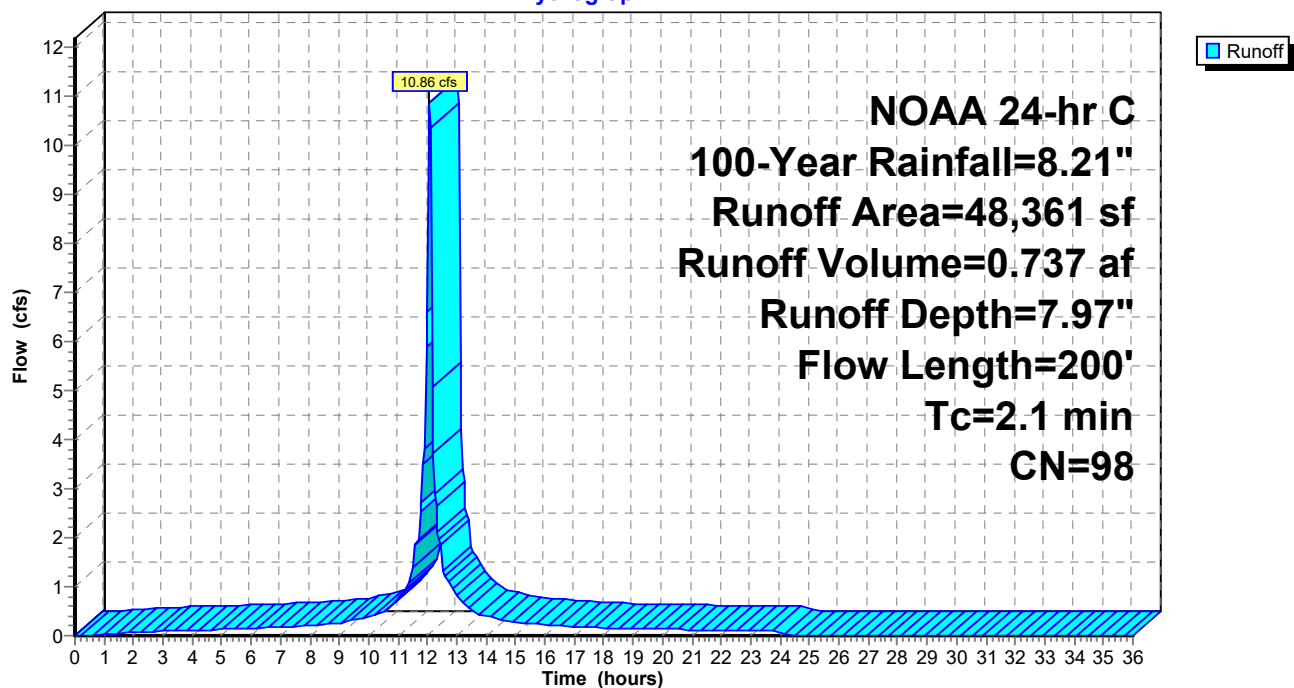

Ex 2 yr, 10 yr, 100 yr

Prepared by Dynamic Engineering

HydroCAD® 10.20-3c s/n 08640 © 2023 HydroCAD Software Solutions LLC

NOAA 24-hr C 100-Year Rainfall=8.21"

Printed 6/14/2023

Page 35

Hydrograph for Subcatchment 1S: Ex SA North Imp

Time (hours)	Precip. (inches)	Excess (inches)	Runoff (cfs)	Time (hours)	Precip. (inches)	Excess (inches)	Runoff (cfs)
0.00	0.00	0.00	0.00	26.00	8.21	7.97	0.00
0.50	0.04	0.00	0.00	26.50	8.21	7.97	0.00
1.00	0.09	0.01	0.03	27.00	8.21	7.97	0.00
1.50	0.14	0.03	0.06	27.50	8.21	7.97	0.00
2.00	0.19	0.06	0.07	28.00	8.21	7.97	0.00
2.50	0.24	0.10	0.09	28.50	8.21	7.97	0.00
3.00	0.29	0.14	0.10	29.00	8.21	7.97	0.00
3.50	0.34	0.18	0.11	29.50	8.21	7.97	0.00
4.00	0.40	0.23	0.11	30.00	8.21	7.97	0.00
4.50	0.46	0.28	0.12	30.50	8.21	7.97	0.00
5.00	0.52	0.34	0.13	31.00	8.21	7.97	0.00
5.50	0.59	0.40	0.13	31.50	8.21	7.97	0.00
6.00	0.65	0.46	0.14	32.00	8.21	7.97	0.00
6.50	0.72	0.52	0.16	32.50	8.21	7.97	0.00
7.00	0.80	0.60	0.18	33.00	8.21	7.97	0.00
7.50	0.89	0.68	0.20	33.50	8.21	7.97	0.00
8.00	0.98	0.78	0.21	34.00	8.21	7.97	0.00
8.50	1.09	0.88	0.23	34.50	8.21	7.97	0.00
9.00	1.20	0.98	0.25	35.00	8.21	7.97	0.00
9.50	1.33	1.12	0.32	35.50	8.21	7.97	0.00
10.00	1.50	1.28	0.39	36.00	8.21	7.97	0.00
10.50	1.69	1.47	0.46				
11.00	1.97	1.74	0.73				
11.50	2.43	2.20	1.22				
12.00	3.91	3.68	6.60				
12.50	5.78	5.55	1.83				
13.00	6.24	6.00	0.82				
13.50	6.52	6.28	0.51				
14.00	6.71	6.47	0.41				
14.50	6.88	6.64	0.34				
15.00	7.01	6.77	0.27				
15.50	7.12	6.88	0.24				
16.00	7.23	6.99	0.22				
16.50	7.32	7.08	0.21				
17.00	7.41	7.17	0.19				
17.50	7.49	7.25	0.17				
18.00	7.56	7.32	0.15				
18.50	7.62	7.39	0.14				
19.00	7.69	7.45	0.14				
19.50	7.75	7.51	0.13				
20.00	7.81	7.57	0.13				
20.50	7.87	7.63	0.13				
21.00	7.92	7.68	0.12				
21.50	7.97	7.73	0.12				
22.00	8.02	7.78	0.11				
22.50	8.07	7.83	0.11				
23.00	8.12	7.88	0.10				
23.50	8.17	7.93	0.10				
24.00	8.21	7.97	0.11				
24.50	8.21	7.97	0.00				
25.00	8.21	7.97	0.00				
25.50	8.21	7.97	0.00				

Ex 2 yr, 10 yr, 100 yr

Prepared by Dynamic Engineering

HydroCAD® 10.20-3c s/n 08640 © 2023 HydroCAD Software Solutions LLC

NOAA 24-hr C 100-Year Rainfall=8.21"

Printed 6/14/2023

Page 36


Summary for Subcatchment 2S: Ex SA North Perv

Runoff = 1.85 cfs @ 12.21 hrs, Volume= 0.150 af, Depth= 3.15"
 Routed to Link 3L : Ex SA North

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs
 NOAA 24-hr C 100-Year Rainfall=8.21"

Area (sf)	CN	Description
15,636	55	Woods, Good, HSG B
9,202	61	>75% Grass cover, Good, HSG B
24,838	57	Weighted Average
24,838		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
11.9	100	0.0300	0.14		Sheet Flow, Sheet Flow
					Grass: Dense n= 0.240 P2= 3.34"
0.2	35	0.0300	2.79		Shallow Concentrated Flow, Shallow Concentrated Flow
					Unpaved Kv= 16.1 fps
12.1	135	Total			

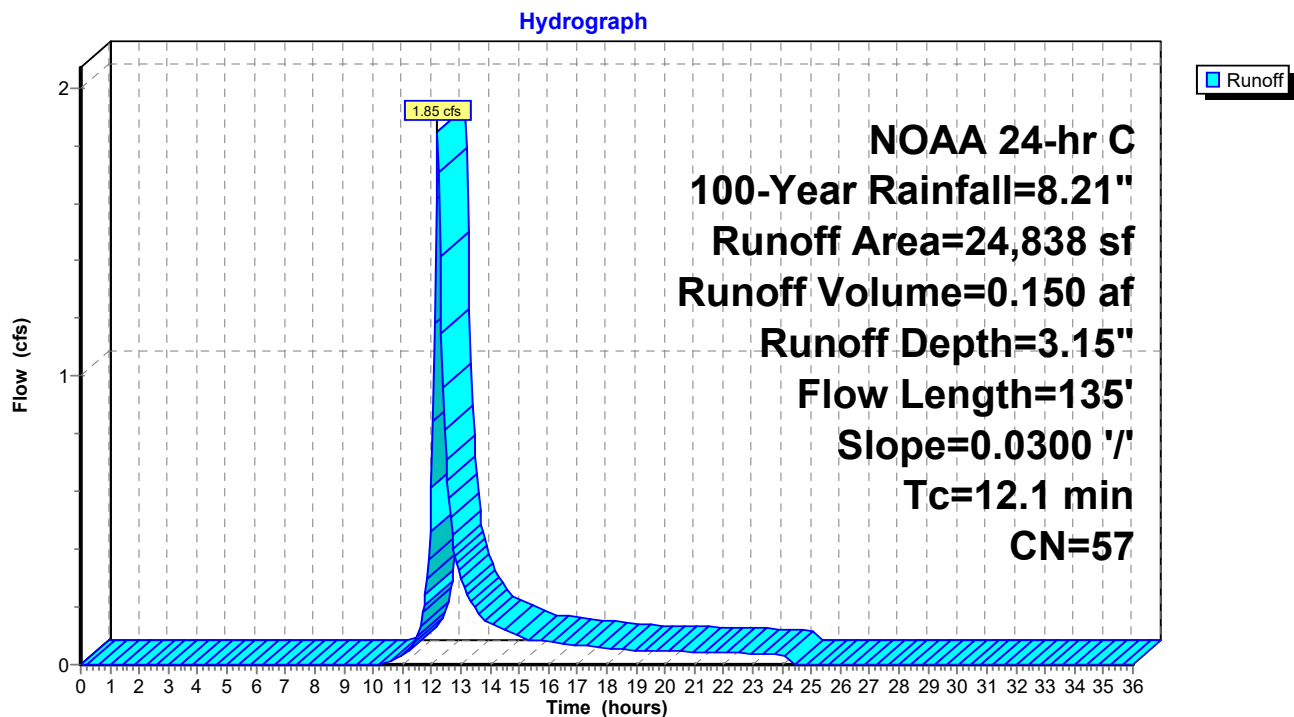Subcatchment 2S: Ex SA North Perv

Ex 2 yr, 10 yr, 100 yr

Prepared by Dynamic Engineering

HydroCAD® 10.20-3c s/n 08640 © 2023 HydroCAD Software Solutions LLC

NOAA 24-hr C 100-Year Rainfall=8.21"

Printed 6/14/2023

Page 37

Hydrograph for Subcatchment 2S: Ex SA North Perv

Time (hours)	Precip. (inches)	Excess (inches)	Runoff (cfs)	Time (hours)	Precip. (inches)	Excess (inches)	Runoff (cfs)
0.00	0.00	0.00	0.00	26.00	8.21	3.15	0.00
0.50	0.04	0.00	0.00	26.50	8.21	3.15	0.00
1.00	0.09	0.00	0.00	27.00	8.21	3.15	0.00
1.50	0.14	0.00	0.00	27.50	8.21	3.15	0.00
2.00	0.19	0.00	0.00	28.00	8.21	3.15	0.00
2.50	0.24	0.00	0.00	28.50	8.21	3.15	0.00
3.00	0.29	0.00	0.00	29.00	8.21	3.15	0.00
3.50	0.34	0.00	0.00	29.50	8.21	3.15	0.00
4.00	0.40	0.00	0.00	30.00	8.21	3.15	0.00
4.50	0.46	0.00	0.00	30.50	8.21	3.15	0.00
5.00	0.52	0.00	0.00	31.00	8.21	3.15	0.00
5.50	0.59	0.00	0.00	31.50	8.21	3.15	0.00
6.00	0.65	0.00	0.00	32.00	8.21	3.15	0.00
6.50	0.72	0.00	0.00	32.50	8.21	3.15	0.00
7.00	0.80	0.00	0.00	33.00	8.21	3.15	0.00
7.50	0.89	0.00	0.00	33.50	8.21	3.15	0.00
8.00	0.98	0.00	0.00	34.00	8.21	3.15	0.00
8.50	1.09	0.00	0.00	34.50	8.21	3.15	0.00
9.00	1.20	0.00	0.00	35.00	8.21	3.15	0.00
9.50	1.33	0.00	0.00	35.50	8.21	3.15	0.00
10.00	1.50	0.00	0.00	36.00	8.21	3.15	0.00
10.50	1.69	0.00	0.01				
11.00	1.97	0.03	0.03				
11.50	2.43	0.10	0.09				
12.00	3.91	0.58	0.61				
12.50	5.78	1.55	0.71				
13.00	6.24	1.82	0.30				
13.50	6.52	2.00	0.19				
14.00	6.71	2.12	0.14				
14.50	6.88	2.23	0.12				
15.00	7.01	2.32	0.10				
15.50	7.12	2.40	0.09				
16.00	7.23	2.47	0.08				
16.50	7.32	2.53	0.07				
17.00	7.41	2.59	0.07				
17.50	7.49	2.64	0.06				
18.00	7.56	2.69	0.06				
18.50	7.62	2.74	0.05				
19.00	7.69	2.78	0.05				
19.50	7.75	2.83	0.05				
20.00	7.81	2.87	0.05				
20.50	7.87	2.91	0.05				
21.00	7.92	2.95	0.04				
21.50	7.97	2.98	0.04				
22.00	8.02	3.02	0.04				
22.50	8.07	3.05	0.04				
23.00	8.12	3.09	0.04				
23.50	8.17	3.12	0.04				
24.00	8.21	3.15	0.04				
24.50	8.21	3.15	0.00				
25.00	8.21	3.15	0.00				
25.50	8.21	3.15	0.00				

Ex 2 yr, 10 yr, 100 yr

Prepared by Dynamic Engineering

HydroCAD® 10.20-3c s/n 08640 © 2023 HydroCAD Software Solutions LLC

NOAA 24-hr C 100-Year Rainfall=8.21"

Printed 6/14/2023

Page 38

Summary for Subcatchment 4S: Ex SA South Imp[49] Hint: $T_c < 2dt$ may require smaller dt

Runoff = 8.68 cfs @ 12.08 hrs, Volume= 0.588 af, Depth= 7.97"
 Routed to Link 6L : EX SA South


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, $dt=0.05$ hrs
 NOAA 24-hr C 100-Year Rainfall=8.21"

Area (sf)	CN	Description
32,900	98	Paved parking, HSG B
5,662	98	Roofs, HSG B
38,562	98	Weighted Average
38,562		100.00% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
1.6	100	0.0090	1.02		Sheet Flow, Sheet Flow
					Smooth surfaces $n=0.011$ $P2=3.34"$
0.3	40	0.0090	1.93		Shallow Concentrated Flow, Shallow Concentrated Flow
					Paved $K_v=20.3$ fps
1.9	140	Total			

Subcatchment 4S: Ex SA South Imp

Hydrograph

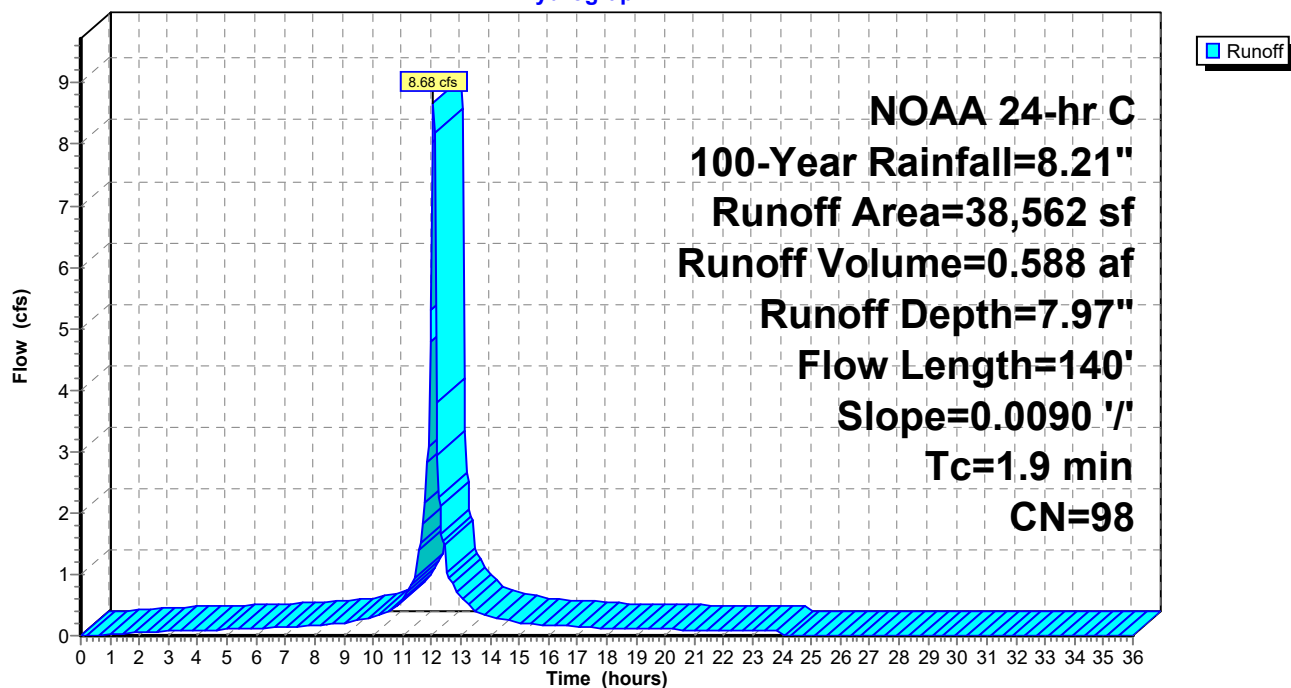

Ex 2 yr, 10 yr, 100 yr

Prepared by Dynamic Engineering

HydroCAD® 10.20-3c s/n 08640 © 2023 HydroCAD Software Solutions LLC

NOAA 24-hr C 100-Year Rainfall=8.21"

Printed 6/14/2023

Page 39

Hydrograph for Subcatchment 4S: Ex SA South Imp

Time (hours)	Precip. (inches)	Excess (inches)	Runoff (cfs)	Time (hours)	Precip. (inches)	Excess (inches)	Runoff (cfs)
0.00	0.00	0.00	0.00	26.00	8.21	7.97	0.00
0.50	0.04	0.00	0.00	26.50	8.21	7.97	0.00
1.00	0.09	0.01	0.03	27.00	8.21	7.97	0.00
1.50	0.14	0.03	0.05	27.50	8.21	7.97	0.00
2.00	0.19	0.06	0.06	28.00	8.21	7.97	0.00
2.50	0.24	0.10	0.07	28.50	8.21	7.97	0.00
3.00	0.29	0.14	0.08	29.00	8.21	7.97	0.00
3.50	0.34	0.18	0.08	29.50	8.21	7.97	0.00
4.00	0.40	0.23	0.09	30.00	8.21	7.97	0.00
4.50	0.46	0.28	0.10	30.50	8.21	7.97	0.00
5.00	0.52	0.34	0.10	31.00	8.21	7.97	0.00
5.50	0.59	0.40	0.11	31.50	8.21	7.97	0.00
6.00	0.65	0.46	0.11	32.00	8.21	7.97	0.00
6.50	0.72	0.52	0.13	32.50	8.21	7.97	0.00
7.00	0.80	0.60	0.14	33.00	8.21	7.97	0.00
7.50	0.89	0.68	0.16	33.50	8.21	7.97	0.00
8.00	0.98	0.78	0.17	34.00	8.21	7.97	0.00
8.50	1.09	0.88	0.19	34.50	8.21	7.97	0.00
9.00	1.20	0.98	0.20	35.00	8.21	7.97	0.00
9.50	1.33	1.12	0.26	35.50	8.21	7.97	0.00
10.00	1.50	1.28	0.31	36.00	8.21	7.97	0.00
10.50	1.69	1.47	0.37				
11.00	1.97	1.74	0.58				
11.50	2.43	2.20	0.98				
12.00	3.91	3.68	5.31				
12.50	5.78	5.55	1.45				
13.00	6.24	6.00	0.65				
13.50	6.52	6.28	0.41				
14.00	6.71	6.47	0.33				
14.50	6.88	6.64	0.27				
15.00	7.01	6.77	0.22				
15.50	7.12	6.88	0.19				
16.00	7.23	6.99	0.18				
16.50	7.32	7.08	0.16				
17.00	7.41	7.17	0.15				
17.50	7.49	7.25	0.14				
18.00	7.56	7.32	0.12				
18.50	7.62	7.39	0.11				
19.00	7.69	7.45	0.11				
19.50	7.75	7.51	0.11				
20.00	7.81	7.57	0.10				
20.50	7.87	7.63	0.10				
21.00	7.92	7.68	0.10				
21.50	7.97	7.73	0.09				
22.00	8.02	7.78	0.09				
22.50	8.07	7.83	0.09				
23.00	8.12	7.88	0.08				
23.50	8.17	7.93	0.08				
24.00	8.21	7.97	0.09				
24.50	8.21	7.97	0.00				
25.00	8.21	7.97	0.00				
25.50	8.21	7.97	0.00				

Ex 2 yr, 10 yr, 100 yr

Prepared by Dynamic Engineering

HydroCAD® 10.20-3c s/n 08640 © 2023 HydroCAD Software Solutions LLC

NOAA 24-hr C 100-Year Rainfall=8.21"

Printed 6/14/2023

Page 40


Summary for Subcatchment 5S: Ex SA South Perv

Runoff = 1.66 cfs @ 12.17 hrs, Volume= 0.123 af, Depth= 3.49"
Routed to Link 6L : EX SA South

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs
NOAA 24-hr C 100-Year Rainfall=8.21"

Area (sf)	CN	Description
2,059	55	Woods, Good, HSG B
16,421	61	>75% Grass cover, Good, HSG B
18,480	60	Weighted Average
18,480		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
9.6	70	0.0250	0.12		Sheet Flow, Sheet Flow Grass: Dense n= 0.240 P2= 3.34"

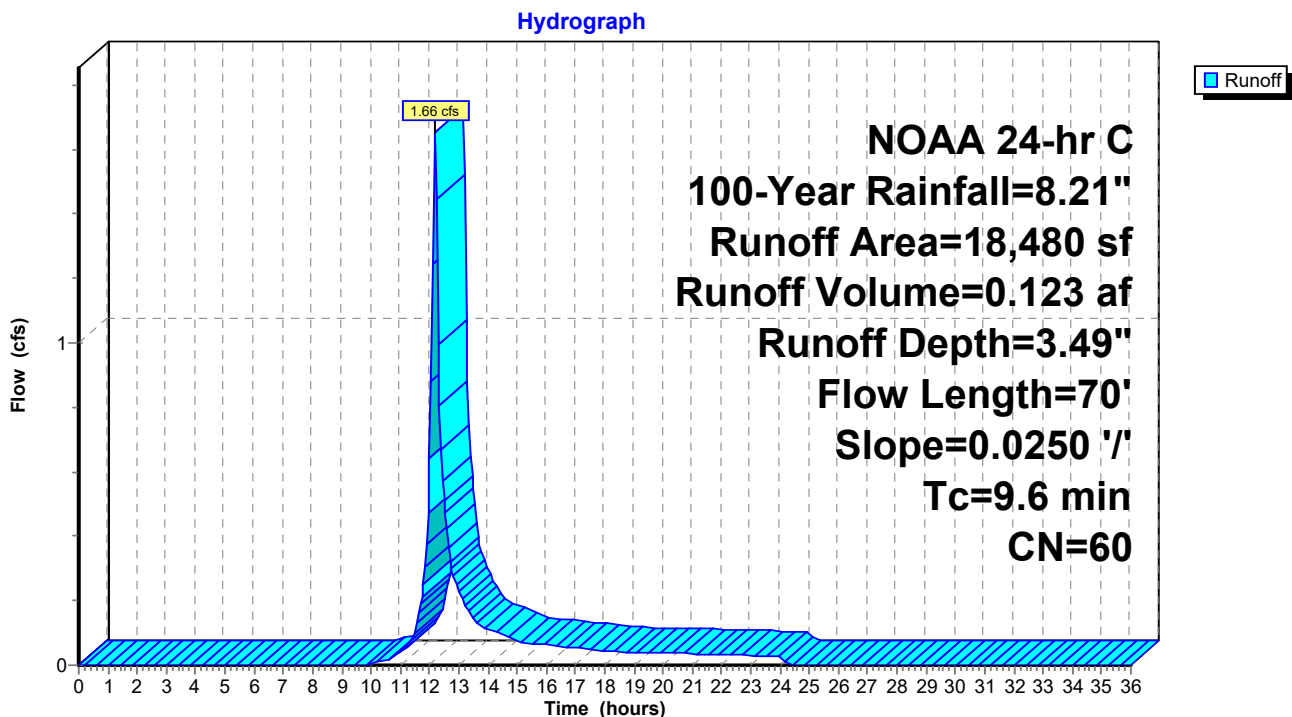Subcatchment 5S: Ex SA South Perv

Ex 2 yr, 10 yr, 100 yr

Prepared by Dynamic Engineering

HydroCAD® 10.20-3c s/n 08640 © 2023 HydroCAD Software Solutions LLC

NOAA 24-hr C 100-Year Rainfall=8.21"

Printed 6/14/2023

Page 41

Hydrograph for Subcatchment 5S: Ex SA South Perv

Time (hours)	Precip. (inches)	Excess (inches)	Runoff (cfs)	Time (hours)	Precip. (inches)	Excess (inches)	Runoff (cfs)
0.00	0.00	0.00	0.00	26.00	8.21	3.49	0.00
0.50	0.04	0.00	0.00	26.50	8.21	3.49	0.00
1.00	0.09	0.00	0.00	27.00	8.21	3.49	0.00
1.50	0.14	0.00	0.00	27.50	8.21	3.49	0.00
2.00	0.19	0.00	0.00	28.00	8.21	3.49	0.00
2.50	0.24	0.00	0.00	28.50	8.21	3.49	0.00
3.00	0.29	0.00	0.00	29.00	8.21	3.49	0.00
3.50	0.34	0.00	0.00	29.50	8.21	3.49	0.00
4.00	0.40	0.00	0.00	30.00	8.21	3.49	0.00
4.50	0.46	0.00	0.00	30.50	8.21	3.49	0.00
5.00	0.52	0.00	0.00	31.00	8.21	3.49	0.00
5.50	0.59	0.00	0.00	31.50	8.21	3.49	0.00
6.00	0.65	0.00	0.00	32.00	8.21	3.49	0.00
6.50	0.72	0.00	0.00	32.50	8.21	3.49	0.00
7.00	0.80	0.00	0.00	33.00	8.21	3.49	0.00
7.50	0.89	0.00	0.00	33.50	8.21	3.49	0.00
8.00	0.98	0.00	0.00	34.00	8.21	3.49	0.00
8.50	1.09	0.00	0.00	34.50	8.21	3.49	0.00
9.00	1.20	0.00	0.00	35.00	8.21	3.49	0.00
9.50	1.33	0.00	0.00	35.50	8.21	3.49	0.00
10.00	1.50	0.00	0.00	36.00	8.21	3.49	0.00
10.50	1.69	0.02	0.01				
11.00	1.97	0.06	0.04				
11.50	2.43	0.15	0.10				
12.00	3.91	0.72	0.64				
12.50	5.78	1.78	0.51				
13.00	6.24	2.08	0.23				
13.50	6.52	2.27	0.15				
14.00	6.71	2.40	0.11				
14.50	6.88	2.52	0.09				
15.00	7.01	2.61	0.08				
15.50	7.12	2.69	0.07				
16.00	7.23	2.77	0.06				
16.50	7.32	2.83	0.06				
17.00	7.41	2.90	0.05				
17.50	7.49	2.95	0.05				
18.00	7.56	3.01	0.04				
18.50	7.62	3.05	0.04				
19.00	7.69	3.10	0.04				
19.50	7.75	3.15	0.04				
20.00	7.81	3.19	0.04				
20.50	7.87	3.23	0.04				
21.00	7.92	3.27	0.03				
21.50	7.97	3.31	0.03				
22.00	8.02	3.35	0.03				
22.50	8.07	3.39	0.03				
23.00	8.12	3.42	0.03				
23.50	8.17	3.46	0.03				
24.00	8.21	3.49	0.03				
24.50	8.21	3.49	0.00				
25.00	8.21	3.49	0.00				
25.50	8.21	3.49	0.00				

Ex 2 yr, 10 yr, 100 yr

Prepared by Dynamic Engineering

HydroCAD® 10.20-3c s/n 08640 © 2023 HydroCAD Software Solutions LLC

NOAA 24-hr C 100-Year Rainfall=8.21"

Printed 6/14/2023

Page 42

Summary for Link 3L: Ex SA North

Inflow Area = 1.680 ac, 66.07% Impervious, Inflow Depth = 6.34" for 100-Year event


Inflow = 11.90 cfs @ 12.08 hrs, Volume= 0.887 af

Primary = 11.90 cfs @ 12.08 hrs, Volume= 0.887 af, Atten= 0%, Lag= 0.0 min

Primary outflow = Inflow, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs

Link 3L: Ex SA North

Hydrograph

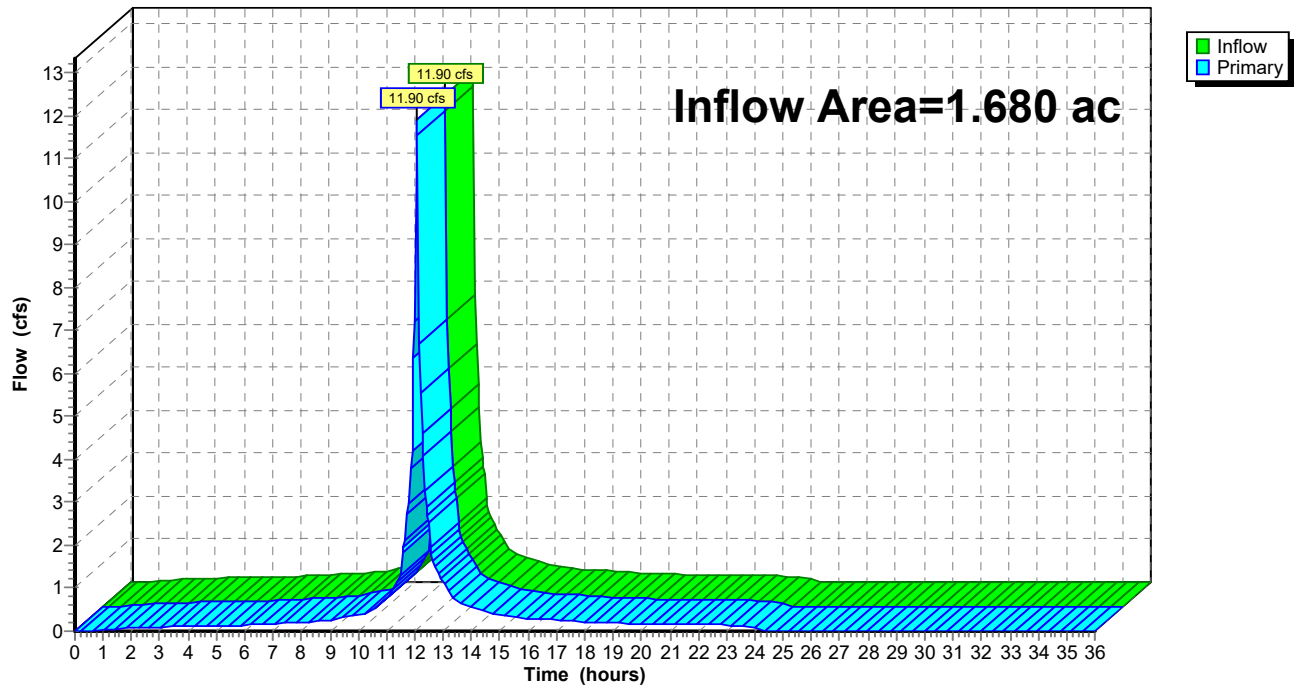

Ex 2 yr, 10 yr, 100 yr

Prepared by Dynamic Engineering

HydroCAD® 10.20-3c s/n 08640 © 2023 HydroCAD Software Solutions LLC

NOAA 24-hr C 100-Year Rainfall=8.21"

Printed 6/14/2023

Page 43

Hydrograph for Link 3L: Ex SA North

Time (hours)	Inflow (cfs)	Elevation (feet)	Primary (cfs)	Time (hours)	Inflow (cfs)	Elevation (feet)	Primary (cfs)
0.00	0.00	0.00	0.00	26.00	0.00	0.00	0.00
0.50	0.00	0.00	0.00	26.50	0.00	0.00	0.00
1.00	0.03	0.00	0.03	27.00	0.00	0.00	0.00
1.50	0.06	0.00	0.06	27.50	0.00	0.00	0.00
2.00	0.07	0.00	0.07	28.00	0.00	0.00	0.00
2.50	0.09	0.00	0.09	28.50	0.00	0.00	0.00
3.00	0.10	0.00	0.10	29.00	0.00	0.00	0.00
3.50	0.11	0.00	0.11	29.50	0.00	0.00	0.00
4.00	0.11	0.00	0.11	30.00	0.00	0.00	0.00
4.50	0.12	0.00	0.12	30.50	0.00	0.00	0.00
5.00	0.13	0.00	0.13	31.00	0.00	0.00	0.00
5.50	0.13	0.00	0.13	31.50	0.00	0.00	0.00
6.00	0.14	0.00	0.14	32.00	0.00	0.00	0.00
6.50	0.16	0.00	0.16	32.50	0.00	0.00	0.00
7.00	0.18	0.00	0.18	33.00	0.00	0.00	0.00
7.50	0.20	0.00	0.20	33.50	0.00	0.00	0.00
8.00	0.21	0.00	0.21	34.00	0.00	0.00	0.00
8.50	0.23	0.00	0.23	34.50	0.00	0.00	0.00
9.00	0.25	0.00	0.25	35.00	0.00	0.00	0.00
9.50	0.32	0.00	0.32	35.50	0.00	0.00	0.00
10.00	0.39	0.00	0.39	36.00	0.00	0.00	0.00
10.50	0.47	0.00	0.47				
11.00	0.76	0.00	0.76				
11.50	1.32	0.00	1.32				
12.00	7.21	0.00	7.21				
12.50	2.54	0.00	2.54				
13.00	1.13	0.00	1.13				
13.50	0.71	0.00	0.71				
14.00	0.55	0.00	0.55				
14.50	0.46	0.00	0.46				
15.00	0.37	0.00	0.37				
15.50	0.33	0.00	0.33				
16.00	0.30	0.00	0.30				
16.50	0.28	0.00	0.28				
17.00	0.26	0.00	0.26				
17.50	0.23	0.00	0.23				
18.00	0.21	0.00	0.21				
18.50	0.20	0.00	0.20				
19.00	0.19	0.00	0.19				
19.50	0.18	0.00	0.18				
20.00	0.18	0.00	0.18				
20.50	0.17	0.00	0.17				
21.00	0.17	0.00	0.17				
21.50	0.16	0.00	0.16				
22.00	0.15	0.00	0.15				
22.50	0.15	0.00	0.15				
23.00	0.14	0.00	0.14				
23.50	0.14	0.00	0.14				
24.00	0.15	0.00	0.15				
24.50	0.00	0.00	0.00				
25.00	0.00	0.00	0.00				
25.50	0.00	0.00	0.00				

Ex 2 yr, 10 yr, 100 yr

Prepared by Dynamic Engineering

HydroCAD® 10.20-3c s/n 08640 © 2023 HydroCAD Software Solutions LLC

NOAA 24-hr C 100-Year Rainfall=8.21"

Printed 6/14/2023

Page 44

Summary for Link 6L: EX SA South

Inflow Area = 1.310 ac, 67.60% Impervious, Inflow Depth = 6.52" for 100-Year event


Inflow = 9.77 cfs @ 12.08 hrs, Volume= 0.711 af

Primary = 9.77 cfs @ 12.08 hrs, Volume= 0.711 af, Atten= 0%, Lag= 0.0 min

Primary outflow = Inflow, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs

Link 6L: EX SA South

Hydrograph

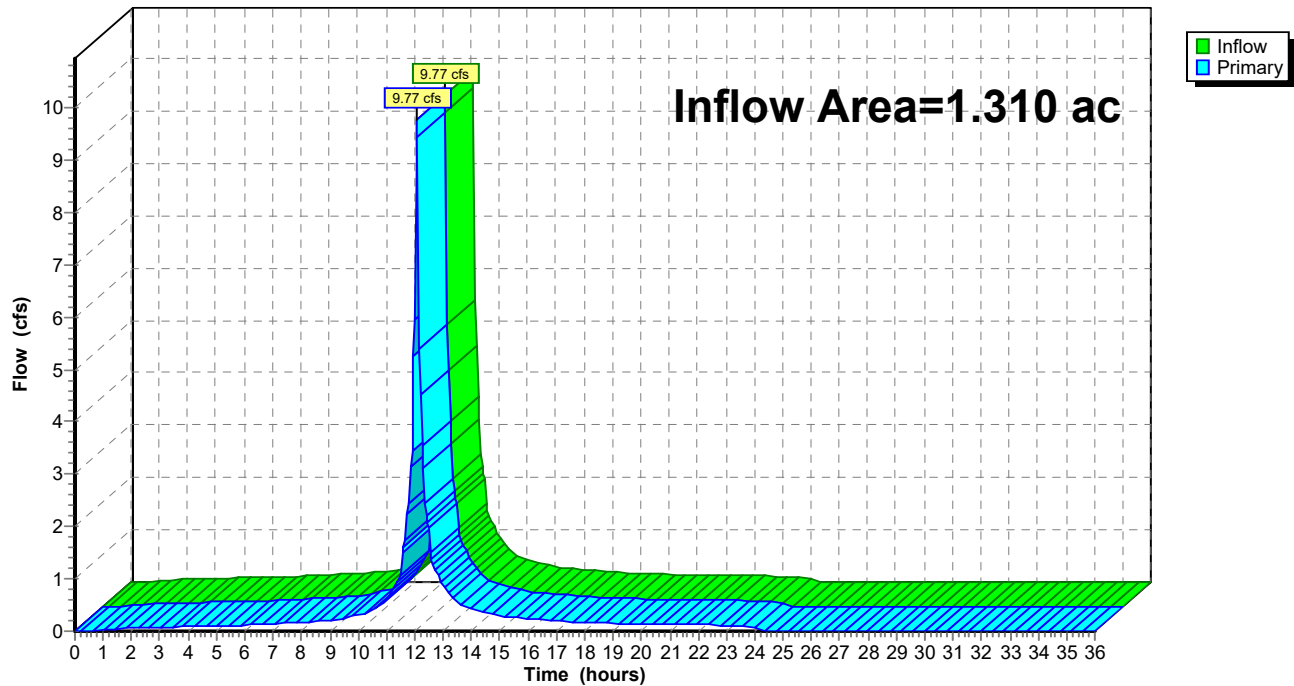

Ex 2 yr, 10 yr, 100 yr

Prepared by Dynamic Engineering

HydroCAD® 10.20-3c s/n 08640 © 2023 HydroCAD Software Solutions LLC

NOAA 24-hr C 100-Year Rainfall=8.21"

Printed 6/14/2023

Page 45

Hydrograph for Link 6L: EX SA South

Time (hours)	Inflow (cfs)	Elevation (feet)	Primary (cfs)	Time (hours)	Inflow (cfs)	Elevation (feet)	Primary (cfs)
0.00	0.00	0.00	0.00	26.00	0.00	0.00	0.00
0.50	0.00	0.00	0.00	26.50	0.00	0.00	0.00
1.00	0.03	0.00	0.03	27.00	0.00	0.00	0.00
1.50	0.05	0.00	0.05	27.50	0.00	0.00	0.00
2.00	0.06	0.00	0.06	28.00	0.00	0.00	0.00
2.50	0.07	0.00	0.07	28.50	0.00	0.00	0.00
3.00	0.08	0.00	0.08	29.00	0.00	0.00	0.00
3.50	0.08	0.00	0.08	29.50	0.00	0.00	0.00
4.00	0.09	0.00	0.09	30.00	0.00	0.00	0.00
4.50	0.10	0.00	0.10	30.50	0.00	0.00	0.00
5.00	0.10	0.00	0.10	31.00	0.00	0.00	0.00
5.50	0.11	0.00	0.11	31.50	0.00	0.00	0.00
6.00	0.11	0.00	0.11	32.00	0.00	0.00	0.00
6.50	0.13	0.00	0.13	32.50	0.00	0.00	0.00
7.00	0.14	0.00	0.14	33.00	0.00	0.00	0.00
7.50	0.16	0.00	0.16	33.50	0.00	0.00	0.00
8.00	0.17	0.00	0.17	34.00	0.00	0.00	0.00
8.50	0.19	0.00	0.19	34.50	0.00	0.00	0.00
9.00	0.20	0.00	0.20	35.00	0.00	0.00	0.00
9.50	0.26	0.00	0.26	35.50	0.00	0.00	0.00
10.00	0.32	0.00	0.32	36.00	0.00	0.00	0.00
10.50	0.38	0.00	0.38				
11.00	0.62	0.00	0.62				
11.50	1.08	0.00	1.08				
12.00	5.95	0.00	5.95				
12.50	1.96	0.00	1.96				
13.00	0.89	0.00	0.89				
13.50	0.56	0.00	0.56				
14.00	0.44	0.00	0.44				
14.50	0.37	0.00	0.37				
15.00	0.29	0.00	0.29				
15.50	0.26	0.00	0.26				
16.00	0.24	0.00	0.24				
16.50	0.22	0.00	0.22				
17.00	0.20	0.00	0.20				
17.50	0.18	0.00	0.18				
18.00	0.16	0.00	0.16				
18.50	0.16	0.00	0.16				
19.00	0.15	0.00	0.15				
19.50	0.15	0.00	0.15				
20.00	0.14	0.00	0.14				
20.50	0.14	0.00	0.14				
21.00	0.13	0.00	0.13				
21.50	0.13	0.00	0.13				
22.00	0.12	0.00	0.12				
22.50	0.12	0.00	0.12				
23.00	0.11	0.00	0.11				
23.50	0.11	0.00	0.11				
24.00	0.12	0.00	0.12				
24.50	0.00	0.00	0.00				
25.00	0.00	0.00	0.00				
25.50	0.00	0.00	0.00				

**HydroCAD SUMMARY REPORTS – PROPOSED
CONDITIONS 2 YR 10 YR & 100 YR**

TABLE OF CONTENTS

Project Reports

- 1 Routing Diagram
- 2 Project Notes
- 3 Rainfall Events Listing
- 4 Area Listing (all nodes)
- 5 Soil Listing (all nodes)
- 6 Ground Covers (all nodes)
- 7 Pipe Listing (all nodes)

WQ Event

- 8 Node Listing
- 9 Subcat 1S: Prop SA North Imp
- 11 Subcat 2S: Prop SA North Perv
- 13 Subcat 4S: Prop SA South Imp
- 15 Subcat 5S: Prop SA South Perv
- 17 Link 3L: Prop SA North
- 19 Link 6L: Prop SA South

2-Year Event



- 21 Node Listing
- 22 Subcat 1S: Prop SA North Imp
- 24 Subcat 2S: Prop SA North Perv
- 26 Subcat 4S: Prop SA South Imp
- 28 Subcat 5S: Prop SA South Perv
- 30 Link 3L: Prop SA North
- 32 Link 6L: Prop SA South

10-Year Event

- 34 Node Listing
- 35 Subcat 1S: Prop SA North Imp
- 37 Subcat 2S: Prop SA North Perv
- 39 Subcat 4S: Prop SA South Imp
- 41 Subcat 5S: Prop SA South Perv
- 43 Link 3L: Prop SA North
- 45 Link 6L: Prop SA South

100-Year Event


- 47 Node Listing
- 48 Subcat 1S: Prop SA North Imp
- 50 Subcat 2S: Prop SA North Perv
- 52 Subcat 4S: Prop SA South Imp
- 54 Subcat 5S: Prop SA South Perv
- 56 Link 3L: Prop SA North
- 58 Link 6L: Prop SA South

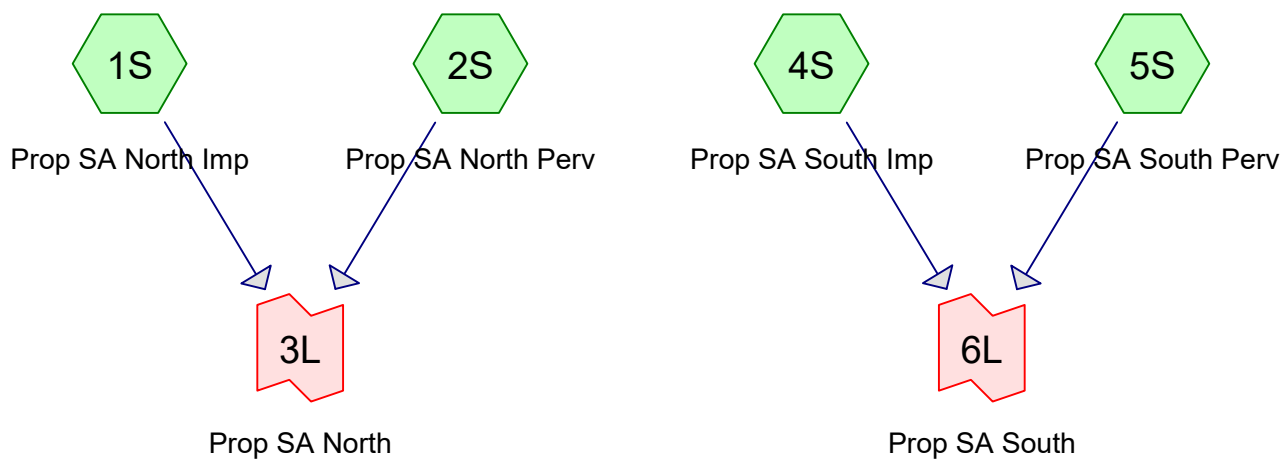

Subcat



Reach



Pond



Link

Routing Diagram for Prop 2 yr, 10 yr, 100 yr - Copy
Prepared by Dynamic Engineering, Printed 3/5/2024
HydroCAD® 10.20-4b s/n 08640 © 2023 HydroCAD Software Solutions LLC

Project Notes

Rainfall events imported from "NRCS-Rain.txt" for 6617 NJ Somerset-C

Prop 2 yr, 10 yr, 100 yr - Copy

Prepared by Dynamic Engineering

HydroCAD® 10.20-4b s/n 08640 © 2023 HydroCAD Software Solutions LLC

Printed 3/5/2024

Page 3

Rainfall Events Listing

Event#	Event Name	Storm Type	Curve	Mode	Duration (hours)	B/B	Depth (inches)	AMC
1	WQ	NJ DEP 2-hr		Default	2.00	1	1.25	2
2	2-Year	NOAA 24-hr	C	Default	24.00	1	3.34	2
3	10-Year	NOAA 24-hr	C	Default	24.00	1	5.01	2
4	100-Year	NOAA 24-hr	C	Default	24.00	1	8.21	2

Prop 2 yr, 10 yr, 100 yr - Copy

Prepared by Dynamic Engineering

HydroCAD® 10.20-4b s/n 08640 © 2023 HydroCAD Software Solutions LLC

Printed 3/5/2024

Page 4

Area Listing (all nodes)

Area (acres)	CN	Description (subcatchment-numbers)
1.028	61	>75% Grass cover, Good, HSG B (2S, 5S)
0.521	98	Paved parking, HSG B (1S, 4S)
1.237	98	Roofs, HSG B (1S, 4S)
0.199	55	Woods, Good, HSG B (2S, 5S)
2.984	82	TOTAL AREA

Prop 2 yr, 10 yr, 100 yr - Copy

Prepared by Dynamic Engineering

HydroCAD® 10.20-4b s/n 08640 © 2023 HydroCAD Software Solutions LLC

Printed 3/5/2024

Page 5

Soil Listing (all nodes)

Area (acres)	Soil Group	Subcatchment Numbers
0.000	HSG A	
2.984	HSG B	1S, 2S, 4S, 5S
0.000	HSG C	
0.000	HSG D	
0.000	Other	
2.984		TOTAL AREA

Prop 2 yr, 10 yr, 100 yr - Copy

Prepared by Dynamic Engineering

HydroCAD® 10.20-4b s/n 08640 © 2023 HydroCAD Software Solutions LLC

Printed 3/5/2024

Page 6

Ground Covers (all nodes)

HSG-A (acres)	HSG-B (acres)	HSG-C (acres)	HSG-D (acres)	Other (acres)	Total (acres)	Ground Cover	Subcatchment Numbers
0.000	1.028	0.000	0.000	0.000	1.028	>75% Grass cover, Good	2S, 5S
0.000	0.521	0.000	0.000	0.000	0.521	Paved parking	1S, 4S
0.000	1.237	0.000	0.000	0.000	1.237	Roofs	1S, 4S
0.000	0.199	0.000	0.000	0.000	0.199	Woods, Good	2S, 5S
0.000	2.984	0.000	0.000	0.000	2.984	TOTAL AREA	

Prop 2 yr, 10 yr, 100 yr - Copy

Prepared by Dynamic Engineering

HydroCAD® 10.20-4b s/n 08640 © 2023 HydroCAD Software Solutions LLC

Printed 3/5/2024

Page 7

Pipe Listing (all nodes)

Line#	Node Number	In-Invert (feet)	Out-Invert (feet)	Length (feet)	Slope (ft/ft)	n	Width (inches)	Diam/Height (inches)	Inside-Fill (inches)	Node Name
1	1S	0.00	0.00	244.0	0.0200	0.010	0.0	15.0	0.0	
2	4S	0.00	0.00	135.0	0.0050	0.010	0.0	12.0	0.0	

Prop 2 yr, 10 yr, 100 yr - Copy

Prepared by Dynamic Engineering

HydroCAD® 10.20-4b s/n 08640 © 2023 HydroCAD Software Solutions LLC

NJ DEP 2-hr WQ Rainfall=1.25"

Printed 3/5/2024

Page 8

Time span=0.00-36.00 hrs, dt=0.05 hrs, 721 points
Runoff by SCS TR-20 method, UH=SCS, Weighted-CN
Reach routing by Stor-Ind+Trans method - Pond routing by Stor-Ind method

Subcatchment1S: Prop SA North Imp Runoff Area=44,706 sf 100.00% Impervious Runoff Depth=1.03"
Flow Length=314' Tc=1.6 min CN=98 Runoff=3.18 cfs 0.088 af

Subcatchment2S: Prop SA North Perv Runoff Area=28,953 sf 0.00% Impervious Runoff Depth=0.00"
Flow Length=130' Slope=0.0300 '/' Tc=12.1 min CN=59 Runoff=0.00 cfs 0.000 af

Subcatchment4S: Prop SA South Imp Runoff Area=31,841 sf 100.00% Impervious Runoff Depth=1.03"
Flow Length=225' Tc=1.9 min CN=98 Runoff=2.24 cfs 0.063 af

Subcatchment5S: Prop SA South Perv Runoff Area=24,504 sf 0.00% Impervious Runoff Depth=0.00"
Flow Length=70' Slope=0.0180 '/' Tc=11.0 min CN=61 Runoff=0.00 cfs 0.000 af

Link 3L: Prop SA North Inflow=3.18 cfs 0.088 af
Primary=3.18 cfs 0.088 af

Link 6L: Prop SA South Inflow=2.24 cfs 0.063 af
Primary=2.24 cfs 0.063 af

Total Runoff Area = 2.984 ac Runoff Volume = 0.152 af Average Runoff Depth = 0.61"
41.12% Pervious = 1.227 ac 58.88% Impervious = 1.757 ac

Prop 2 yr, 10 yr, 100 yr - Copy

Prepared by Dynamic Engineering

HydroCAD® 10.20-4b s/n 08640 © 2023 HydroCAD Software Solutions LLC

NJ DEP 2-hr WQ Rainfall=1.25"

Printed 3/5/2024

Page 9

Summary for Subcatchment 1S: Prop SA North Imp[49] Hint: $T_c < 2dt$ may require smaller dt

Runoff = 3.18 cfs @ 1.03 hrs, Volume= 0.088 af, Depth= 1.03"
Routed to Link 3L : Prop SA North


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, $dt=0.05$ hrs
NJ DEP 2-hr WQ Rainfall=1.25"

Area (sf)	CN	Description
12,060	98	Paved parking, HSG B
32,646	98	Roofs, HSG B
44,706	98	Weighted Average
44,706		100.00% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
1.2	70	0.0100	0.99		Sheet Flow, Sheet Flow Smooth surfaces $n=0.011$ $P2=3.34"$
0.4	244	0.0200	9.68	11.88	Pipe Channel, Channel Flow 15.0" Round Area= 1.2 sf Perim= 3.9' $r=0.31'$ $n=0.010$ PVC, smooth interior
1.6	314	Total			

Subcatchment 1S: Prop SA North Imp

Hydrograph

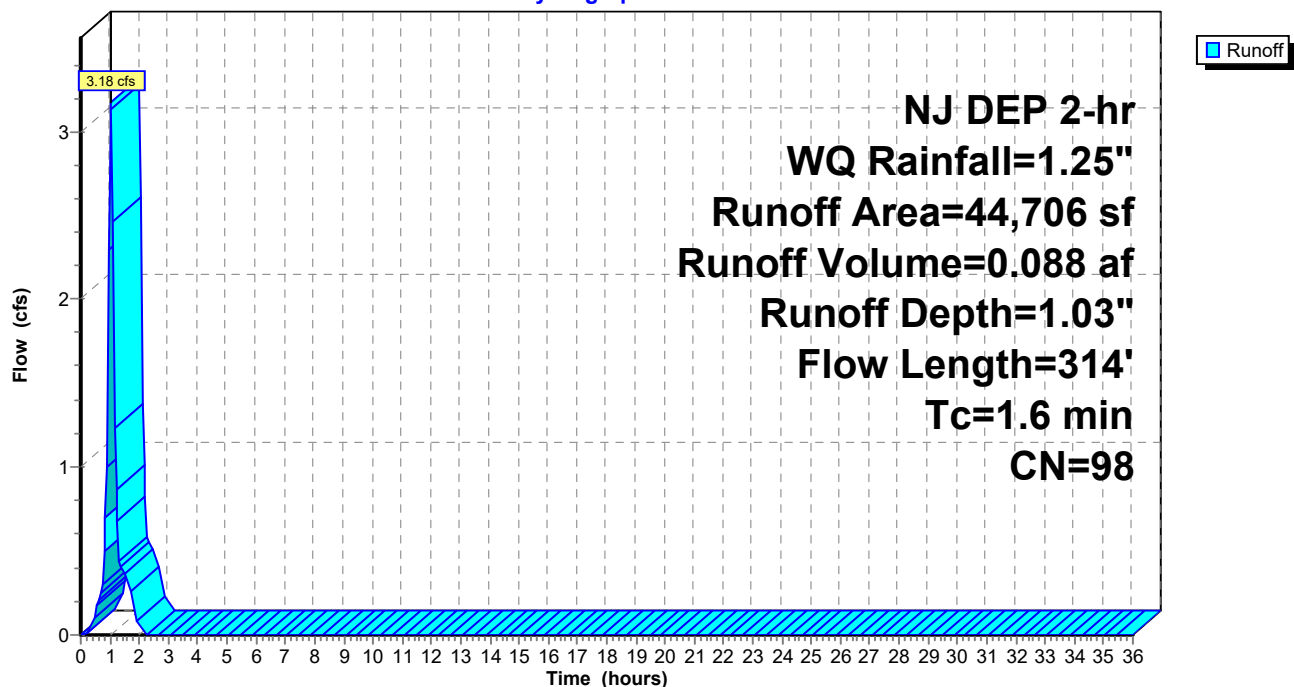

Prop 2 yr, 10 yr, 100 yr - Copy

Prepared by Dynamic Engineering

HydroCAD® 10.20-4b s/n 08640 © 2023 HydroCAD Software Solutions LLC

NJ DEP 2-hr WQ Rainfall=1.25"

Printed 3/5/2024

Page 10

Hydrograph for Subcatchment 1S: Prop SA North Imp

Time (hours)	Precip. (inches)	Excess (inches)	Runoff (cfs)	Time (hours)	Precip. (inches)	Excess (inches)	Runoff (cfs)
0.00	0.00	0.00	0.00	26.00	1.25	1.03	0.00
0.50	0.10	0.01	0.12	26.50	1.25	1.03	0.00
1.00	0.63	0.43	3.03	27.00	1.25	1.03	0.00
1.50	1.15	0.94	0.39	27.50	1.25	1.03	0.00
2.00	1.25	1.03	0.09	28.00	1.25	1.03	0.00
2.50	1.25	1.03	0.00	28.50	1.25	1.03	0.00
3.00	1.25	1.03	0.00	29.00	1.25	1.03	0.00
3.50	1.25	1.03	0.00	29.50	1.25	1.03	0.00
4.00	1.25	1.03	0.00	30.00	1.25	1.03	0.00
4.50	1.25	1.03	0.00	30.50	1.25	1.03	0.00
5.00	1.25	1.03	0.00	31.00	1.25	1.03	0.00
5.50	1.25	1.03	0.00	31.50	1.25	1.03	0.00
6.00	1.25	1.03	0.00	32.00	1.25	1.03	0.00
6.50	1.25	1.03	0.00	32.50	1.25	1.03	0.00
7.00	1.25	1.03	0.00	33.00	1.25	1.03	0.00
7.50	1.25	1.03	0.00	33.50	1.25	1.03	0.00
8.00	1.25	1.03	0.00	34.00	1.25	1.03	0.00
8.50	1.25	1.03	0.00	34.50	1.25	1.03	0.00
9.00	1.25	1.03	0.00	35.00	1.25	1.03	0.00
9.50	1.25	1.03	0.00	35.50	1.25	1.03	0.00
10.00	1.25	1.03	0.00	36.00	1.25	1.03	0.00
10.50	1.25	1.03	0.00				
11.00	1.25	1.03	0.00				
11.50	1.25	1.03	0.00				
12.00	1.25	1.03	0.00				
12.50	1.25	1.03	0.00				
13.00	1.25	1.03	0.00				
13.50	1.25	1.03	0.00				
14.00	1.25	1.03	0.00				
14.50	1.25	1.03	0.00				
15.00	1.25	1.03	0.00				
15.50	1.25	1.03	0.00				
16.00	1.25	1.03	0.00				
16.50	1.25	1.03	0.00				
17.00	1.25	1.03	0.00				
17.50	1.25	1.03	0.00				
18.00	1.25	1.03	0.00				
18.50	1.25	1.03	0.00				
19.00	1.25	1.03	0.00				
19.50	1.25	1.03	0.00				
20.00	1.25	1.03	0.00				
20.50	1.25	1.03	0.00				
21.00	1.25	1.03	0.00				
21.50	1.25	1.03	0.00				
22.00	1.25	1.03	0.00				
22.50	1.25	1.03	0.00				
23.00	1.25	1.03	0.00				
23.50	1.25	1.03	0.00				
24.00	1.25	1.03	0.00				
24.50	1.25	1.03	0.00				
25.00	1.25	1.03	0.00				
25.50	1.25	1.03	0.00				

Prop 2 yr, 10 yr, 100 yr - Copy

Prepared by Dynamic Engineering

HydroCAD® 10.20-4b s/n 08640 © 2023 HydroCAD Software Solutions LLC

NJ DEP 2-hr WQ Rainfall=1.25"

Printed 3/5/2024

Page 11

Summary for Subcatchment 2S: Prop SA North Perv


[45] Hint: Runoff=Zero

Runoff = 0.00 cfs @ 0.00 hrs, Volume= 0.000 af, Depth= 0.00"
Routed to Link 3L : Prop SA North

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs
NJ DEP 2-hr WQ Rainfall=1.25"

Area (sf)	CN	Description
7,705	55	Woods, Good, HSG B
21,248	61	>75% Grass cover, Good, HSG B
28,953	59	Weighted Average
28,953		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
11.9	100	0.0300	0.14		Sheet Flow, Sheet Flow
					Grass: Dense n= 0.240 P2= 3.34"
0.2	30	0.0300	2.79		Shallow Concentrated Flow, Shallow Concentrated Flow
					Unpaved Kv= 16.1 fps
12.1	130	Total			

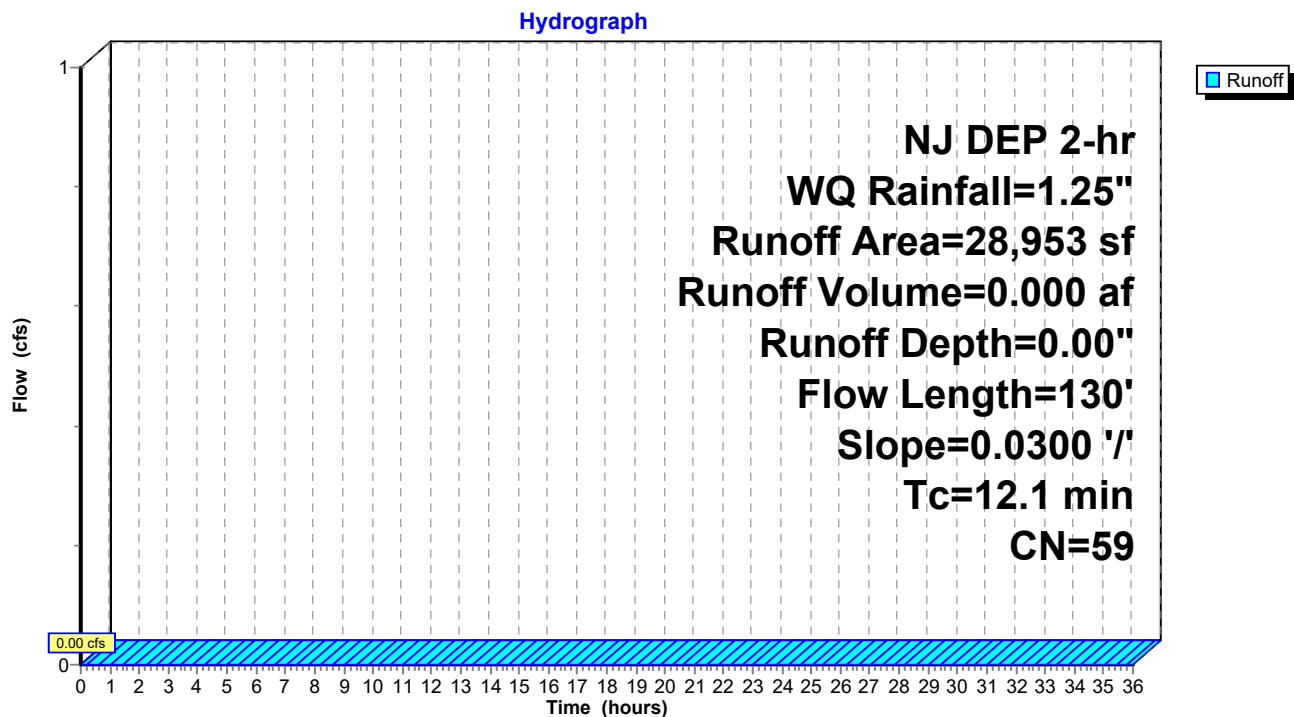Subcatchment 2S: Prop SA North Perv

Prop 2 yr, 10 yr, 100 yr - Copy

Prepared by Dynamic Engineering

HydroCAD® 10.20-4b s/n 08640 © 2023 HydroCAD Software Solutions LLC

NJ DEP 2-hr WQ Rainfall=1.25"

Printed 3/5/2024

Page 12

Hydrograph for Subcatchment 2S: Prop SA North Perv

Time (hours)	Precip. (inches)	Excess (inches)	Runoff (cfs)	Time (hours)	Precip. (inches)	Excess (inches)	Runoff (cfs)
0.00	0.00	0.00	0.00	26.00	1.25	0.00	0.00
0.50	0.10	0.00	0.00	26.50	1.25	0.00	0.00
1.00	0.63	0.00	0.00	27.00	1.25	0.00	0.00
1.50	1.15	0.00	0.00	27.50	1.25	0.00	0.00
2.00	1.25	0.00	0.00	28.00	1.25	0.00	0.00
2.50	1.25	0.00	0.00	28.50	1.25	0.00	0.00
3.00	1.25	0.00	0.00	29.00	1.25	0.00	0.00
3.50	1.25	0.00	0.00	29.50	1.25	0.00	0.00
4.00	1.25	0.00	0.00	30.00	1.25	0.00	0.00
4.50	1.25	0.00	0.00	30.50	1.25	0.00	0.00
5.00	1.25	0.00	0.00	31.00	1.25	0.00	0.00
5.50	1.25	0.00	0.00	31.50	1.25	0.00	0.00
6.00	1.25	0.00	0.00	32.00	1.25	0.00	0.00
6.50	1.25	0.00	0.00	32.50	1.25	0.00	0.00
7.00	1.25	0.00	0.00	33.00	1.25	0.00	0.00
7.50	1.25	0.00	0.00	33.50	1.25	0.00	0.00
8.00	1.25	0.00	0.00	34.00	1.25	0.00	0.00
8.50	1.25	0.00	0.00	34.50	1.25	0.00	0.00
9.00	1.25	0.00	0.00	35.00	1.25	0.00	0.00
9.50	1.25	0.00	0.00	35.50	1.25	0.00	0.00
10.00	1.25	0.00	0.00	36.00	1.25	0.00	0.00
10.50	1.25	0.00	0.00				
11.00	1.25	0.00	0.00				
11.50	1.25	0.00	0.00				
12.00	1.25	0.00	0.00				
12.50	1.25	0.00	0.00				
13.00	1.25	0.00	0.00				
13.50	1.25	0.00	0.00				
14.00	1.25	0.00	0.00				
14.50	1.25	0.00	0.00				
15.00	1.25	0.00	0.00				
15.50	1.25	0.00	0.00				
16.00	1.25	0.00	0.00				
16.50	1.25	0.00	0.00				
17.00	1.25	0.00	0.00				
17.50	1.25	0.00	0.00				
18.00	1.25	0.00	0.00				
18.50	1.25	0.00	0.00				
19.00	1.25	0.00	0.00				
19.50	1.25	0.00	0.00				
20.00	1.25	0.00	0.00				
20.50	1.25	0.00	0.00				
21.00	1.25	0.00	0.00				
21.50	1.25	0.00	0.00				
22.00	1.25	0.00	0.00				
22.50	1.25	0.00	0.00				
23.00	1.25	0.00	0.00				
23.50	1.25	0.00	0.00				
24.00	1.25	0.00	0.00				
24.50	1.25	0.00	0.00				
25.00	1.25	0.00	0.00				
25.50	1.25	0.00	0.00				

Prop 2 yr, 10 yr, 100 yr - Copy

Prepared by Dynamic Engineering

HydroCAD® 10.20-4b s/n 08640 © 2023 HydroCAD Software Solutions LLC

NJ DEP 2-hr WQ Rainfall=1.25"

Printed 3/5/2024

Page 13

Summary for Subcatchment 4S: Prop SA South Imp[49] Hint: $T_c < 2dt$ may require smaller dt

Runoff = 2.24 cfs @ 1.03 hrs, Volume= 0.063 af, Depth= 1.03"
Routed to Link 6L : Prop SA South


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, $dt=0.05$ hrs
NJ DEP 2-hr WQ Rainfall=1.25"

Area (sf)	CN	Description
21,220	98	Roofs, HSG B
10,621	98	Paved parking, HSG B
31,841	98	Weighted Average
31,841		100.00% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
1.4	90	0.0100	1.04		Sheet Flow, Sheet Flow Smooth surfaces $n=0.011$ $P2=3.34"$
0.5	135	0.0050	4.17	3.28	Pipe Channel, Pipe Channel Flow B 12.0" Round Area= 0.8 sf Perim= 3.1' $r=0.25'$ $n=0.010$ PVC, smooth interior
1.9	225	Total			

Subcatchment 4S: Prop SA South Imp

Hydrograph

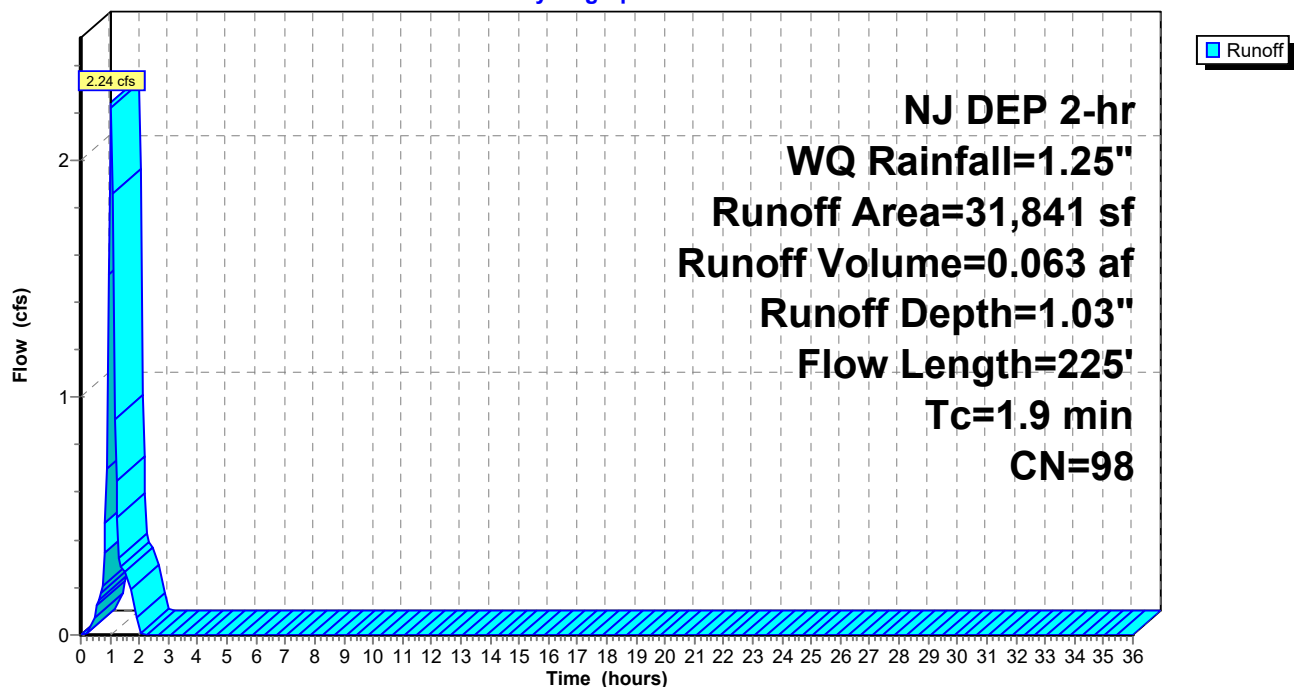

Prop 2 yr, 10 yr, 100 yr - Copy

Prepared by Dynamic Engineering

HydroCAD® 10.20-4b s/n 08640 © 2023 HydroCAD Software Solutions LLC

NJ DEP 2-hr WQ Rainfall=1.25"

Printed 3/5/2024

Page 14

Hydrograph for Subcatchment 4S: Prop SA South Imp

Time (hours)	Precip. (inches)	Excess (inches)	Runoff (cfs)	Time (hours)	Precip. (inches)	Excess (inches)	Runoff (cfs)
0.00	0.00	0.00	0.00	26.00	1.25	1.03	0.00
0.50	0.10	0.01	0.08	26.50	1.25	1.03	0.00
1.00	0.63	0.43	2.14	27.00	1.25	1.03	0.00
1.50	1.15	0.94	0.28	27.50	1.25	1.03	0.00
2.00	1.25	1.03	0.07	28.00	1.25	1.03	0.00
2.50	1.25	1.03	0.00	28.50	1.25	1.03	0.00
3.00	1.25	1.03	0.00	29.00	1.25	1.03	0.00
3.50	1.25	1.03	0.00	29.50	1.25	1.03	0.00
4.00	1.25	1.03	0.00	30.00	1.25	1.03	0.00
4.50	1.25	1.03	0.00	30.50	1.25	1.03	0.00
5.00	1.25	1.03	0.00	31.00	1.25	1.03	0.00
5.50	1.25	1.03	0.00	31.50	1.25	1.03	0.00
6.00	1.25	1.03	0.00	32.00	1.25	1.03	0.00
6.50	1.25	1.03	0.00	32.50	1.25	1.03	0.00
7.00	1.25	1.03	0.00	33.00	1.25	1.03	0.00
7.50	1.25	1.03	0.00	33.50	1.25	1.03	0.00
8.00	1.25	1.03	0.00	34.00	1.25	1.03	0.00
8.50	1.25	1.03	0.00	34.50	1.25	1.03	0.00
9.00	1.25	1.03	0.00	35.00	1.25	1.03	0.00
9.50	1.25	1.03	0.00	35.50	1.25	1.03	0.00
10.00	1.25	1.03	0.00	36.00	1.25	1.03	0.00
10.50	1.25	1.03	0.00				
11.00	1.25	1.03	0.00				
11.50	1.25	1.03	0.00				
12.00	1.25	1.03	0.00				
12.50	1.25	1.03	0.00				
13.00	1.25	1.03	0.00				
13.50	1.25	1.03	0.00				
14.00	1.25	1.03	0.00				
14.50	1.25	1.03	0.00				
15.00	1.25	1.03	0.00				
15.50	1.25	1.03	0.00				
16.00	1.25	1.03	0.00				
16.50	1.25	1.03	0.00				
17.00	1.25	1.03	0.00				
17.50	1.25	1.03	0.00				
18.00	1.25	1.03	0.00				
18.50	1.25	1.03	0.00				
19.00	1.25	1.03	0.00				
19.50	1.25	1.03	0.00				
20.00	1.25	1.03	0.00				
20.50	1.25	1.03	0.00				
21.00	1.25	1.03	0.00				
21.50	1.25	1.03	0.00				
22.00	1.25	1.03	0.00				
22.50	1.25	1.03	0.00				
23.00	1.25	1.03	0.00				
23.50	1.25	1.03	0.00				
24.00	1.25	1.03	0.00				
24.50	1.25	1.03	0.00				
25.00	1.25	1.03	0.00				
25.50	1.25	1.03	0.00				

Summary for Subcatchment 5S: Prop SA South Perv

[45] Hint: Runoff=Zero

Runoff = 0.00 cfs @ 0.00 hrs, Volume= 0.000 af, Depth= 0.00"
Routed to Link 6L : Prop SA South


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs
NJ DEP 2-hr WQ Rainfall=1.25"

Area (sf)	CN	Description
971	55	Woods, Good, HSG B
23,533	61	>75% Grass cover, Good, HSG B
24,504	61	Weighted Average
24,504		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
11.0	70	0.0180	0.11		Sheet Flow, Sheet Flow
					Grass: Dense n= 0.240 P2= 3.34"

Subcatchment 5S: Prop SA South Perv

Hydrograph

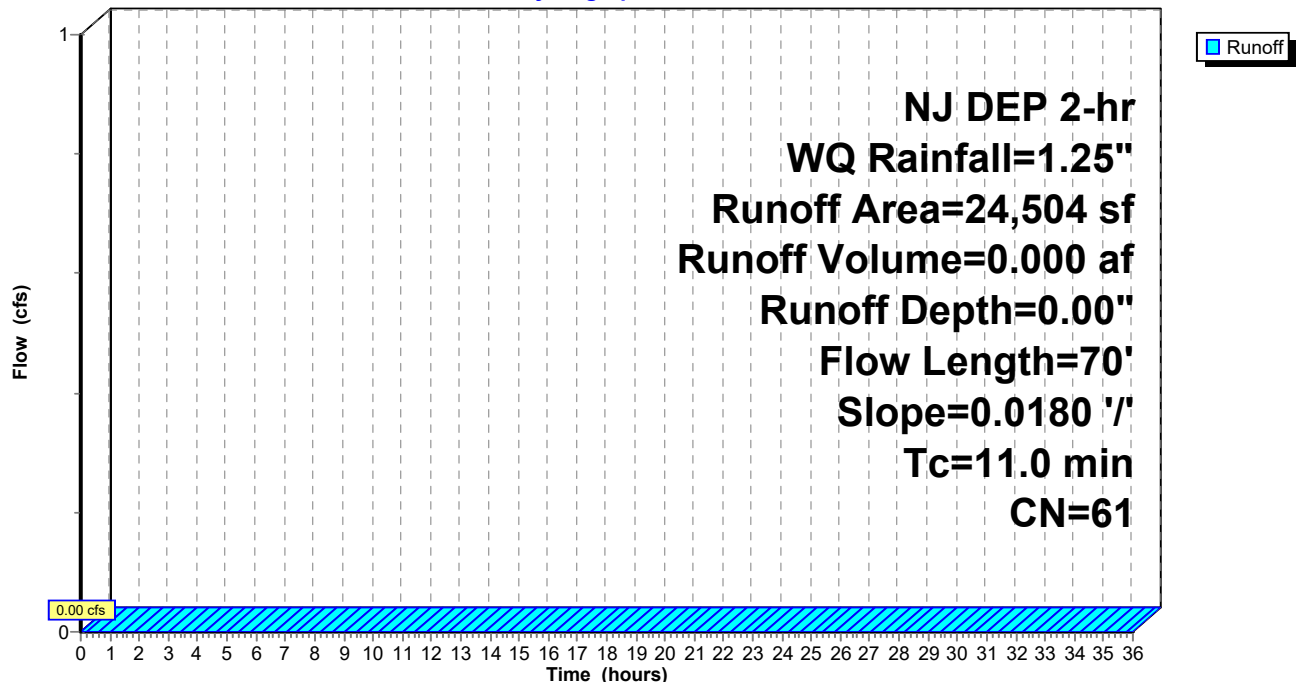

Prop 2 yr, 10 yr, 100 yr - Copy

Prepared by Dynamic Engineering

HydroCAD® 10.20-4b s/n 08640 © 2023 HydroCAD Software Solutions LLC

NJ DEP 2-hr WQ Rainfall=1.25"

Printed 3/5/2024

Page 16

Hydrograph for Subcatchment 5S: Prop SA South Perv

Time (hours)	Precip. (inches)	Excess (inches)	Runoff (cfs)	Time (hours)	Precip. (inches)	Excess (inches)	Runoff (cfs)
0.00	0.00	0.00	0.00	26.00	1.25	0.00	0.00
0.50	0.10	0.00	0.00	26.50	1.25	0.00	0.00
1.00	0.63	0.00	0.00	27.00	1.25	0.00	0.00
1.50	1.15	0.00	0.00	27.50	1.25	0.00	0.00
2.00	1.25	0.00	0.00	28.00	1.25	0.00	0.00
2.50	1.25	0.00	0.00	28.50	1.25	0.00	0.00
3.00	1.25	0.00	0.00	29.00	1.25	0.00	0.00
3.50	1.25	0.00	0.00	29.50	1.25	0.00	0.00
4.00	1.25	0.00	0.00	30.00	1.25	0.00	0.00
4.50	1.25	0.00	0.00	30.50	1.25	0.00	0.00
5.00	1.25	0.00	0.00	31.00	1.25	0.00	0.00
5.50	1.25	0.00	0.00	31.50	1.25	0.00	0.00
6.00	1.25	0.00	0.00	32.00	1.25	0.00	0.00
6.50	1.25	0.00	0.00	32.50	1.25	0.00	0.00
7.00	1.25	0.00	0.00	33.00	1.25	0.00	0.00
7.50	1.25	0.00	0.00	33.50	1.25	0.00	0.00
8.00	1.25	0.00	0.00	34.00	1.25	0.00	0.00
8.50	1.25	0.00	0.00	34.50	1.25	0.00	0.00
9.00	1.25	0.00	0.00	35.00	1.25	0.00	0.00
9.50	1.25	0.00	0.00	35.50	1.25	0.00	0.00
10.00	1.25	0.00	0.00	36.00	1.25	0.00	0.00
10.50	1.25	0.00	0.00				
11.00	1.25	0.00	0.00				
11.50	1.25	0.00	0.00				
12.00	1.25	0.00	0.00				
12.50	1.25	0.00	0.00				
13.00	1.25	0.00	0.00				
13.50	1.25	0.00	0.00				
14.00	1.25	0.00	0.00				
14.50	1.25	0.00	0.00				
15.00	1.25	0.00	0.00				
15.50	1.25	0.00	0.00				
16.00	1.25	0.00	0.00				
16.50	1.25	0.00	0.00				
17.00	1.25	0.00	0.00				
17.50	1.25	0.00	0.00				
18.00	1.25	0.00	0.00				
18.50	1.25	0.00	0.00				
19.00	1.25	0.00	0.00				
19.50	1.25	0.00	0.00				
20.00	1.25	0.00	0.00				
20.50	1.25	0.00	0.00				
21.00	1.25	0.00	0.00				
21.50	1.25	0.00	0.00				
22.00	1.25	0.00	0.00				
22.50	1.25	0.00	0.00				
23.00	1.25	0.00	0.00				
23.50	1.25	0.00	0.00				
24.00	1.25	0.00	0.00				
24.50	1.25	0.00	0.00				
25.00	1.25	0.00	0.00				
25.50	1.25	0.00	0.00				


Summary for Link 3L: Prop SA North

Inflow Area = 1.691 ac, 60.69% Impervious, Inflow Depth = 0.63" for WQ event
Inflow = 3.18 cfs @ 1.03 hrs, Volume= 0.088 af
Primary = 3.18 cfs @ 1.03 hrs, Volume= 0.088 af, Atten= 0%, Lag= 0.0 min

Primary outflow = Inflow, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs

Link 3L: Prop SA North

Hydrograph

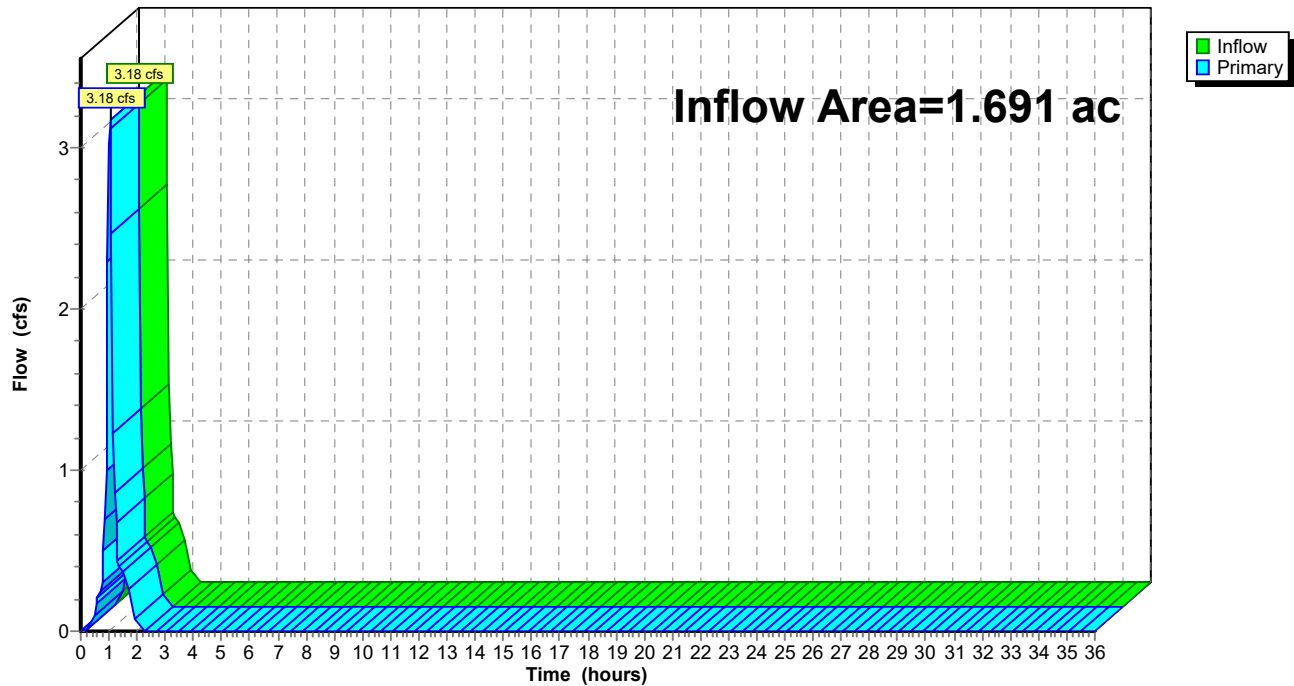

Prop 2 yr, 10 yr, 100 yr - Copy

Prepared by Dynamic Engineering

HydroCAD® 10.20-4b s/n 08640 © 2023 HydroCAD Software Solutions LLC

NJ DEP 2-hr WQ Rainfall=1.25"

Printed 3/5/2024

Page 18

Hydrograph for Link 3L: Prop SA North


Time (hours)	Inflow (cfs)	Elevation (feet)	Primary (cfs)	Time (hours)	Inflow (cfs)	Elevation (feet)	Primary (cfs)
0.00	0.00	0.00	0.00	26.00	0.00	0.00	0.00
0.50	0.12	0.00	0.12	26.50	0.00	0.00	0.00
1.00	3.03	0.00	3.03	27.00	0.00	0.00	0.00
1.50	0.39	0.00	0.39	27.50	0.00	0.00	0.00
2.00	0.09	0.00	0.09	28.00	0.00	0.00	0.00
2.50	0.00	0.00	0.00	28.50	0.00	0.00	0.00
3.00	0.00	0.00	0.00	29.00	0.00	0.00	0.00
3.50	0.00	0.00	0.00	29.50	0.00	0.00	0.00
4.00	0.00	0.00	0.00	30.00	0.00	0.00	0.00
4.50	0.00	0.00	0.00	30.50	0.00	0.00	0.00
5.00	0.00	0.00	0.00	31.00	0.00	0.00	0.00
5.50	0.00	0.00	0.00	31.50	0.00	0.00	0.00
6.00	0.00	0.00	0.00	32.00	0.00	0.00	0.00
6.50	0.00	0.00	0.00	32.50	0.00	0.00	0.00
7.00	0.00	0.00	0.00	33.00	0.00	0.00	0.00
7.50	0.00	0.00	0.00	33.50	0.00	0.00	0.00
8.00	0.00	0.00	0.00	34.00	0.00	0.00	0.00
8.50	0.00	0.00	0.00	34.50	0.00	0.00	0.00
9.00	0.00	0.00	0.00	35.00	0.00	0.00	0.00
9.50	0.00	0.00	0.00	35.50	0.00	0.00	0.00
10.00	0.00	0.00	0.00	36.00	0.00	0.00	0.00
10.50	0.00	0.00	0.00				
11.00	0.00	0.00	0.00				
11.50	0.00	0.00	0.00				
12.00	0.00	0.00	0.00				
12.50	0.00	0.00	0.00				
13.00	0.00	0.00	0.00				
13.50	0.00	0.00	0.00				
14.00	0.00	0.00	0.00				
14.50	0.00	0.00	0.00				
15.00	0.00	0.00	0.00				
15.50	0.00	0.00	0.00				
16.00	0.00	0.00	0.00				
16.50	0.00	0.00	0.00				
17.00	0.00	0.00	0.00				
17.50	0.00	0.00	0.00				
18.00	0.00	0.00	0.00				
18.50	0.00	0.00	0.00				
19.00	0.00	0.00	0.00				
19.50	0.00	0.00	0.00				
20.00	0.00	0.00	0.00				
20.50	0.00	0.00	0.00				
21.00	0.00	0.00	0.00				
21.50	0.00	0.00	0.00				
22.00	0.00	0.00	0.00				
22.50	0.00	0.00	0.00				
23.00	0.00	0.00	0.00				
23.50	0.00	0.00	0.00				
24.00	0.00	0.00	0.00				
24.50	0.00	0.00	0.00				
25.00	0.00	0.00	0.00				
25.50	0.00	0.00	0.00				

Summary for Link 6L: Prop SA South

Inflow Area = 1.294 ac, 56.51% Impervious, Inflow Depth = 0.58" for WQ event
Inflow = 2.24 cfs @ 1.03 hrs, Volume= 0.063 af
Primary = 2.24 cfs @ 1.03 hrs, Volume= 0.063 af, Atten= 0%, Lag= 0.0 min

Primary outflow = Inflow, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs

Link 6L: Prop SA South

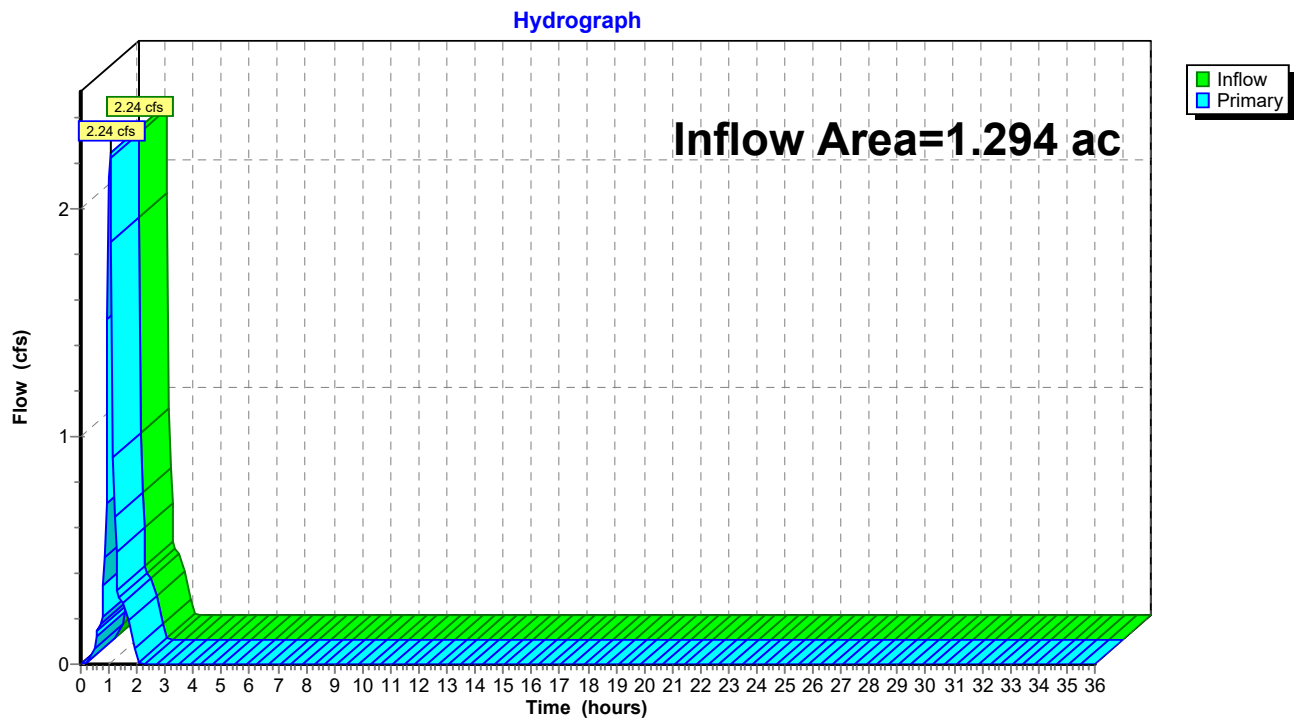

Prop 2 yr, 10 yr, 100 yr - Copy

Prepared by Dynamic Engineering

HydroCAD® 10.20-4b s/n 08640 © 2023 HydroCAD Software Solutions LLC

NJ DEP 2-hr WQ Rainfall=1.25"

Printed 3/5/2024

Page 20

Hydrograph for Link 6L: Prop SA South

Time (hours)	Inflow (cfs)	Elevation (feet)	Primary (cfs)	Time (hours)	Inflow (cfs)	Elevation (feet)	Primary (cfs)
0.00	0.00	0.00	0.00	26.00	0.00	0.00	0.00
0.50	0.08	0.00	0.08	26.50	0.00	0.00	0.00
1.00	2.14	0.00	2.14	27.00	0.00	0.00	0.00
1.50	0.28	0.00	0.28	27.50	0.00	0.00	0.00
2.00	0.07	0.00	0.07	28.00	0.00	0.00	0.00
2.50	0.00	0.00	0.00	28.50	0.00	0.00	0.00
3.00	0.00	0.00	0.00	29.00	0.00	0.00	0.00
3.50	0.00	0.00	0.00	29.50	0.00	0.00	0.00
4.00	0.00	0.00	0.00	30.00	0.00	0.00	0.00
4.50	0.00	0.00	0.00	30.50	0.00	0.00	0.00
5.00	0.00	0.00	0.00	31.00	0.00	0.00	0.00
5.50	0.00	0.00	0.00	31.50	0.00	0.00	0.00
6.00	0.00	0.00	0.00	32.00	0.00	0.00	0.00
6.50	0.00	0.00	0.00	32.50	0.00	0.00	0.00
7.00	0.00	0.00	0.00	33.00	0.00	0.00	0.00
7.50	0.00	0.00	0.00	33.50	0.00	0.00	0.00
8.00	0.00	0.00	0.00	34.00	0.00	0.00	0.00
8.50	0.00	0.00	0.00	34.50	0.00	0.00	0.00
9.00	0.00	0.00	0.00	35.00	0.00	0.00	0.00
9.50	0.00	0.00	0.00	35.50	0.00	0.00	0.00
10.00	0.00	0.00	0.00	36.00	0.00	0.00	0.00
10.50	0.00	0.00	0.00				
11.00	0.00	0.00	0.00				
11.50	0.00	0.00	0.00				
12.00	0.00	0.00	0.00				
12.50	0.00	0.00	0.00				
13.00	0.00	0.00	0.00				
13.50	0.00	0.00	0.00				
14.00	0.00	0.00	0.00				
14.50	0.00	0.00	0.00				
15.00	0.00	0.00	0.00				
15.50	0.00	0.00	0.00				
16.00	0.00	0.00	0.00				
16.50	0.00	0.00	0.00				
17.00	0.00	0.00	0.00				
17.50	0.00	0.00	0.00				
18.00	0.00	0.00	0.00				
18.50	0.00	0.00	0.00				
19.00	0.00	0.00	0.00				
19.50	0.00	0.00	0.00				
20.00	0.00	0.00	0.00				
20.50	0.00	0.00	0.00				
21.00	0.00	0.00	0.00				
21.50	0.00	0.00	0.00				
22.00	0.00	0.00	0.00				
22.50	0.00	0.00	0.00				
23.00	0.00	0.00	0.00				
23.50	0.00	0.00	0.00				
24.00	0.00	0.00	0.00				
24.50	0.00	0.00	0.00				
25.00	0.00	0.00	0.00				
25.50	0.00	0.00	0.00				

Prop 2 yr, 10 yr, 100 yr - Copy

Prepared by Dynamic Engineering

HydroCAD® 10.20-4b s/n 08640 © 2023 HydroCAD Software Solutions LLC

NOAA 24-hr C 2-Year Rainfall=3.34"

Printed 3/5/2024

Page 21

Time span=0.00-36.00 hrs, dt=0.05 hrs, 721 points
Runoff by SCS TR-20 method, UH=SCS, Weighted-CN
Reach routing by Stor-Ind+Trans method - Pond routing by Stor-Ind method

Subcatchment1S: Prop SA North Imp Runoff Area=44,706 sf 100.00% Impervious Runoff Depth=3.11"
Flow Length=314' Tc=1.6 min CN=98 Runoff=3.98 cfs 0.266 af

Subcatchment2S: Prop SA North Perv Runoff Area=28,953 sf 0.00% Impervious Runoff Depth=0.43"
Flow Length=130' Slope=0.0300 '/' Tc=12.1 min CN=59 Runoff=0.18 cfs 0.024 af

Subcatchment4S: Prop SA South Imp Runoff Area=31,841 sf 100.00% Impervious Runoff Depth=3.11"
Flow Length=225' Tc=1.9 min CN=98 Runoff=2.89 cfs 0.189 af

Subcatchment5S: Prop SA South Perv Runoff Area=24,504 sf 0.00% Impervious Runoff Depth=0.50"
Flow Length=70' Slope=0.0180 '/' Tc=11.0 min CN=61 Runoff=0.22 cfs 0.024 af

Link 3L: Prop SA North Inflow=4.01 cfs 0.289 af
Primary=4.01 cfs 0.289 af

Link 6L: Prop SA South Inflow=2.96 cfs 0.213 af
Primary=2.96 cfs 0.213 af

Total Runoff Area = 2.984 ac Runoff Volume = 0.502 af Average Runoff Depth = 2.02"
41.12% Pervious = 1.227 ac 58.88% Impervious = 1.757 ac

Prop 2 yr, 10 yr, 100 yr - Copy

Prepared by Dynamic Engineering

HydroCAD® 10.20-4b s/n 08640 © 2023 HydroCAD Software Solutions LLC

NOAA 24-hr C 2-Year Rainfall=3.34"

Printed 3/5/2024

Page 22

Summary for Subcatchment 1S: Prop SA North Imp[49] Hint: $T_c < 2dt$ may require smaller dt

Runoff = 3.98 cfs @ 12.07 hrs, Volume= 0.266 af, Depth= 3.11"
Routed to Link 3L : Prop SA North


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, $dt=0.05$ hrs
NOAA 24-hr C 2-Year Rainfall=3.34"

Area (sf)	CN	Description
12,060	98	Paved parking, HSG B
32,646	98	Roofs, HSG B
44,706	98	Weighted Average
44,706		100.00% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
1.2	70	0.0100	0.99		Sheet Flow, Sheet Flow Smooth surfaces $n=0.011$ $P2=3.34"$
0.4	244	0.0200	9.68	11.88	Pipe Channel, Channel Flow 15.0" Round Area= 1.2 sf Perim= 3.9' $r=0.31'$ $n=0.010$ PVC, smooth interior
1.6	314	Total			

Subcatchment 1S: Prop SA North Imp

Hydrograph

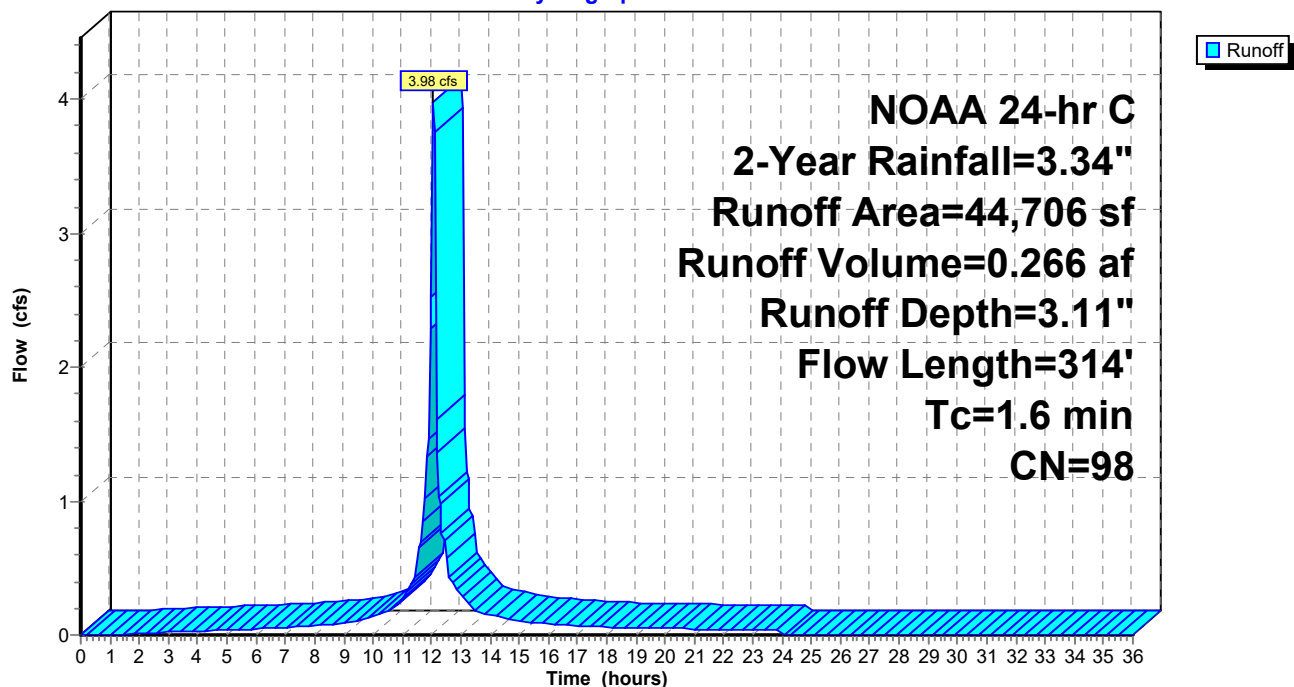

Prop 2 yr, 10 yr, 100 yr - Copy

Prepared by Dynamic Engineering

HydroCAD® 10.20-4b s/n 08640 © 2023 HydroCAD Software Solutions LLC

NOAA 24-hr C 2-Year Rainfall=3.34"

Printed 3/5/2024

Page 23

Hydrograph for Subcatchment 1S: Prop SA North Imp

Time (hours)	Precip. (inches)	Excess (inches)	Runoff (cfs)	Time (hours)	Precip. (inches)	Excess (inches)	Runoff (cfs)
0.00	0.00	0.00	0.00	26.00	3.34	3.11	0.00
0.50	0.02	0.00	0.00	26.50	3.34	3.11	0.00
1.00	0.04	0.00	0.00	27.00	3.34	3.11	0.00
1.50	0.06	0.00	0.00	27.50	3.34	3.11	0.00
2.00	0.08	0.01	0.01	28.00	3.34	3.11	0.00
2.50	0.10	0.01	0.02	28.50	3.34	3.11	0.00
3.00	0.12	0.02	0.02	29.00	3.34	3.11	0.00
3.50	0.14	0.03	0.03	29.50	3.34	3.11	0.00
4.00	0.16	0.05	0.03	30.00	3.34	3.11	0.00
4.50	0.19	0.06	0.03	30.50	3.34	3.11	0.00
5.00	0.21	0.08	0.04	31.00	3.34	3.11	0.00
5.50	0.24	0.10	0.04	31.50	3.34	3.11	0.00
6.00	0.26	0.12	0.04	32.00	3.34	3.11	0.00
6.50	0.29	0.14	0.05	32.50	3.34	3.11	0.00
7.00	0.33	0.17	0.06	33.00	3.34	3.11	0.00
7.50	0.36	0.20	0.06	33.50	3.34	3.11	0.00
8.00	0.40	0.23	0.07	34.00	3.34	3.11	0.00
8.50	0.44	0.27	0.08	34.50	3.34	3.11	0.00
9.00	0.49	0.31	0.09	35.00	3.34	3.11	0.00
9.50	0.54	0.36	0.11	35.50	3.34	3.11	0.00
10.00	0.61	0.42	0.14	36.00	3.34	3.11	0.00
10.50	0.69	0.49	0.17				
11.00	0.80	0.60	0.26				
11.50	0.99	0.78	0.46				
12.00	1.59	1.37	2.53				
12.50	2.35	2.12	0.67				
13.00	2.54	2.31	0.31				
13.50	2.65	2.42	0.19				
14.00	2.73	2.50	0.15				
14.50	2.80	2.57	0.13				
15.00	2.85	2.62	0.10				
15.50	2.90	2.67	0.09				
16.00	2.94	2.71	0.08				
16.50	2.98	2.75	0.08				
17.00	3.01	2.78	0.07				
17.50	3.05	2.81	0.06				
18.00	3.08	2.84	0.06				
18.50	3.10	2.87	0.05				
19.00	3.13	2.90	0.05				
19.50	3.15	2.92	0.05				
20.00	3.18	2.94	0.05				
20.50	3.20	2.97	0.05				
21.00	3.22	2.99	0.05				
21.50	3.24	3.01	0.04				
22.00	3.26	3.03	0.04				
22.50	3.28	3.05	0.04				
23.00	3.30	3.07	0.04				
23.50	3.32	3.09	0.04				
24.00	3.34	3.11	0.04				
24.50	3.34	3.11	0.00				
25.00	3.34	3.11	0.00				
25.50	3.34	3.11	0.00				

Prop 2 yr, 10 yr, 100 yr - Copy

Prepared by Dynamic Engineering

HydroCAD® 10.20-4b s/n 08640 © 2023 HydroCAD Software Solutions LLC

NOAA 24-hr C 2-Year Rainfall=3.34"

Printed 3/5/2024

Page 24

Summary for Subcatchment 2S: Prop SA North Perv

Runoff = 0.18 cfs @ 12.25 hrs, Volume= 0.024 af, Depth= 0.43"

Routed to Link 3L : Prop SA North


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs
NOAA 24-hr C 2-Year Rainfall=3.34"

Area (sf)	CN	Description
7,705	55	Woods, Good, HSG B
21,248	61	>75% Grass cover, Good, HSG B
28,953	59	Weighted Average
28,953		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
11.9	100	0.0300	0.14		Sheet Flow, Sheet Flow Grass: Dense n= 0.240 P2= 3.34"
0.2	30	0.0300	2.79		Shallow Concentrated Flow, Shallow Concentrated Flow Unpaved Kv= 16.1 fps
12.1	130	Total			

Subcatchment 2S: Prop SA North Perv

Hydrograph

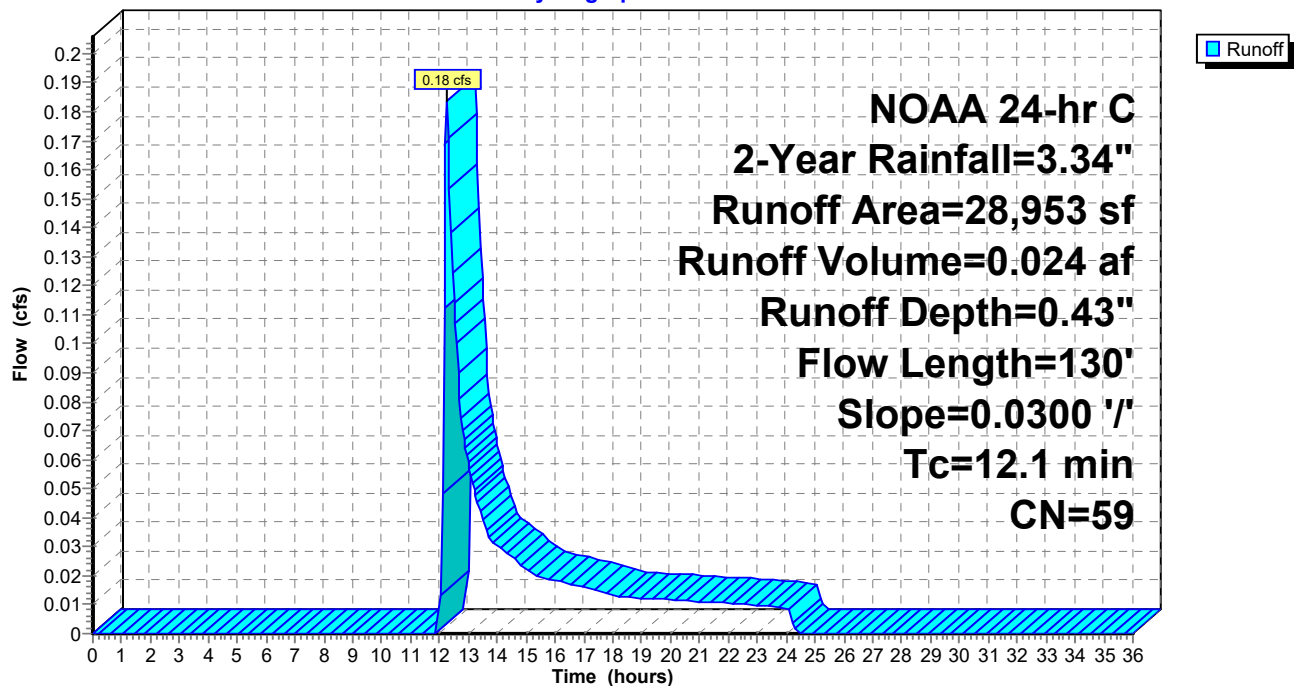

Prop 2 yr, 10 yr, 100 yr - Copy

Prepared by Dynamic Engineering

HydroCAD® 10.20-4b s/n 08640 © 2023 HydroCAD Software Solutions LLC

NOAA 24-hr C 2-Year Rainfall=3.34"

Printed 3/5/2024

Page 25

Hydrograph for Subcatchment 2S: Prop SA North Perv

Time (hours)	Precip. (inches)	Excess (inches)	Runoff (cfs)	Time (hours)	Precip. (inches)	Excess (inches)	Runoff (cfs)
0.00	0.00	0.00	0.00	26.00	3.34	0.43	0.00
0.50	0.02	0.00	0.00	26.50	3.34	0.43	0.00
1.00	0.04	0.00	0.00	27.00	3.34	0.43	0.00
1.50	0.06	0.00	0.00	27.50	3.34	0.43	0.00
2.00	0.08	0.00	0.00	28.00	3.34	0.43	0.00
2.50	0.10	0.00	0.00	28.50	3.34	0.43	0.00
3.00	0.12	0.00	0.00	29.00	3.34	0.43	0.00
3.50	0.14	0.00	0.00	29.50	3.34	0.43	0.00
4.00	0.16	0.00	0.00	30.00	3.34	0.43	0.00
4.50	0.19	0.00	0.00	30.50	3.34	0.43	0.00
5.00	0.21	0.00	0.00	31.00	3.34	0.43	0.00
5.50	0.24	0.00	0.00	31.50	3.34	0.43	0.00
6.00	0.26	0.00	0.00	32.00	3.34	0.43	0.00
6.50	0.29	0.00	0.00	32.50	3.34	0.43	0.00
7.00	0.33	0.00	0.00	33.00	3.34	0.43	0.00
7.50	0.36	0.00	0.00	33.50	3.34	0.43	0.00
8.00	0.40	0.00	0.00	34.00	3.34	0.43	0.00
8.50	0.44	0.00	0.00	34.50	3.34	0.43	0.00
9.00	0.49	0.00	0.00	35.00	3.34	0.43	0.00
9.50	0.54	0.00	0.00	35.50	3.34	0.43	0.00
10.00	0.61	0.00	0.00	36.00	3.34	0.43	0.00
10.50	0.69	0.00	0.00				
11.00	0.80	0.00	0.00				
11.50	0.99	0.00	0.00				
12.00	1.59	0.01	0.00				
12.50	2.35	0.12	0.11				
13.00	2.54	0.16	0.06				
13.50	2.65	0.19	0.04				
14.00	2.73	0.22	0.03				
14.50	2.80	0.24	0.03				
15.00	2.85	0.25	0.02				
15.50	2.90	0.27	0.02				
16.00	2.94	0.28	0.02				
16.50	2.98	0.30	0.02				
17.00	3.01	0.31	0.02				
17.50	3.05	0.32	0.01				
18.00	3.08	0.33	0.01				
18.50	3.10	0.34	0.01				
19.00	3.13	0.35	0.01				
19.50	3.15	0.36	0.01				
20.00	3.18	0.37	0.01				
20.50	3.20	0.37	0.01				
21.00	3.22	0.38	0.01				
21.50	3.24	0.39	0.01				
22.00	3.26	0.40	0.01				
22.50	3.28	0.41	0.01				
23.00	3.30	0.41	0.01				
23.50	3.32	0.42	0.01				
24.00	3.34	0.43	0.01				
24.50	3.34	0.43	0.00				
25.00	3.34	0.43	0.00				
25.50	3.34	0.43	0.00				

Prop 2 yr, 10 yr, 100 yr - Copy

Prepared by Dynamic Engineering

HydroCAD® 10.20-4b s/n 08640 © 2023 HydroCAD Software Solutions LLC

NOAA 24-hr C 2-Year Rainfall=3.34"

Printed 3/5/2024

Page 26

Summary for Subcatchment 4S: Prop SA South Imp[49] Hint: $T_c < 2dt$ may require smaller dt

Runoff = 2.89 cfs @ 12.08 hrs, Volume= 0.189 af, Depth= 3.11"
Routed to Link 6L : Prop SA South


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, $dt=0.05$ hrs
NOAA 24-hr C 2-Year Rainfall=3.34"

Area (sf)	CN	Description
21,220	98	Roofs, HSG B
10,621	98	Paved parking, HSG B
31,841	98	Weighted Average
31,841		100.00% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
1.4	90	0.0100	1.04		Sheet Flow, Sheet Flow Smooth surfaces $n=0.011$ $P2=3.34"$
0.5	135	0.0050	4.17	3.28	Pipe Channel, Pipe Channel Flow B 12.0" Round Area= 0.8 sf Perim= 3.1' $r=0.25'$ $n=0.010$ PVC, smooth interior
1.9	225	Total			

Subcatchment 4S: Prop SA South Imp

Hydrograph

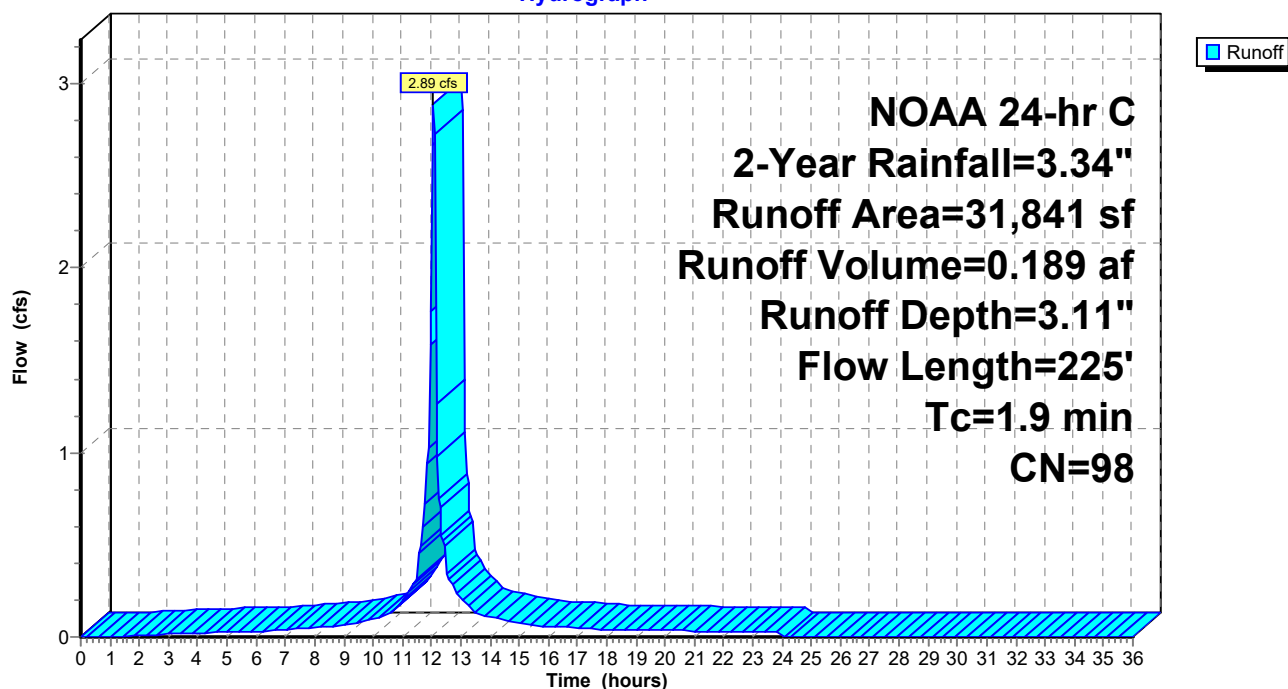

Prop 2 yr, 10 yr, 100 yr - Copy

Prepared by Dynamic Engineering

HydroCAD® 10.20-4b s/n 08640 © 2023 HydroCAD Software Solutions LLC

NOAA 24-hr C 2-Year Rainfall=3.34"

Printed 3/5/2024

Page 27

Hydrograph for Subcatchment 4S: Prop SA South Imp

Time (hours)	Precip. (inches)	Excess (inches)	Runoff (cfs)	Time (hours)	Precip. (inches)	Excess (inches)	Runoff (cfs)
0.00	0.00	0.00	0.00	26.00	3.34	3.11	0.00
0.50	0.02	0.00	0.00	26.50	3.34	3.11	0.00
1.00	0.04	0.00	0.00	27.00	3.34	3.11	0.00
1.50	0.06	0.00	0.00	27.50	3.34	3.11	0.00
2.00	0.08	0.01	0.01	28.00	3.34	3.11	0.00
2.50	0.10	0.01	0.01	28.50	3.34	3.11	0.00
3.00	0.12	0.02	0.02	29.00	3.34	3.11	0.00
3.50	0.14	0.03	0.02	29.50	3.34	3.11	0.00
4.00	0.16	0.05	0.02	30.00	3.34	3.11	0.00
4.50	0.19	0.06	0.02	30.50	3.34	3.11	0.00
5.00	0.21	0.08	0.03	31.00	3.34	3.11	0.00
5.50	0.24	0.10	0.03	31.50	3.34	3.11	0.00
6.00	0.26	0.12	0.03	32.00	3.34	3.11	0.00
6.50	0.29	0.14	0.04	32.50	3.34	3.11	0.00
7.00	0.33	0.17	0.04	33.00	3.34	3.11	0.00
7.50	0.36	0.20	0.05	33.50	3.34	3.11	0.00
8.00	0.40	0.23	0.05	34.00	3.34	3.11	0.00
8.50	0.44	0.27	0.06	34.50	3.34	3.11	0.00
9.00	0.49	0.31	0.06	35.00	3.34	3.11	0.00
9.50	0.54	0.36	0.08	35.50	3.34	3.11	0.00
10.00	0.61	0.42	0.10	36.00	3.34	3.11	0.00
10.50	0.69	0.49	0.12				
11.00	0.80	0.60	0.19				
11.50	0.99	0.78	0.32				
12.00	1.59	1.37	1.76				
12.50	2.35	2.12	0.48				
13.00	2.54	2.31	0.22				
13.50	2.65	2.42	0.14				
14.00	2.73	2.50	0.11				
14.50	2.80	2.57	0.09				
15.00	2.85	2.62	0.07				
15.50	2.90	2.67	0.06				
16.00	2.94	2.71	0.06				
16.50	2.98	2.75	0.05				
17.00	3.01	2.78	0.05				
17.50	3.05	2.81	0.05				
18.00	3.08	2.84	0.04				
18.50	3.10	2.87	0.04				
19.00	3.13	2.90	0.04				
19.50	3.15	2.92	0.04				
20.00	3.18	2.94	0.03				
20.50	3.20	2.97	0.03				
21.00	3.22	2.99	0.03				
21.50	3.24	3.01	0.03				
22.00	3.26	3.03	0.03				
22.50	3.28	3.05	0.03				
23.00	3.30	3.07	0.03				
23.50	3.32	3.09	0.03				
24.00	3.34	3.11	0.03				
24.50	3.34	3.11	0.00				
25.00	3.34	3.11	0.00				
25.50	3.34	3.11	0.00				

Prop 2 yr, 10 yr, 100 yr - Copy

Prepared by Dynamic Engineering

HydroCAD® 10.20-4b s/n 08640 © 2023 HydroCAD Software Solutions LLC

NOAA 24-hr C 2-Year Rainfall=3.34"

Printed 3/5/2024

Page 28

Summary for Subcatchment 5S: Prop SA South Perv

Runoff = 0.22 cfs @ 12.22 hrs, Volume= 0.024 af, Depth= 0.50"
Routed to Link 6L : Prop SA South


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs
NOAA 24-hr C 2-Year Rainfall=3.34"

Area (sf)	CN	Description
971	55	Woods, Good, HSG B
23,533	61	>75% Grass cover, Good, HSG B
24,504	61	Weighted Average
24,504		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
11.0	70	0.0180	0.11		Sheet Flow, Sheet Flow
					Grass: Dense n= 0.240 P2= 3.34"

Subcatchment 5S: Prop SA South Perv

Hydrograph

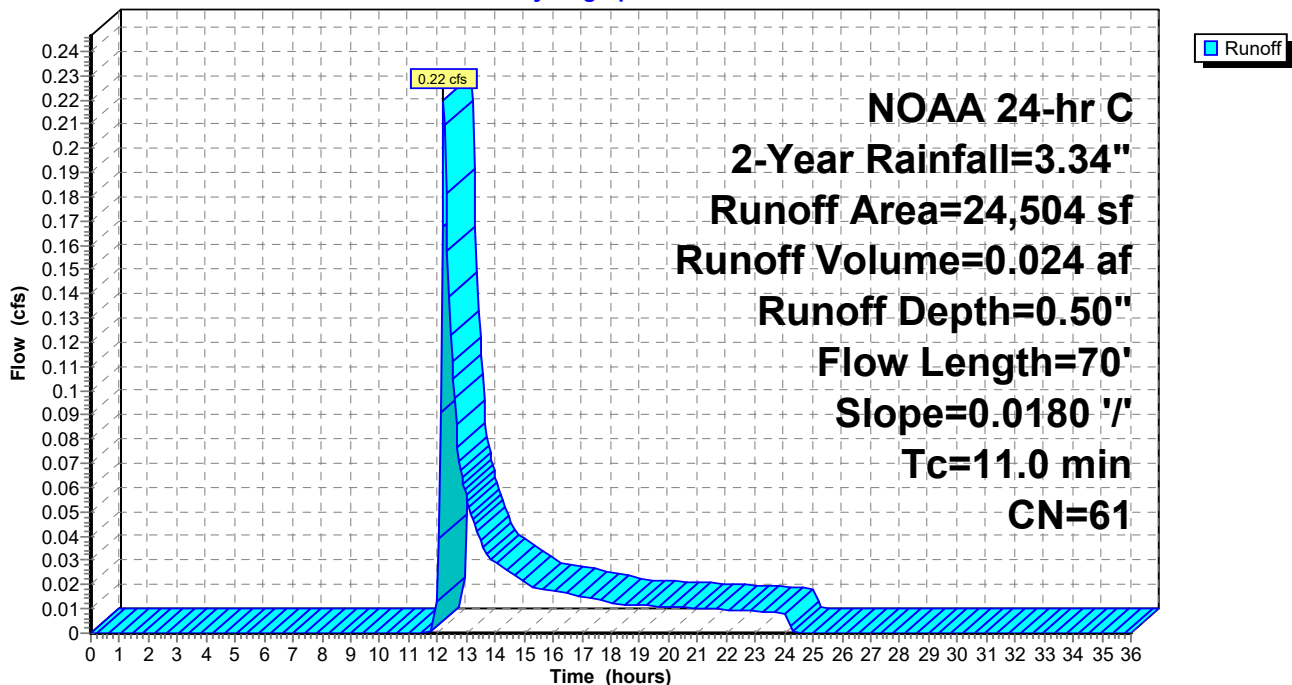

Prop 2 yr, 10 yr, 100 yr - Copy

Prepared by Dynamic Engineering

HydroCAD® 10.20-4b s/n 08640 © 2023 HydroCAD Software Solutions LLC

NOAA 24-hr C 2-Year Rainfall=3.34"

Printed 3/5/2024

Page 29

Hydrograph for Subcatchment 5S: Prop SA South Perv


Time (hours)	Precip. (inches)	Excess (inches)	Runoff (cfs)	Time (hours)	Precip. (inches)	Excess (inches)	Runoff (cfs)
0.00	0.00	0.00	0.00	26.00	3.34	0.50	0.00
0.50	0.02	0.00	0.00	26.50	3.34	0.50	0.00
1.00	0.04	0.00	0.00	27.00	3.34	0.50	0.00
1.50	0.06	0.00	0.00	27.50	3.34	0.50	0.00
2.00	0.08	0.00	0.00	28.00	3.34	0.50	0.00
2.50	0.10	0.00	0.00	28.50	3.34	0.50	0.00
3.00	0.12	0.00	0.00	29.00	3.34	0.50	0.00
3.50	0.14	0.00	0.00	29.50	3.34	0.50	0.00
4.00	0.16	0.00	0.00	30.00	3.34	0.50	0.00
4.50	0.19	0.00	0.00	30.50	3.34	0.50	0.00
5.00	0.21	0.00	0.00	31.00	3.34	0.50	0.00
5.50	0.24	0.00	0.00	31.50	3.34	0.50	0.00
6.00	0.26	0.00	0.00	32.00	3.34	0.50	0.00
6.50	0.29	0.00	0.00	32.50	3.34	0.50	0.00
7.00	0.33	0.00	0.00	33.00	3.34	0.50	0.00
7.50	0.36	0.00	0.00	33.50	3.34	0.50	0.00
8.00	0.40	0.00	0.00	34.00	3.34	0.50	0.00
8.50	0.44	0.00	0.00	34.50	3.34	0.50	0.00
9.00	0.49	0.00	0.00	35.00	3.34	0.50	0.00
9.50	0.54	0.00	0.00	35.50	3.34	0.50	0.00
10.00	0.61	0.00	0.00	36.00	3.34	0.50	0.00
10.50	0.69	0.00	0.00				
11.00	0.80	0.00	0.00				
11.50	0.99	0.00	0.00				
12.00	1.59	0.01	0.01				
12.50	2.35	0.15	0.11				
13.00	2.54	0.21	0.06				
13.50	2.65	0.24	0.04				
14.00	2.73	0.27	0.03				
14.50	2.80	0.29	0.03				
15.00	2.85	0.31	0.02				
15.50	2.90	0.33	0.02				
16.00	2.94	0.34	0.02				
16.50	2.98	0.36	0.02				
17.00	3.01	0.37	0.02				
17.50	3.05	0.38	0.01				
18.00	3.08	0.39	0.01				
18.50	3.10	0.40	0.01				
19.00	3.13	0.41	0.01				
19.50	3.15	0.42	0.01				
20.00	3.18	0.43	0.01				
20.50	3.20	0.44	0.01				
21.00	3.22	0.45	0.01				
21.50	3.24	0.46	0.01				
22.00	3.26	0.47	0.01				
22.50	3.28	0.48	0.01				
23.00	3.30	0.49	0.01				
23.50	3.32	0.49	0.01				
24.00	3.34	0.50	0.01				
24.50	3.34	0.50	0.00				
25.00	3.34	0.50	0.00				
25.50	3.34	0.50	0.00				

Summary for Link 3L: Prop SA North

Inflow Area = 1.691 ac, 60.69% Impervious, Inflow Depth = 2.05" for 2-Year event
Inflow = 4.01 cfs @ 12.07 hrs, Volume= 0.289 af
Primary = 4.01 cfs @ 12.07 hrs, Volume= 0.289 af, Atten= 0%, Lag= 0.0 min

Primary outflow = Inflow, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs

Link 3L: Prop SA North

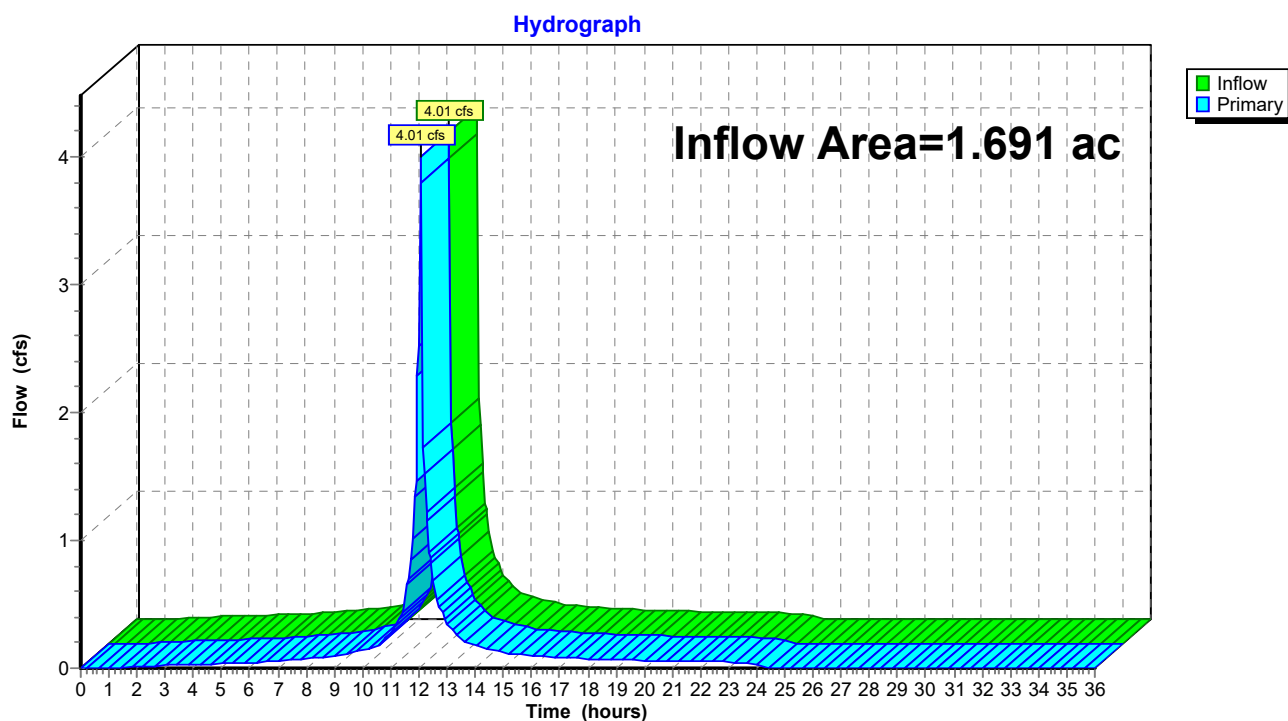

Prop 2 yr, 10 yr, 100 yr - Copy

Prepared by Dynamic Engineering

HydroCAD® 10.20-4b s/n 08640 © 2023 HydroCAD Software Solutions LLC

NOAA 24-hr C 2-Year Rainfall=3.34"

Printed 3/5/2024

Page 31

Hydrograph for Link 3L: Prop SA North


Time (hours)	Inflow (cfs)	Elevation (feet)	Primary (cfs)	Time (hours)	Inflow (cfs)	Elevation (feet)	Primary (cfs)
0.00	0.00	0.00	0.00	26.00	0.00	0.00	0.00
0.50	0.00	0.00	0.00	26.50	0.00	0.00	0.00
1.00	0.00	0.00	0.00	27.00	0.00	0.00	0.00
1.50	0.00	0.00	0.00	27.50	0.00	0.00	0.00
2.00	0.01	0.00	0.01	28.00	0.00	0.00	0.00
2.50	0.02	0.00	0.02	28.50	0.00	0.00	0.00
3.00	0.02	0.00	0.02	29.00	0.00	0.00	0.00
3.50	0.03	0.00	0.03	29.50	0.00	0.00	0.00
4.00	0.03	0.00	0.03	30.00	0.00	0.00	0.00
4.50	0.03	0.00	0.03	30.50	0.00	0.00	0.00
5.00	0.04	0.00	0.04	31.00	0.00	0.00	0.00
5.50	0.04	0.00	0.04	31.50	0.00	0.00	0.00
6.00	0.04	0.00	0.04	32.00	0.00	0.00	0.00
6.50	0.05	0.00	0.05	32.50	0.00	0.00	0.00
7.00	0.06	0.00	0.06	33.00	0.00	0.00	0.00
7.50	0.06	0.00	0.06	33.50	0.00	0.00	0.00
8.00	0.07	0.00	0.07	34.00	0.00	0.00	0.00
8.50	0.08	0.00	0.08	34.50	0.00	0.00	0.00
9.00	0.09	0.00	0.09	35.00	0.00	0.00	0.00
9.50	0.11	0.00	0.11	35.50	0.00	0.00	0.00
10.00	0.14	0.00	0.14	36.00	0.00	0.00	0.00
10.50	0.17	0.00	0.17				
11.00	0.26	0.00	0.26				
11.50	0.46	0.00	0.46				
12.00	2.53	0.00	2.53				
12.50	0.79	0.00	0.79				
13.00	0.37	0.00	0.37				
13.50	0.23	0.00	0.23				
14.00	0.18	0.00	0.18				
14.50	0.15	0.00	0.15				
15.00	0.12	0.00	0.12				
15.50	0.11	0.00	0.11				
16.00	0.10	0.00	0.10				
16.50	0.09	0.00	0.09				
17.00	0.09	0.00	0.09				
17.50	0.08	0.00	0.08				
18.00	0.07	0.00	0.07				
18.50	0.07	0.00	0.07				
19.00	0.06	0.00	0.06				
19.50	0.06	0.00	0.06				
20.00	0.06	0.00	0.06				
20.50	0.06	0.00	0.06				
21.00	0.06	0.00	0.06				
21.50	0.05	0.00	0.05				
22.00	0.05	0.00	0.05				
22.50	0.05	0.00	0.05				
23.00	0.05	0.00	0.05				
23.50	0.05	0.00	0.05				
24.00	0.05	0.00	0.05				
24.50	0.00	0.00	0.00				
25.00	0.00	0.00	0.00				
25.50	0.00	0.00	0.00				

Summary for Link 6L: Prop SA South

Inflow Area = 1.294 ac, 56.51% Impervious, Inflow Depth = 1.97" for 2-Year event
Inflow = 2.96 cfs @ 12.08 hrs, Volume= 0.213 af
Primary = 2.96 cfs @ 12.08 hrs, Volume= 0.213 af, Atten= 0%, Lag= 0.0 min

Primary outflow = Inflow, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs

Link 6L: Prop SA South

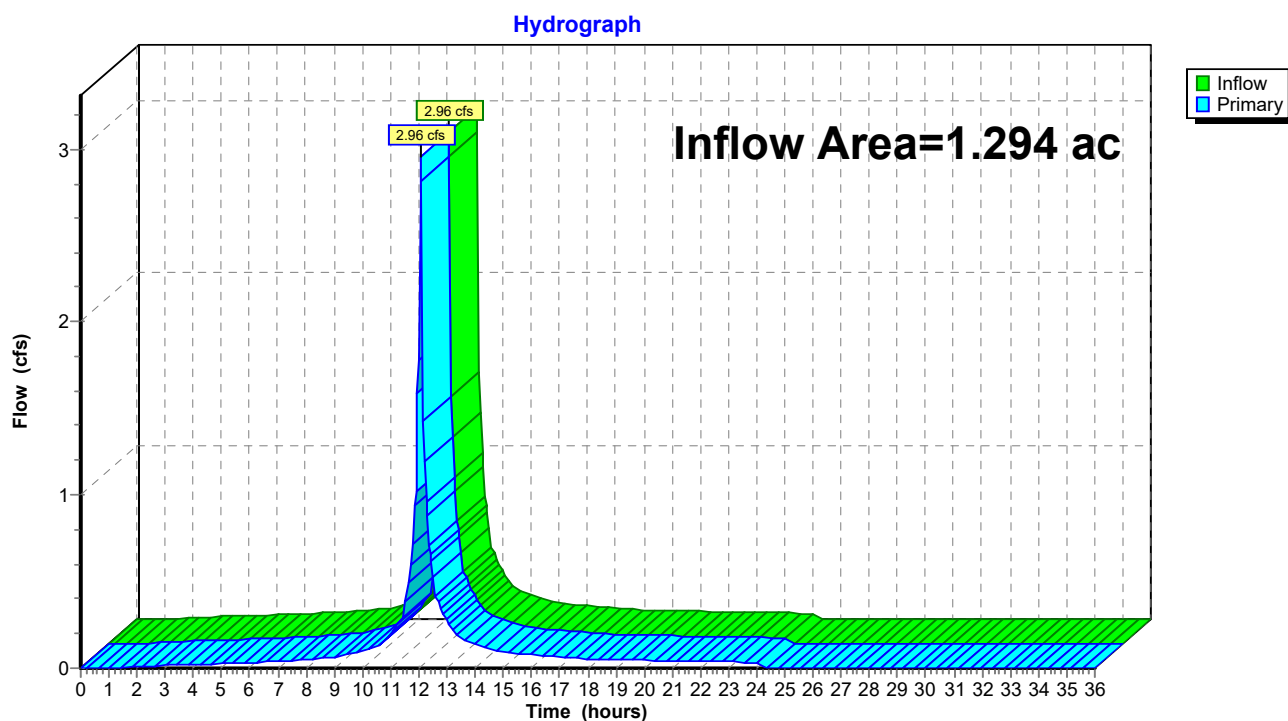

Prop 2 yr, 10 yr, 100 yr - Copy

Prepared by Dynamic Engineering

HydroCAD® 10.20-4b s/n 08640 © 2023 HydroCAD Software Solutions LLC

NOAA 24-hr C 2-Year Rainfall=3.34"

Printed 3/5/2024

Page 33

Hydrograph for Link 6L: Prop SA South

Time (hours)	Inflow (cfs)	Elevation (feet)	Primary (cfs)	Time (hours)	Inflow (cfs)	Elevation (feet)	Primary (cfs)
0.00	0.00	0.00	0.00	26.00	0.00	0.00	0.00
0.50	0.00	0.00	0.00	26.50	0.00	0.00	0.00
1.00	0.00	0.00	0.00	27.00	0.00	0.00	0.00
1.50	0.00	0.00	0.00	27.50	0.00	0.00	0.00
2.00	0.01	0.00	0.01	28.00	0.00	0.00	0.00
2.50	0.01	0.00	0.01	28.50	0.00	0.00	0.00
3.00	0.02	0.00	0.02	29.00	0.00	0.00	0.00
3.50	0.02	0.00	0.02	29.50	0.00	0.00	0.00
4.00	0.02	0.00	0.02	30.00	0.00	0.00	0.00
4.50	0.02	0.00	0.02	30.50	0.00	0.00	0.00
5.00	0.03	0.00	0.03	31.00	0.00	0.00	0.00
5.50	0.03	0.00	0.03	31.50	0.00	0.00	0.00
6.00	0.03	0.00	0.03	32.00	0.00	0.00	0.00
6.50	0.04	0.00	0.04	32.50	0.00	0.00	0.00
7.00	0.04	0.00	0.04	33.00	0.00	0.00	0.00
7.50	0.05	0.00	0.05	33.50	0.00	0.00	0.00
8.00	0.05	0.00	0.05	34.00	0.00	0.00	0.00
8.50	0.06	0.00	0.06	34.50	0.00	0.00	0.00
9.00	0.06	0.00	0.06	35.00	0.00	0.00	0.00
9.50	0.08	0.00	0.08	35.50	0.00	0.00	0.00
10.00	0.10	0.00	0.10	36.00	0.00	0.00	0.00
10.50	0.12	0.00	0.12				
11.00	0.19	0.00	0.19				
11.50	0.32	0.00	0.32				
12.00	1.78	0.00	1.78				
12.50	0.60	0.00	0.60				
13.00	0.28	0.00	0.28				
13.50	0.17	0.00	0.17				
14.00	0.14	0.00	0.14				
14.50	0.12	0.00	0.12				
15.00	0.09	0.00	0.09				
15.50	0.08	0.00	0.08				
16.00	0.08	0.00	0.08				
16.50	0.07	0.00	0.07				
17.00	0.07	0.00	0.07				
17.50	0.06	0.00	0.06				
18.00	0.05	0.00	0.05				
18.50	0.05	0.00	0.05				
19.00	0.05	0.00	0.05				
19.50	0.05	0.00	0.05				
20.00	0.05	0.00	0.05				
20.50	0.04	0.00	0.04				
21.00	0.04	0.00	0.04				
21.50	0.04	0.00	0.04				
22.00	0.04	0.00	0.04				
22.50	0.04	0.00	0.04				
23.00	0.04	0.00	0.04				
23.50	0.03	0.00	0.03				
24.00	0.04	0.00	0.04				
24.50	0.00	0.00	0.00				
25.00	0.00	0.00	0.00				
25.50	0.00	0.00	0.00				

Prop 2 yr, 10 yr, 100 yr - Copy

NOAA 24-hr C 10-Year Rainfall=5.01"

Prepared by Dynamic Engineering

Printed 3/5/2024

HydroCAD® 10.20-4b s/n 08640 © 2023 HydroCAD Software Solutions LLC

Page 34

Time span=0.00-36.00 hrs, dt=0.05 hrs, 721 points
Runoff by SCS TR-20 method, UH=SCS, Weighted-CN
Reach routing by Stor-Ind+Trans method - Pond routing by Stor-Ind method

Subcatchment1S: Prop SA North Imp Runoff Area=44,706 sf 100.00% Impervious Runoff Depth=4.77"
Flow Length=314' Tc=1.6 min CN=98 Runoff=6.01 cfs 0.408 af

Subcatchment2S: Prop SA North Perv Runoff Area=28,953 sf 0.00% Impervious Runoff Depth=1.24"
Flow Length=130' Slope=0.0300 '/' Tc=12.1 min CN=59 Runoff=0.78 cfs 0.069 af

Subcatchment4S: Prop SA South Imp Runoff Area=31,841 sf 100.00% Impervious Runoff Depth=4.77"
Flow Length=225' Tc=1.9 min CN=98 Runoff=4.36 cfs 0.291 af

Subcatchment5S: Prop SA South Perv Runoff Area=24,504 sf 0.00% Impervious Runoff Depth=1.38"
Flow Length=70' Slope=0.0180 '/' Tc=11.0 min CN=61 Runoff=0.78 cfs 0.064 af

Link 3L: Prop SA North Inflow=6.47 cfs 0.477 af
Primary=6.47 cfs 0.477 af

Link 6L: Prop SA South Inflow=4.77 cfs 0.355 af
Primary=4.77 cfs 0.355 af

Total Runoff Area = 2.984 ac Runoff Volume = 0.832 af Average Runoff Depth = 3.35"
41.12% Pervious = 1.227 ac 58.88% Impervious = 1.757 ac

Prop 2 yr, 10 yr, 100 yr - Copy

Prepared by Dynamic Engineering

HydroCAD® 10.20-4b s/n 08640 © 2023 HydroCAD Software Solutions LLC

NOAA 24-hr C 10-Year Rainfall=5.01"

Printed 3/5/2024

Page 35

Summary for Subcatchment 1S: Prop SA North Imp[49] Hint: $T_c < 2dt$ may require smaller dt

Runoff = 6.01 cfs @ 12.07 hrs, Volume= 0.408 af, Depth= 4.77"
Routed to Link 3L : Prop SA North


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, $dt=0.05$ hrs
NOAA 24-hr C 10-Year Rainfall=5.01"

Area (sf)	CN	Description
12,060	98	Paved parking, HSG B
32,646	98	Roofs, HSG B
44,706	98	Weighted Average
44,706		100.00% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
1.2	70	0.0100	0.99		Sheet Flow, Sheet Flow Smooth surfaces $n=0.011$ $P2=3.34"$
0.4	244	0.0200	9.68	11.88	Pipe Channel, Channel Flow 15.0" Round Area= 1.2 sf Perim= 3.9' $r=0.31'$ $n=0.010$ PVC, smooth interior
1.6	314	Total			

Subcatchment 1S: Prop SA North Imp

Hydrograph

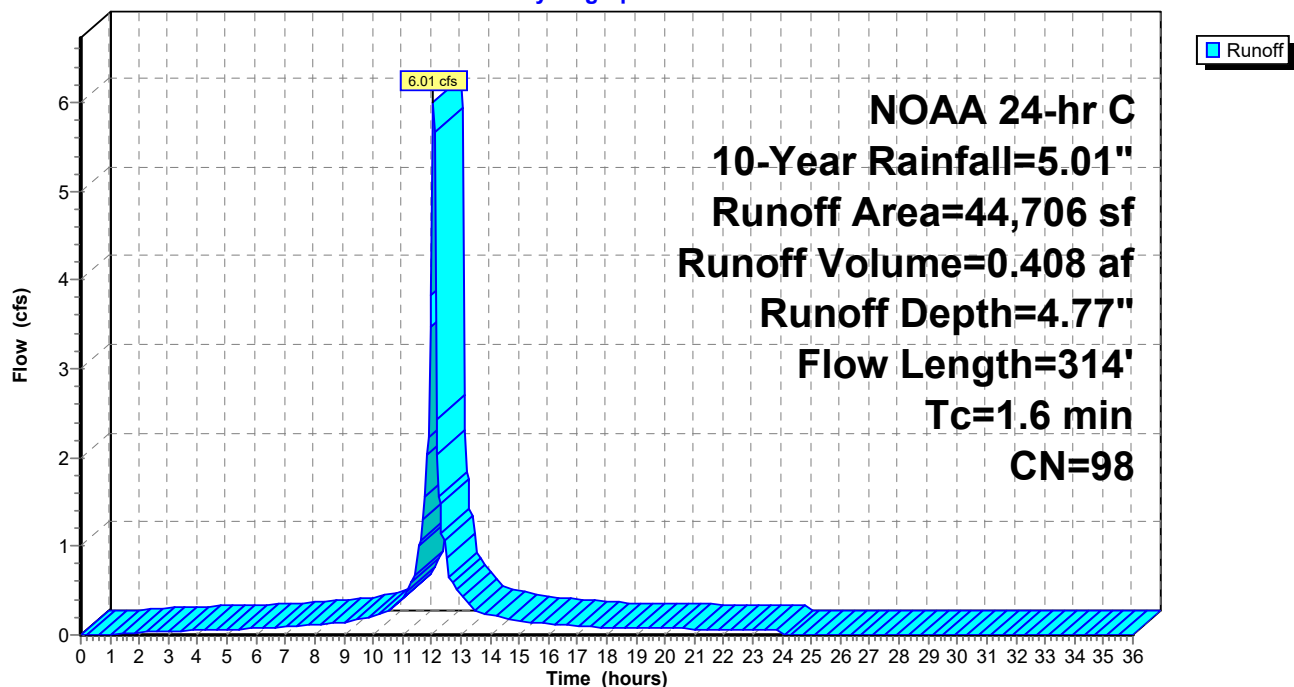

Prop 2 yr, 10 yr, 100 yr - Copy

Prepared by Dynamic Engineering

HydroCAD® 10.20-4b s/n 08640 © 2023 HydroCAD Software Solutions LLC

NOAA 24-hr C 10-Year Rainfall=5.01"

Printed 3/5/2024

Page 36

Hydrograph for Subcatchment 1S: Prop SA North Imp

Time (hours)	Precip. (inches)	Excess (inches)	Runoff (cfs)	Time (hours)	Precip. (inches)	Excess (inches)	Runoff (cfs)
0.00	0.00	0.00	0.00	26.00	5.01	4.77	0.00
0.50	0.03	0.00	0.00	26.50	5.01	4.77	0.00
1.00	0.05	0.00	0.01	27.00	5.01	4.77	0.00
1.50	0.08	0.01	0.02	27.50	5.01	4.77	0.00
2.00	0.11	0.02	0.03	28.00	5.01	4.77	0.00
2.50	0.14	0.03	0.04	28.50	5.01	4.77	0.00
3.00	0.18	0.05	0.04	29.00	5.01	4.77	0.00
3.50	0.21	0.08	0.05	29.50	5.01	4.77	0.00
4.00	0.25	0.10	0.05	30.00	5.01	4.77	0.00
4.50	0.28	0.13	0.06	30.50	5.01	4.77	0.00
5.00	0.32	0.16	0.06	31.00	5.01	4.77	0.00
5.50	0.36	0.19	0.07	31.50	5.01	4.77	0.00
6.00	0.40	0.23	0.07	32.00	5.01	4.77	0.00
6.50	0.44	0.26	0.08	32.50	5.01	4.77	0.00
7.00	0.49	0.31	0.09	33.00	5.01	4.77	0.00
7.50	0.54	0.36	0.11	33.50	5.01	4.77	0.00
8.00	0.60	0.41	0.12	34.00	5.01	4.77	0.00
8.50	0.66	0.47	0.13	34.50	5.01	4.77	0.00
9.00	0.73	0.53	0.14	35.00	5.01	4.77	0.00
9.50	0.81	0.61	0.18	35.50	5.01	4.77	0.00
10.00	0.91	0.71	0.22	36.00	5.01	4.77	0.00
10.50	1.03	0.82	0.26				
11.00	1.20	0.99	0.41				
11.50	1.48	1.26	0.70				
12.00	2.39	2.16	3.82				
12.50	3.53	3.30	1.01				
13.00	3.81	3.57	0.46				
13.50	3.98	3.74	0.29				
14.00	4.10	3.86	0.23				
14.50	4.20	3.96	0.19				
15.00	4.28	4.04	0.15				
15.50	4.35	4.11	0.14				
16.00	4.41	4.17	0.13				
16.50	4.47	4.23	0.12				
17.00	4.52	4.29	0.11				
17.50	4.57	4.33	0.10				
18.00	4.61	4.38	0.09				
18.50	4.65	4.42	0.08				
19.00	4.69	4.46	0.08				
19.50	4.73	4.49	0.08				
20.00	4.76	4.53	0.07				
20.50	4.80	4.56	0.07				
21.00	4.83	4.60	0.07				
21.50	4.87	4.63	0.07				
22.00	4.90	4.66	0.06				
22.50	4.93	4.69	0.06				
23.00	4.96	4.72	0.06				
23.50	4.98	4.75	0.06				
24.00	5.01	4.77	0.06				
24.50	5.01	4.77	0.00				
25.00	5.01	4.77	0.00				
25.50	5.01	4.77	0.00				

Prop 2 yr, 10 yr, 100 yr - Copy

Prepared by Dynamic Engineering

HydroCAD® 10.20-4b s/n 08640 © 2023 HydroCAD Software Solutions LLC

NOAA 24-hr C 10-Year Rainfall=5.01"

Printed 3/5/2024

Page 37

Summary for Subcatchment 2S: Prop SA North Perv

Runoff = 0.78 cfs @ 12.22 hrs, Volume= 0.069 af, Depth= 1.24"

Routed to Link 3L : Prop SA North


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs
NOAA 24-hr C 10-Year Rainfall=5.01"

Area (sf)	CN	Description
7,705	55	Woods, Good, HSG B
21,248	61	>75% Grass cover, Good, HSG B
28,953	59	Weighted Average
28,953		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
11.9	100	0.0300	0.14		Sheet Flow, Sheet Flow Grass: Dense n= 0.240 P2= 3.34"
0.2	30	0.0300	2.79		Shallow Concentrated Flow, Shallow Concentrated Flow Unpaved Kv= 16.1 fps
12.1	130	Total			

Subcatchment 2S: Prop SA North Perv

Hydrograph

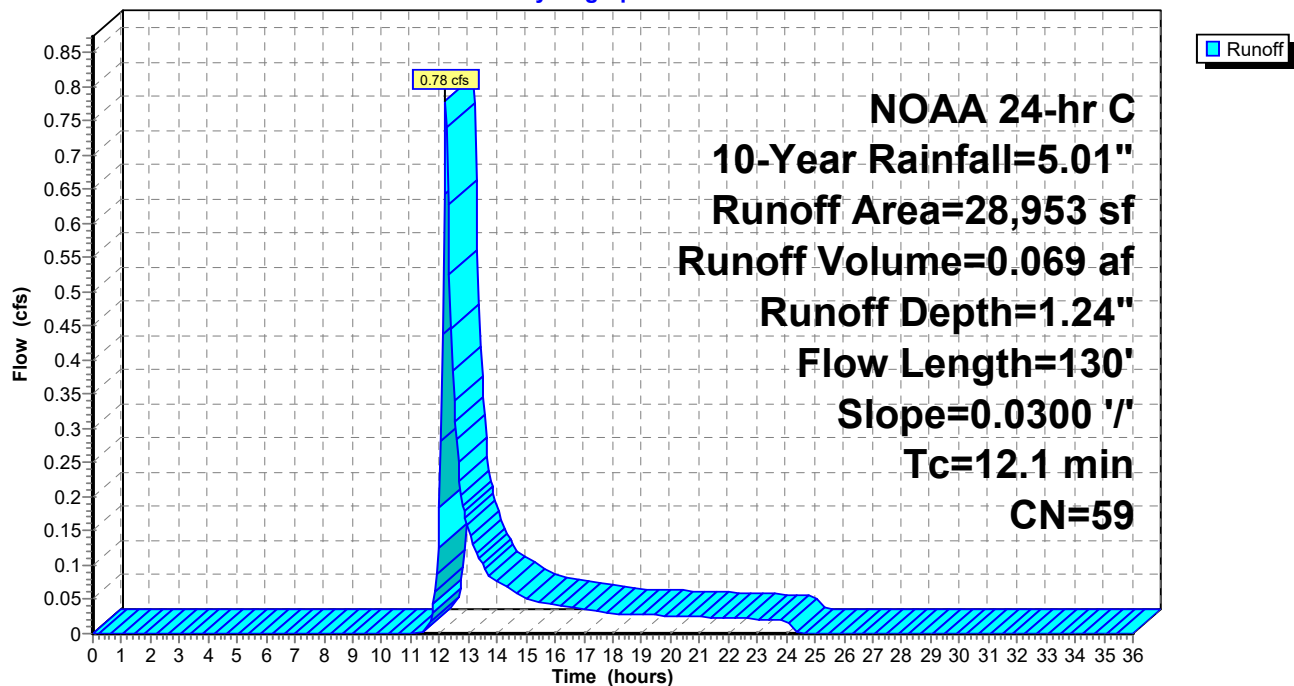

Prop 2 yr, 10 yr, 100 yr - Copy

Prepared by Dynamic Engineering

HydroCAD® 10.20-4b s/n 08640 © 2023 HydroCAD Software Solutions LLC

NOAA 24-hr C 10-Year Rainfall=5.01"

Printed 3/5/2024

Page 38

Hydrograph for Subcatchment 2S: Prop SA North Perv

Time (hours)	Precip. (inches)	Excess (inches)	Runoff (cfs)	Time (hours)	Precip. (inches)	Excess (inches)	Runoff (cfs)
0.00	0.00	0.00	0.00	26.00	5.01	1.24	0.00
0.50	0.03	0.00	0.00	26.50	5.01	1.24	0.00
1.00	0.05	0.00	0.00	27.00	5.01	1.24	0.00
1.50	0.08	0.00	0.00	27.50	5.01	1.24	0.00
2.00	0.11	0.00	0.00	28.00	5.01	1.24	0.00
2.50	0.14	0.00	0.00	28.50	5.01	1.24	0.00
3.00	0.18	0.00	0.00	29.00	5.01	1.24	0.00
3.50	0.21	0.00	0.00	29.50	5.01	1.24	0.00
4.00	0.25	0.00	0.00	30.00	5.01	1.24	0.00
4.50	0.28	0.00	0.00	30.50	5.01	1.24	0.00
5.00	0.32	0.00	0.00	31.00	5.01	1.24	0.00
5.50	0.36	0.00	0.00	31.50	5.01	1.24	0.00
6.00	0.40	0.00	0.00	32.00	5.01	1.24	0.00
6.50	0.44	0.00	0.00	32.50	5.01	1.24	0.00
7.00	0.49	0.00	0.00	33.00	5.01	1.24	0.00
7.50	0.54	0.00	0.00	33.50	5.01	1.24	0.00
8.00	0.60	0.00	0.00	34.00	5.01	1.24	0.00
8.50	0.66	0.00	0.00	34.50	5.01	1.24	0.00
9.00	0.73	0.00	0.00	35.00	5.01	1.24	0.00
9.50	0.81	0.00	0.00	35.50	5.01	1.24	0.00
10.00	0.91	0.00	0.00	36.00	5.01	1.24	0.00
10.50	1.03	0.00	0.00				
11.00	1.20	0.00	0.00				
11.50	1.48	0.00	0.00				
12.00	2.39	0.13	0.18				
12.50	3.53	0.50	0.34				
13.00	3.81	0.62	0.15				
13.50	3.98	0.70	0.10				
14.00	4.10	0.76	0.07				
14.50	4.20	0.81	0.06				
15.00	4.28	0.85	0.05				
15.50	4.35	0.88	0.05				
16.00	4.41	0.91	0.04				
16.50	4.47	0.94	0.04				
17.00	4.52	0.97	0.04				
17.50	4.57	1.00	0.03				
18.00	4.61	1.02	0.03				
18.50	4.65	1.04	0.03				
19.00	4.69	1.06	0.03				
19.50	4.73	1.08	0.03				
20.00	4.76	1.10	0.03				
20.50	4.80	1.12	0.03				
21.00	4.83	1.14	0.02				
21.50	4.87	1.16	0.02				
22.00	4.90	1.18	0.02				
22.50	4.93	1.19	0.02				
23.00	4.96	1.21	0.02				
23.50	4.98	1.22	0.02				
24.00	5.01	1.24	0.02				
24.50	5.01	1.24	0.00				
25.00	5.01	1.24	0.00				
25.50	5.01	1.24	0.00				

Prop 2 yr, 10 yr, 100 yr - Copy

Prepared by Dynamic Engineering

HydroCAD® 10.20-4b s/n 08640 © 2023 HydroCAD Software Solutions LLC

NOAA 24-hr C 10-Year Rainfall=5.01"

Printed 3/5/2024

Page 39

Summary for Subcatchment 4S: Prop SA South Imp[49] Hint: $T_c < 2dt$ may require smaller dt

[47] Hint: Peak is 133% of capacity of segment #2

Runoff = 4.36 cfs @ 12.08 hrs, Volume= 0.291 af, Depth= 4.77"
Routed to Link 6L : Prop SA South


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, $dt=0.05$ hrs
NOAA 24-hr C 10-Year Rainfall=5.01"

Area (sf)	CN	Description
21,220	98	Roofs, HSG B
10,621	98	Paved parking, HSG B
31,841	98	Weighted Average
31,841		100.00% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
1.4	90	0.0100	1.04		Sheet Flow, Sheet Flow Smooth surfaces $n=0.011$ $P2=3.34"$
0.5	135	0.0050	4.17	3.28	Pipe Channel, Pipe Channel Flow B 12.0" Round Area= 0.8 sf Perim= 3.1' $r=0.25'$ $n=0.010$ PVC, smooth interior
1.9	225	Total			

Subcatchment 4S: Prop SA South Imp

Hydrograph

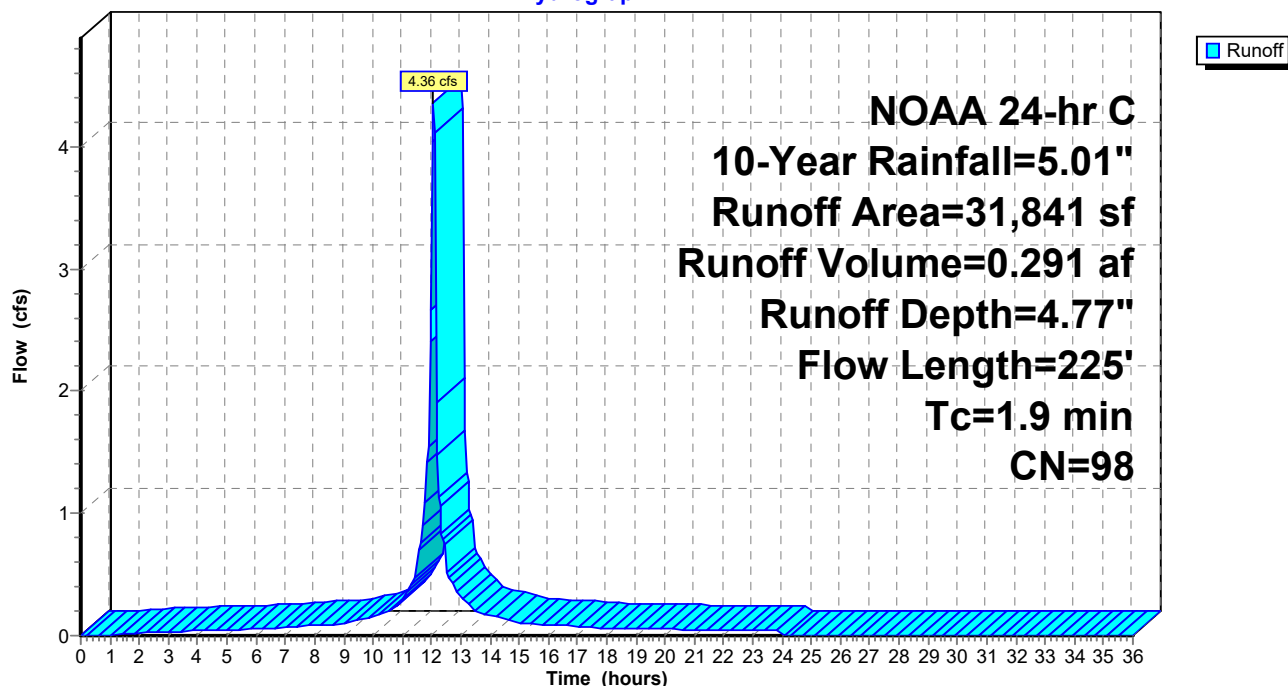

Prop 2 yr, 10 yr, 100 yr - Copy

Prepared by Dynamic Engineering

HydroCAD® 10.20-4b s/n 08640 © 2023 HydroCAD Software Solutions LLC

NOAA 24-hr C 10-Year Rainfall=5.01"

Printed 3/5/2024

Page 40

Hydrograph for Subcatchment 4S: Prop SA South Imp

Time (hours)	Precip. (inches)	Excess (inches)	Runoff (cfs)	Time (hours)	Precip. (inches)	Excess (inches)	Runoff (cfs)
0.00	0.00	0.00	0.00	26.00	5.01	4.77	0.00
0.50	0.03	0.00	0.00	26.50	5.01	4.77	0.00
1.00	0.05	0.00	0.00	27.00	5.01	4.77	0.00
1.50	0.08	0.01	0.01	27.50	5.01	4.77	0.00
2.00	0.11	0.02	0.02	28.00	5.01	4.77	0.00
2.50	0.14	0.03	0.03	28.50	5.01	4.77	0.00
3.00	0.18	0.05	0.03	29.00	5.01	4.77	0.00
3.50	0.21	0.08	0.04	29.50	5.01	4.77	0.00
4.00	0.25	0.10	0.04	30.00	5.01	4.77	0.00
4.50	0.28	0.13	0.04	30.50	5.01	4.77	0.00
5.00	0.32	0.16	0.05	31.00	5.01	4.77	0.00
5.50	0.36	0.19	0.05	31.50	5.01	4.77	0.00
6.00	0.40	0.23	0.05	32.00	5.01	4.77	0.00
6.50	0.44	0.26	0.06	32.50	5.01	4.77	0.00
7.00	0.49	0.31	0.07	33.00	5.01	4.77	0.00
7.50	0.54	0.36	0.07	33.50	5.01	4.77	0.00
8.00	0.60	0.41	0.08	34.00	5.01	4.77	0.00
8.50	0.66	0.47	0.09	34.50	5.01	4.77	0.00
9.00	0.73	0.53	0.10	35.00	5.01	4.77	0.00
9.50	0.81	0.61	0.13	35.50	5.01	4.77	0.00
10.00	0.91	0.71	0.15	36.00	5.01	4.77	0.00
10.50	1.03	0.82	0.18				
11.00	1.20	0.99	0.29				
11.50	1.48	1.26	0.49				
12.00	2.39	2.16	2.67				
12.50	3.53	3.30	0.73				
13.00	3.81	3.57	0.33				
13.50	3.98	3.74	0.21				
14.00	4.10	3.86	0.16				
14.50	4.20	3.96	0.14				
15.00	4.28	4.04	0.11				
15.50	4.35	4.11	0.10				
16.00	4.41	4.17	0.09				
16.50	4.47	4.23	0.08				
17.00	4.52	4.29	0.08				
17.50	4.57	4.33	0.07				
18.00	4.61	4.38	0.06				
18.50	4.65	4.42	0.06				
19.00	4.69	4.46	0.06				
19.50	4.73	4.49	0.05				
20.00	4.76	4.53	0.05				
20.50	4.80	4.56	0.05				
21.00	4.83	4.60	0.05				
21.50	4.87	4.63	0.05				
22.00	4.90	4.66	0.04				
22.50	4.93	4.69	0.04				
23.00	4.96	4.72	0.04				
23.50	4.98	4.75	0.04				
24.00	5.01	4.77	0.04				
24.50	5.01	4.77	0.00				
25.00	5.01	4.77	0.00				
25.50	5.01	4.77	0.00				

Prop 2 yr, 10 yr, 100 yr - Copy

Prepared by Dynamic Engineering

HydroCAD® 10.20-4b s/n 08640 © 2023 HydroCAD Software Solutions LLC

NOAA 24-hr C 10-Year Rainfall=5.01"

Printed 3/5/2024

Page 41

Summary for Subcatchment 5S: Prop SA South Perv

Runoff = 0.78 cfs @ 12.20 hrs, Volume= 0.064 af, Depth= 1.38"
Routed to Link 6L : Prop SA South


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs
NOAA 24-hr C 10-Year Rainfall=5.01"

Area (sf)	CN	Description
971	55	Woods, Good, HSG B
23,533	61	>75% Grass cover, Good, HSG B
24,504	61	Weighted Average
24,504		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
11.0	70	0.0180	0.11		Sheet Flow, Sheet Flow
					Grass: Dense n= 0.240 P2= 3.34"

Subcatchment 5S: Prop SA South Perv

Hydrograph

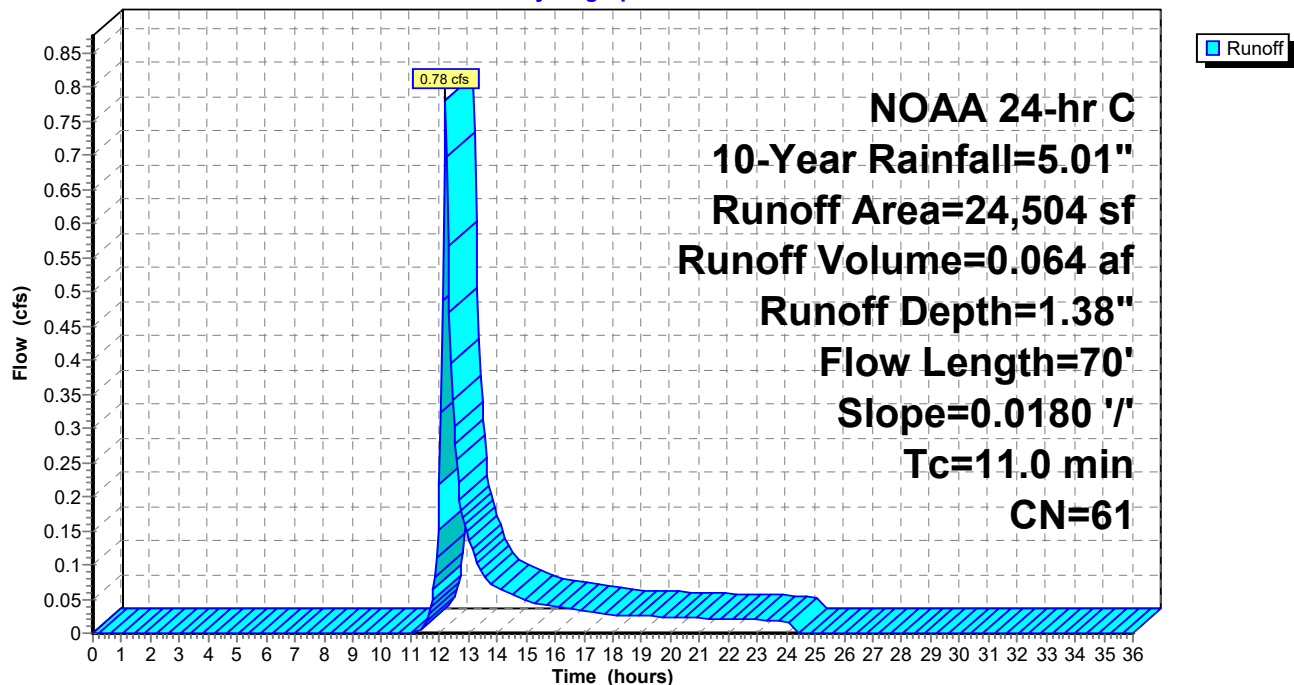

Prop 2 yr, 10 yr, 100 yr - Copy

Prepared by Dynamic Engineering

HydroCAD® 10.20-4b s/n 08640 © 2023 HydroCAD Software Solutions LLC

NOAA 24-hr C 10-Year Rainfall=5.01"

Printed 3/5/2024

Page 42

Hydrograph for Subcatchment 5S: Prop SA South Perv


Time (hours)	Precip. (inches)	Excess (inches)	Runoff (cfs)	Time (hours)	Precip. (inches)	Excess (inches)	Runoff (cfs)
0.00	0.00	0.00	0.00	26.00	5.01	1.38	0.00
0.50	0.03	0.00	0.00	26.50	5.01	1.38	0.00
1.00	0.05	0.00	0.00	27.00	5.01	1.38	0.00
1.50	0.08	0.00	0.00	27.50	5.01	1.38	0.00
2.00	0.11	0.00	0.00	28.00	5.01	1.38	0.00
2.50	0.14	0.00	0.00	28.50	5.01	1.38	0.00
3.00	0.18	0.00	0.00	29.00	5.01	1.38	0.00
3.50	0.21	0.00	0.00	29.50	5.01	1.38	0.00
4.00	0.25	0.00	0.00	30.00	5.01	1.38	0.00
4.50	0.28	0.00	0.00	30.50	5.01	1.38	0.00
5.00	0.32	0.00	0.00	31.00	5.01	1.38	0.00
5.50	0.36	0.00	0.00	31.50	5.01	1.38	0.00
6.00	0.40	0.00	0.00	32.00	5.01	1.38	0.00
6.50	0.44	0.00	0.00	32.50	5.01	1.38	0.00
7.00	0.49	0.00	0.00	33.00	5.01	1.38	0.00
7.50	0.54	0.00	0.00	33.50	5.01	1.38	0.00
8.00	0.60	0.00	0.00	34.00	5.01	1.38	0.00
8.50	0.66	0.00	0.00	34.50	5.01	1.38	0.00
9.00	0.73	0.00	0.00	35.00	5.01	1.38	0.00
9.50	0.81	0.00	0.00	35.50	5.01	1.38	0.00
10.00	0.91	0.00	0.00	36.00	5.01	1.38	0.00
10.50	1.03	0.00	0.00				
11.00	1.20	0.00	0.00				
11.50	1.48	0.01	0.01				
12.00	2.39	0.16	0.22				
12.50	3.53	0.59	0.30				
13.00	3.81	0.72	0.14				
13.50	3.98	0.80	0.09				
14.00	4.10	0.86	0.07				
14.50	4.20	0.91	0.06				
15.00	4.28	0.96	0.05				
15.50	4.35	0.99	0.04				
16.00	4.41	1.03	0.04				
16.50	4.47	1.06	0.04				
17.00	4.52	1.09	0.03				
17.50	4.57	1.12	0.03				
18.00	4.61	1.14	0.03				
18.50	4.65	1.17	0.03				
19.00	4.69	1.19	0.02				
19.50	4.73	1.21	0.02				
20.00	4.76	1.23	0.02				
20.50	4.80	1.25	0.02				
21.00	4.83	1.27	0.02				
21.50	4.87	1.29	0.02				
22.00	4.90	1.31	0.02				
22.50	4.93	1.33	0.02				
23.00	4.96	1.34	0.02				
23.50	4.98	1.36	0.02				
24.00	5.01	1.38	0.02				
24.50	5.01	1.38	0.00				
25.00	5.01	1.38	0.00				
25.50	5.01	1.38	0.00				

Summary for Link 3L: Prop SA North

Inflow Area = 1.691 ac, 60.69% Impervious, Inflow Depth = 3.38" for 10-Year event
Inflow = 6.47 cfs @ 12.08 hrs, Volume= 0.477 af
Primary = 6.47 cfs @ 12.08 hrs, Volume= 0.477 af, Atten= 0%, Lag= 0.0 min

Primary outflow = Inflow, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs

Link 3L: Prop SA North

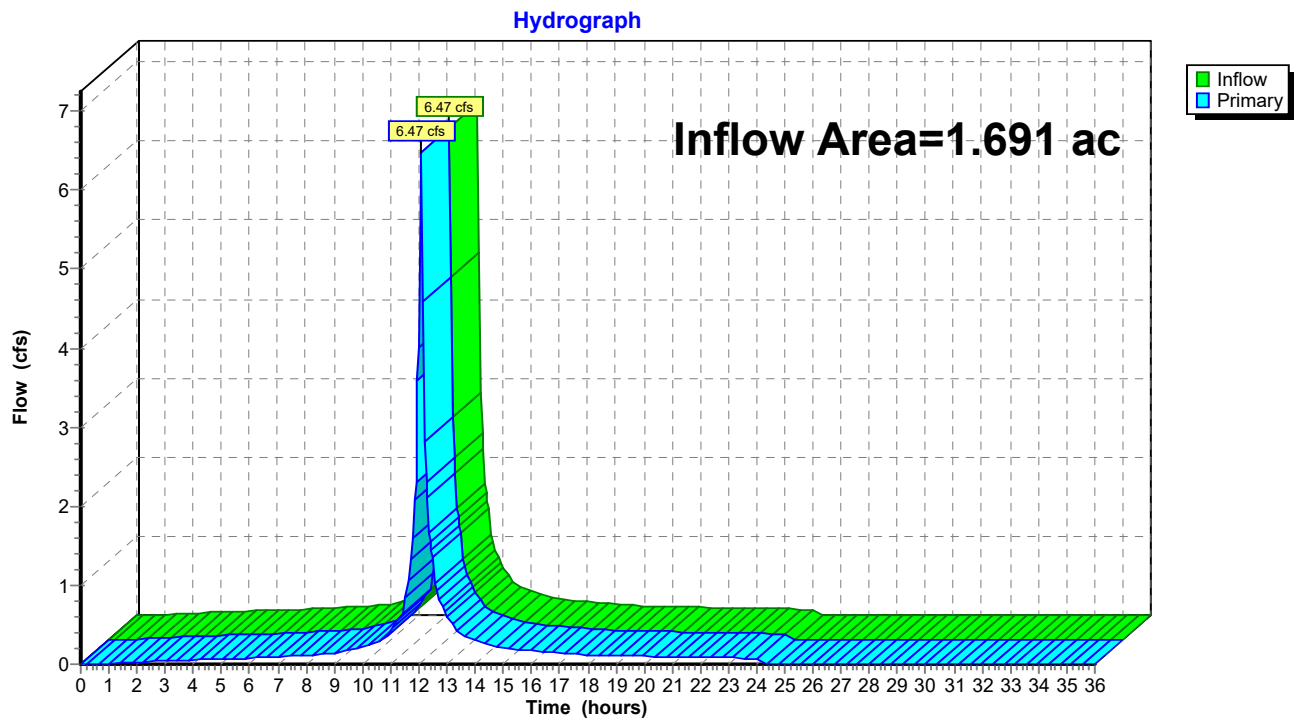

Prop 2 yr, 10 yr, 100 yr - Copy

Prepared by Dynamic Engineering

HydroCAD® 10.20-4b s/n 08640 © 2023 HydroCAD Software Solutions LLC

NOAA 24-hr C 10-Year Rainfall=5.01"

Printed 3/5/2024

Page 44


Hydrograph for Link 3L: Prop SA North

Time (hours)	Inflow (cfs)	Elevation (feet)	Primary (cfs)	Time (hours)	Inflow (cfs)	Elevation (feet)	Primary (cfs)
0.00	0.00	0.00	0.00	26.00	0.00	0.00	0.00
0.50	0.00	0.00	0.00	26.50	0.00	0.00	0.00
1.00	0.01	0.00	0.01	27.00	0.00	0.00	0.00
1.50	0.02	0.00	0.02	27.50	0.00	0.00	0.00
2.00	0.03	0.00	0.03	28.00	0.00	0.00	0.00
2.50	0.04	0.00	0.04	28.50	0.00	0.00	0.00
3.00	0.04	0.00	0.04	29.00	0.00	0.00	0.00
3.50	0.05	0.00	0.05	29.50	0.00	0.00	0.00
4.00	0.05	0.00	0.05	30.00	0.00	0.00	0.00
4.50	0.06	0.00	0.06	30.50	0.00	0.00	0.00
5.00	0.06	0.00	0.06	31.00	0.00	0.00	0.00
5.50	0.07	0.00	0.07	31.50	0.00	0.00	0.00
6.00	0.07	0.00	0.07	32.00	0.00	0.00	0.00
6.50	0.08	0.00	0.08	32.50	0.00	0.00	0.00
7.00	0.09	0.00	0.09	33.00	0.00	0.00	0.00
7.50	0.11	0.00	0.11	33.50	0.00	0.00	0.00
8.00	0.12	0.00	0.12	34.00	0.00	0.00	0.00
8.50	0.13	0.00	0.13	34.50	0.00	0.00	0.00
9.00	0.14	0.00	0.14	35.00	0.00	0.00	0.00
9.50	0.18	0.00	0.18	35.50	0.00	0.00	0.00
10.00	0.22	0.00	0.22	36.00	0.00	0.00	0.00
10.50	0.26	0.00	0.26				
11.00	0.41	0.00	0.41				
11.50	0.70	0.00	0.70				
12.00	4.01	0.00	4.01				
12.50	1.35	0.00	1.35				
13.00	0.61	0.00	0.61				
13.50	0.39	0.00	0.39				
14.00	0.30	0.00	0.30				
14.50	0.26	0.00	0.26				
15.00	0.20	0.00	0.20				
15.50	0.18	0.00	0.18				
16.00	0.17	0.00	0.17				
16.50	0.16	0.00	0.16				
17.00	0.14	0.00	0.14				
17.50	0.13	0.00	0.13				
18.00	0.12	0.00	0.12				
18.50	0.11	0.00	0.11				
19.00	0.11	0.00	0.11				
19.50	0.10	0.00	0.10				
20.00	0.10	0.00	0.10				
20.50	0.10	0.00	0.10				
21.00	0.09	0.00	0.09				
21.50	0.09	0.00	0.09				
22.00	0.09	0.00	0.09				
22.50	0.08	0.00	0.08				
23.00	0.08	0.00	0.08				
23.50	0.08	0.00	0.08				
24.00	0.08	0.00	0.08				
24.50	0.00	0.00	0.00				
25.00	0.00	0.00	0.00				
25.50	0.00	0.00	0.00				

Summary for Link 6L: Prop SA South

Inflow Area = 1.294 ac, 56.51% Impervious, Inflow Depth = 3.30" for 10-Year event
Inflow = 4.77 cfs @ 12.08 hrs, Volume= 0.355 af
Primary = 4.77 cfs @ 12.08 hrs, Volume= 0.355 af, Atten= 0%, Lag= 0.0 min

Primary outflow = Inflow, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs

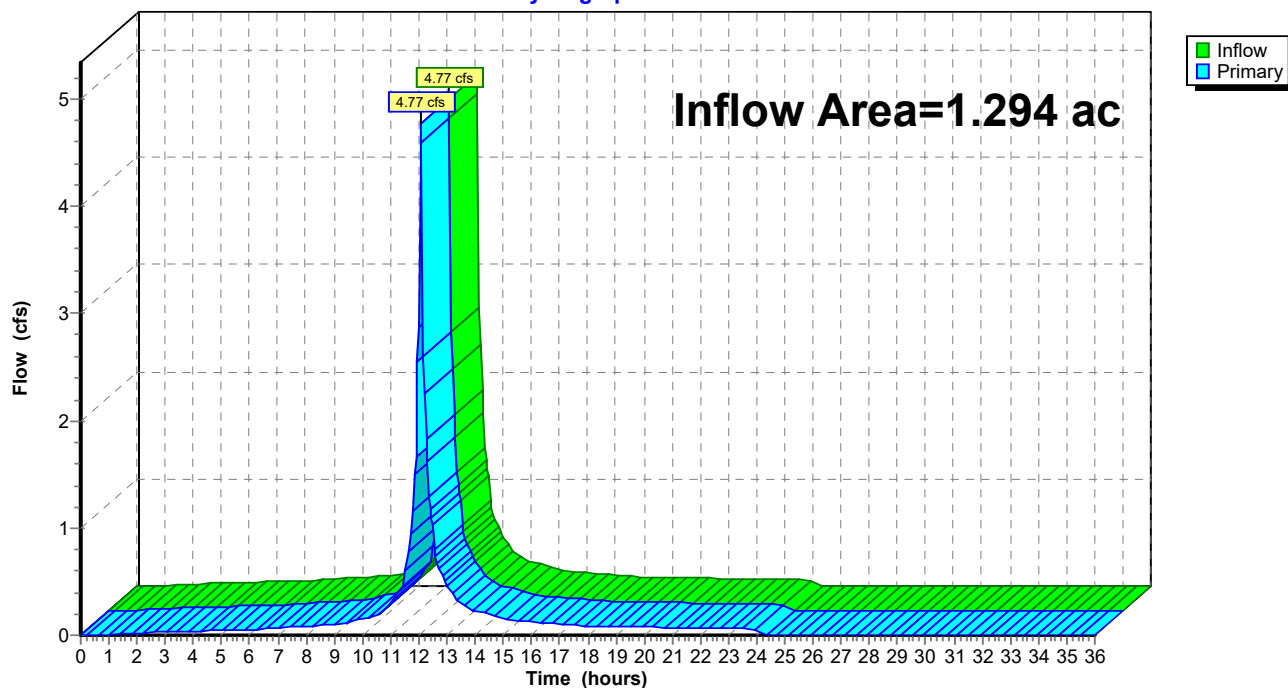Link 6L: Prop SA South**Hydrograph**

Prop 2 yr, 10 yr, 100 yr - Copy

Prepared by Dynamic Engineering

HydroCAD® 10.20-4b s/n 08640 © 2023 HydroCAD Software Solutions LLC

NOAA 24-hr C 10-Year Rainfall=5.01"

Printed 3/5/2024

Page 46

Hydrograph for Link 6L: Prop SA South

Time (hours)	Inflow (cfs)	Elevation (feet)	Primary (cfs)	Time (hours)	Inflow (cfs)	Elevation (feet)	Primary (cfs)
0.00	0.00	0.00	0.00	26.00	0.00	0.00	0.00
0.50	0.00	0.00	0.00	26.50	0.00	0.00	0.00
1.00	0.00	0.00	0.00	27.00	0.00	0.00	0.00
1.50	0.01	0.00	0.01	27.50	0.00	0.00	0.00
2.00	0.02	0.00	0.02	28.00	0.00	0.00	0.00
2.50	0.03	0.00	0.03	28.50	0.00	0.00	0.00
3.00	0.03	0.00	0.03	29.00	0.00	0.00	0.00
3.50	0.04	0.00	0.04	29.50	0.00	0.00	0.00
4.00	0.04	0.00	0.04	30.00	0.00	0.00	0.00
4.50	0.04	0.00	0.04	30.50	0.00	0.00	0.00
5.00	0.05	0.00	0.05	31.00	0.00	0.00	0.00
5.50	0.05	0.00	0.05	31.50	0.00	0.00	0.00
6.00	0.05	0.00	0.05	32.00	0.00	0.00	0.00
6.50	0.06	0.00	0.06	32.50	0.00	0.00	0.00
7.00	0.07	0.00	0.07	33.00	0.00	0.00	0.00
7.50	0.07	0.00	0.07	33.50	0.00	0.00	0.00
8.00	0.08	0.00	0.08	34.00	0.00	0.00	0.00
8.50	0.09	0.00	0.09	34.50	0.00	0.00	0.00
9.00	0.10	0.00	0.10	35.00	0.00	0.00	0.00
9.50	0.13	0.00	0.13	35.50	0.00	0.00	0.00
10.00	0.15	0.00	0.15	36.00	0.00	0.00	0.00
10.50	0.18	0.00	0.18				
11.00	0.29	0.00	0.29				
11.50	0.50	0.00	0.50				
12.00	2.88	0.00	2.88				
12.50	1.03	0.00	1.03				
13.00	0.47	0.00	0.47				
13.50	0.30	0.00	0.30				
14.00	0.23	0.00	0.23				
14.50	0.19	0.00	0.19				
15.00	0.16	0.00	0.16				
15.50	0.14	0.00	0.14				
16.00	0.13	0.00	0.13				
16.50	0.12	0.00	0.12				
17.00	0.11	0.00	0.11				
17.50	0.10	0.00	0.10				
18.00	0.09	0.00	0.09				
18.50	0.08	0.00	0.08				
19.00	0.08	0.00	0.08				
19.50	0.08	0.00	0.08				
20.00	0.08	0.00	0.08				
20.50	0.07	0.00	0.07				
21.00	0.07	0.00	0.07				
21.50	0.07	0.00	0.07				
22.00	0.07	0.00	0.07				
22.50	0.06	0.00	0.06				
23.00	0.06	0.00	0.06				
23.50	0.06	0.00	0.06				
24.00	0.06	0.00	0.06				
24.50	0.00	0.00	0.00				
25.00	0.00	0.00	0.00				
25.50	0.00	0.00	0.00				

Prop 2 yr, 10 yr, 100 yr - Copy

NOAA 24-hr C 100-Year Rainfall=8.21"

Prepared by Dynamic Engineering

Printed 3/5/2024

HydroCAD® 10.20-4b s/n 08640 © 2023 HydroCAD Software Solutions LLC

Page 47

Time span=0.00-36.00 hrs, dt=0.05 hrs, 721 points
Runoff by SCS TR-20 method, UH=SCS, Weighted-CN
Reach routing by Stor-Ind+Trans method - Pond routing by Stor-Ind method

Subcatchment1S: Prop SA North Imp Runoff Area=44,706 sf 100.00% Impervious Runoff Depth=7.97"
Flow Length=314' Tc=1.6 min CN=98 Runoff=9.87 cfs 0.682 af

Subcatchment2S: Prop SA North Perv Runoff Area=28,953 sf 0.00% Impervious Runoff Depth=3.38"
Flow Length=130' Slope=0.0300 '/' Tc=12.1 min CN=59 Runoff=2.33 cfs 0.187 af

Subcatchment4S: Prop SA South Imp Runoff Area=31,841 sf 100.00% Impervious Runoff Depth=7.97"
Flow Length=225' Tc=1.9 min CN=98 Runoff=7.17 cfs 0.485 af

Subcatchment5S: Prop SA South Perv Runoff Area=24,504 sf 0.00% Impervious Runoff Depth=3.61"
Flow Length=70' Slope=0.0180 '/' Tc=11.0 min CN=61 Runoff=2.18 cfs 0.169 af

Link 3L: Prop SA North Inflow=11.35 cfs 0.869 af
Primary=11.35 cfs 0.869 af

Link 6L: Prop SA South Inflow=8.51 cfs 0.655 af
Primary=8.51 cfs 0.655 af

Total Runoff Area = 2.984 ac Runoff Volume = 1.523 af Average Runoff Depth = 6.12"
41.12% Pervious = 1.227 ac 58.88% Impervious = 1.757 ac

Prop 2 yr, 10 yr, 100 yr - Copy

Prepared by Dynamic Engineering

HydroCAD® 10.20-4b s/n 08640 © 2023 HydroCAD Software Solutions LLC

NOAA 24-hr C 100-Year Rainfall=8.21"

Printed 3/5/2024

Page 48

Summary for Subcatchment 1S: Prop SA North Imp[49] Hint: $T_c < 2dt$ may require smaller dt

Runoff = 9.87 cfs @ 12.07 hrs, Volume= 0.682 af, Depth= 7.97"
Routed to Link 3L : Prop SA North


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, $dt=0.05$ hrs
NOAA 24-hr C 100-Year Rainfall=8.21"

Area (sf)	CN	Description
12,060	98	Paved parking, HSG B
32,646	98	Roofs, HSG B
44,706	98	Weighted Average
44,706		100.00% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
1.2	70	0.0100	0.99		Sheet Flow, Sheet Flow Smooth surfaces $n=0.011$ $P2=3.34"$
0.4	244	0.0200	9.68	11.88	Pipe Channel, Channel Flow 15.0" Round Area= 1.2 sf Perim= 3.9' $r=0.31'$ $n=0.010$ PVC, smooth interior
1.6	314	Total			

Subcatchment 1S: Prop SA North Imp

Hydrograph

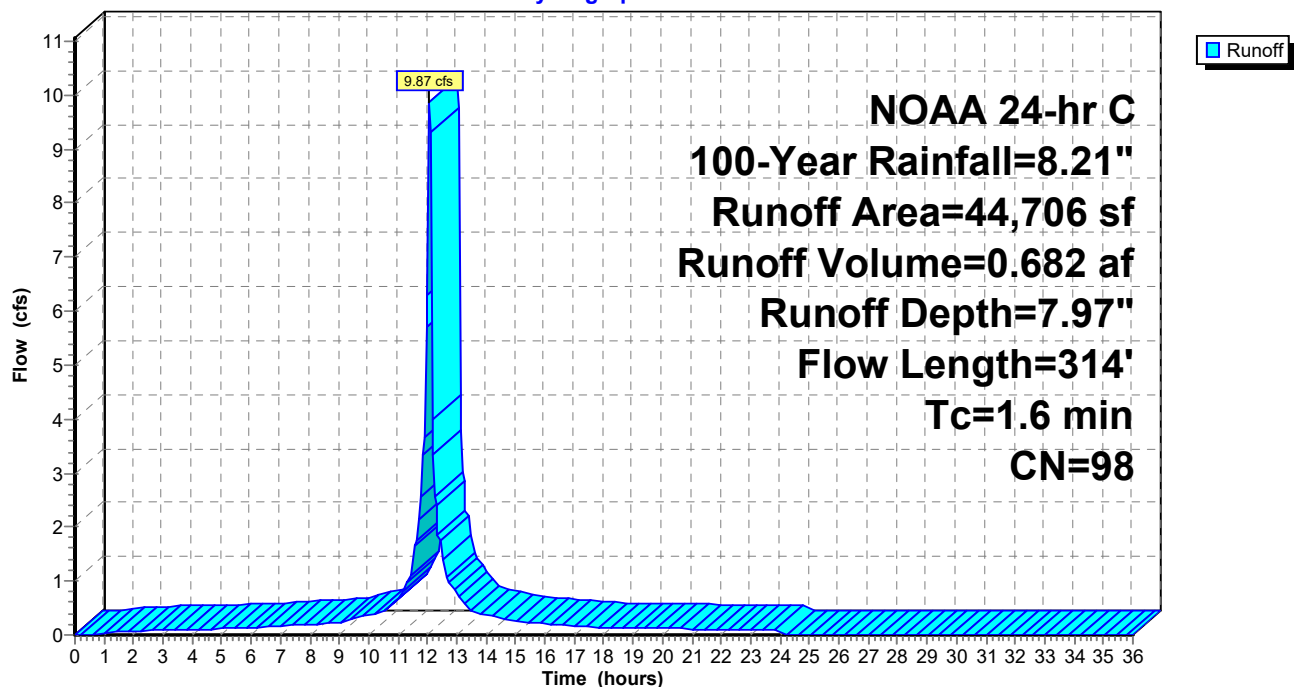

Prop 2 yr, 10 yr, 100 yr - Copy

Prepared by Dynamic Engineering

HydroCAD® 10.20-4b s/n 08640 © 2023 HydroCAD Software Solutions LLC

NOAA 24-hr C 100-Year Rainfall=8.21"

Printed 3/5/2024

Page 49

Hydrograph for Subcatchment 1S: Prop SA North Imp

Time (hours)	Precip. (inches)	Excess (inches)	Runoff (cfs)	Time (hours)	Precip. (inches)	Excess (inches)	Runoff (cfs)
0.00	0.00	0.00	0.00	26.00	8.21	7.97	0.00
0.50	0.04	0.00	0.00	26.50	8.21	7.97	0.00
1.00	0.09	0.01	0.03	27.00	8.21	7.97	0.00
1.50	0.14	0.03	0.05	27.50	8.21	7.97	0.00
2.00	0.19	0.06	0.07	28.00	8.21	7.97	0.00
2.50	0.24	0.10	0.08	28.50	8.21	7.97	0.00
3.00	0.29	0.14	0.09	29.00	8.21	7.97	0.00
3.50	0.34	0.18	0.10	29.50	8.21	7.97	0.00
4.00	0.40	0.23	0.10	30.00	8.21	7.97	0.00
4.50	0.46	0.28	0.11	30.50	8.21	7.97	0.00
5.00	0.52	0.34	0.12	31.00	8.21	7.97	0.00
5.50	0.59	0.40	0.12	31.50	8.21	7.97	0.00
6.00	0.65	0.46	0.13	32.00	8.21	7.97	0.00
6.50	0.72	0.52	0.15	32.50	8.21	7.97	0.00
7.00	0.80	0.60	0.16	33.00	8.21	7.97	0.00
7.50	0.89	0.68	0.18	33.50	8.21	7.97	0.00
8.00	0.98	0.78	0.20	34.00	8.21	7.97	0.00
8.50	1.09	0.88	0.22	34.50	8.21	7.97	0.00
9.00	1.20	0.98	0.23	35.00	8.21	7.97	0.00
9.50	1.33	1.12	0.30	35.50	8.21	7.97	0.00
10.00	1.50	1.28	0.36	36.00	8.21	7.97	0.00
10.50	1.69	1.47	0.43				
11.00	1.97	1.74	0.68				
11.50	2.43	2.20	1.16				
12.00	3.91	3.68	6.29				
12.50	5.78	5.55	1.66				
13.00	6.24	6.00	0.76				
13.50	6.52	6.28	0.47				
14.00	6.71	6.47	0.38				
14.50	6.88	6.64	0.31				
15.00	7.01	6.77	0.25				
15.50	7.12	6.88	0.22				
16.00	7.23	6.99	0.21				
16.50	7.32	7.08	0.19				
17.00	7.41	7.17	0.17				
17.50	7.49	7.25	0.16				
18.00	7.56	7.32	0.14				
18.50	7.62	7.39	0.13				
19.00	7.69	7.45	0.13				
19.50	7.75	7.51	0.12				
20.00	7.81	7.57	0.12				
20.50	7.87	7.63	0.12				
21.00	7.92	7.68	0.11				
21.50	7.97	7.73	0.11				
22.00	8.02	7.78	0.10				
22.50	8.07	7.83	0.10				
23.00	8.12	7.88	0.10				
23.50	8.17	7.93	0.09				
24.00	8.21	7.97	0.10				
24.50	8.21	7.97	0.00				
25.00	8.21	7.97	0.00				
25.50	8.21	7.97	0.00				

Prop 2 yr, 10 yr, 100 yr - Copy

Prepared by Dynamic Engineering

HydroCAD® 10.20-4b s/n 08640 © 2023 HydroCAD Software Solutions LLC

NOAA 24-hr C 100-Year Rainfall=8.21"

Printed 3/5/2024

Page 50


Summary for Subcatchment 2S: Prop SA North Perv

Runoff = 2.33 cfs @ 12.21 hrs, Volume= 0.187 af, Depth= 3.38"
Routed to Link 3L : Prop SA North

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs
NOAA 24-hr C 100-Year Rainfall=8.21"

Area (sf)	CN	Description
7,705	55	Woods, Good, HSG B
21,248	61	>75% Grass cover, Good, HSG B
28,953	59	Weighted Average
28,953		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
11.9	100	0.0300	0.14		Sheet Flow, Sheet Flow Grass: Dense n= 0.240 P2= 3.34"
0.2	30	0.0300	2.79		Shallow Concentrated Flow, Shallow Concentrated Flow Unpaved Kv= 16.1 fps
12.1	130	Total			

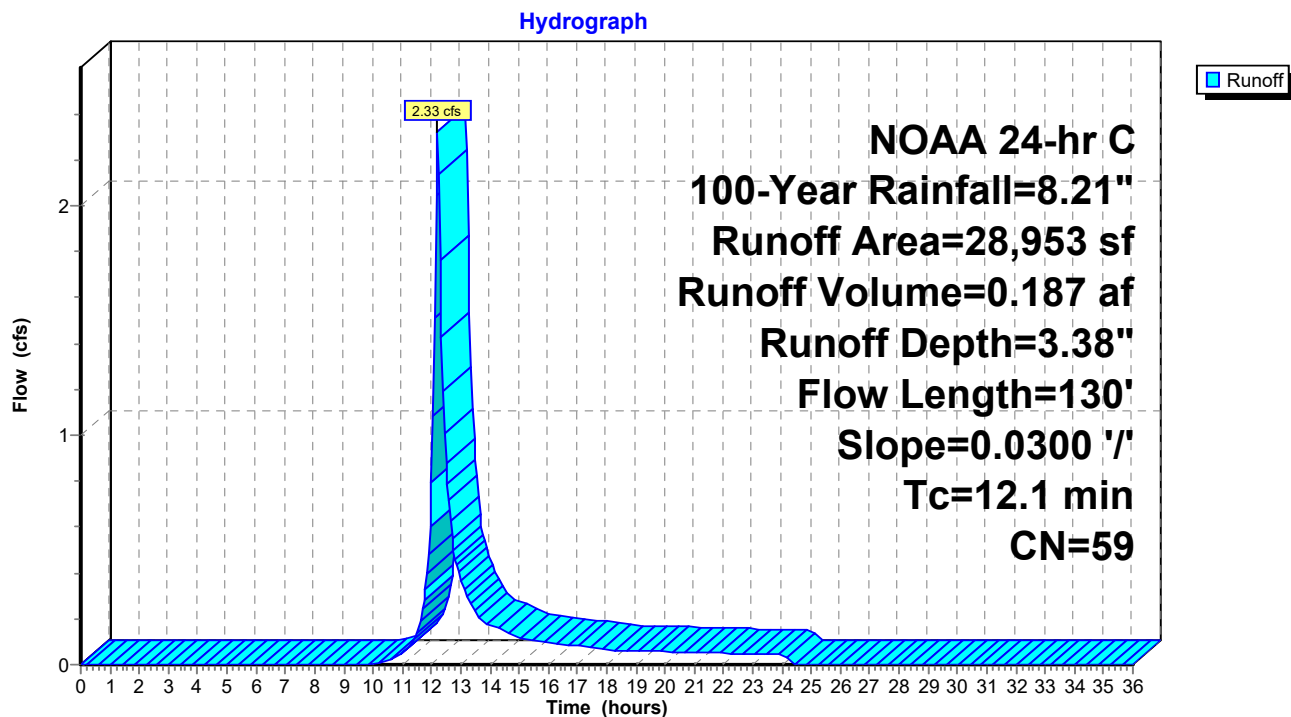Subcatchment 2S: Prop SA North Perv

Prop 2 yr, 10 yr, 100 yr - Copy

Prepared by Dynamic Engineering

HydroCAD® 10.20-4b s/n 08640 © 2023 HydroCAD Software Solutions LLC

NOAA 24-hr C 100-Year Rainfall=8.21"

Printed 3/5/2024

Page 51

Hydrograph for Subcatchment 2S: Prop SA North Perv

Time (hours)	Precip. (inches)	Excess (inches)	Runoff (cfs)	Time (hours)	Precip. (inches)	Excess (inches)	Runoff (cfs)
0.00	0.00	0.00	0.00	26.00	8.21	3.38	0.00
0.50	0.04	0.00	0.00	26.50	8.21	3.38	0.00
1.00	0.09	0.00	0.00	27.00	8.21	3.38	0.00
1.50	0.14	0.00	0.00	27.50	8.21	3.38	0.00
2.00	0.19	0.00	0.00	28.00	8.21	3.38	0.00
2.50	0.24	0.00	0.00	28.50	8.21	3.38	0.00
3.00	0.29	0.00	0.00	29.00	8.21	3.38	0.00
3.50	0.34	0.00	0.00	29.50	8.21	3.38	0.00
4.00	0.40	0.00	0.00	30.00	8.21	3.38	0.00
4.50	0.46	0.00	0.00	30.50	8.21	3.38	0.00
5.00	0.52	0.00	0.00	31.00	8.21	3.38	0.00
5.50	0.59	0.00	0.00	31.50	8.21	3.38	0.00
6.00	0.65	0.00	0.00	32.00	8.21	3.38	0.00
6.50	0.72	0.00	0.00	32.50	8.21	3.38	0.00
7.00	0.80	0.00	0.00	33.00	8.21	3.38	0.00
7.50	0.89	0.00	0.00	33.50	8.21	3.38	0.00
8.00	0.98	0.00	0.00	34.00	8.21	3.38	0.00
8.50	1.09	0.00	0.00	34.50	8.21	3.38	0.00
9.00	1.20	0.00	0.00	35.00	8.21	3.38	0.00
9.50	1.33	0.00	0.00	35.50	8.21	3.38	0.00
10.00	1.50	0.00	0.00	36.00	8.21	3.38	0.00
10.50	1.69	0.01	0.02				
11.00	1.97	0.04	0.05				
11.50	2.43	0.13	0.13				
12.00	3.91	0.67	0.79				
12.50	5.78	1.70	0.88				
13.00	6.24	1.99	0.37				
13.50	6.52	2.18	0.23				
14.00	6.71	2.31	0.17				
14.50	6.88	2.42	0.15				
15.00	7.01	2.51	0.12				
15.50	7.12	2.59	0.10				
16.00	7.23	2.66	0.10				
16.50	7.32	2.73	0.09				
17.00	7.41	2.79	0.08				
17.50	7.49	2.85	0.07				
18.00	7.56	2.90	0.07				
18.50	7.62	2.95	0.06				
19.00	7.69	2.99	0.06				
19.50	7.75	3.04	0.06				
20.00	7.81	3.08	0.06				
20.50	7.87	3.12	0.06				
21.00	7.92	3.16	0.05				
21.50	7.97	3.20	0.05				
22.00	8.02	3.24	0.05				
22.50	8.07	3.28	0.05				
23.00	8.12	3.31	0.05				
23.50	8.17	3.34	0.04				
24.00	8.21	3.38	0.04				
24.50	8.21	3.38	0.00				
25.00	8.21	3.38	0.00				
25.50	8.21	3.38	0.00				

Prop 2 yr, 10 yr, 100 yr - Copy

Prepared by Dynamic Engineering

HydroCAD® 10.20-4b s/n 08640 © 2023 HydroCAD Software Solutions LLC

NOAA 24-hr C 100-Year Rainfall=8.21"

Printed 3/5/2024

Page 52

Summary for Subcatchment 4S: Prop SA South Imp[49] Hint: $T_c < 2dt$ may require smaller dt

[47] Hint: Peak is 219% of capacity of segment #2

Runoff = 7.17 cfs @ 12.08 hrs, Volume= 0.485 af, Depth= 7.97"
Routed to Link 6L : Prop SA South


Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, $dt=0.05$ hrs
NOAA 24-hr C 100-Year Rainfall=8.21"

Area (sf)	CN	Description
21,220	98	Roofs, HSG B
10,621	98	Paved parking, HSG B
31,841	98	Weighted Average
31,841		100.00% Impervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
1.4	90	0.0100	1.04		Sheet Flow, Sheet Flow Smooth surfaces $n=0.011$ $P2=3.34"$
0.5	135	0.0050	4.17	3.28	Pipe Channel, Pipe Channel Flow B 12.0" Round Area= 0.8 sf Perim= 3.1' $r=0.25'$ $n=0.010$ PVC, smooth interior
1.9	225	Total			

Subcatchment 4S: Prop SA South Imp

Hydrograph

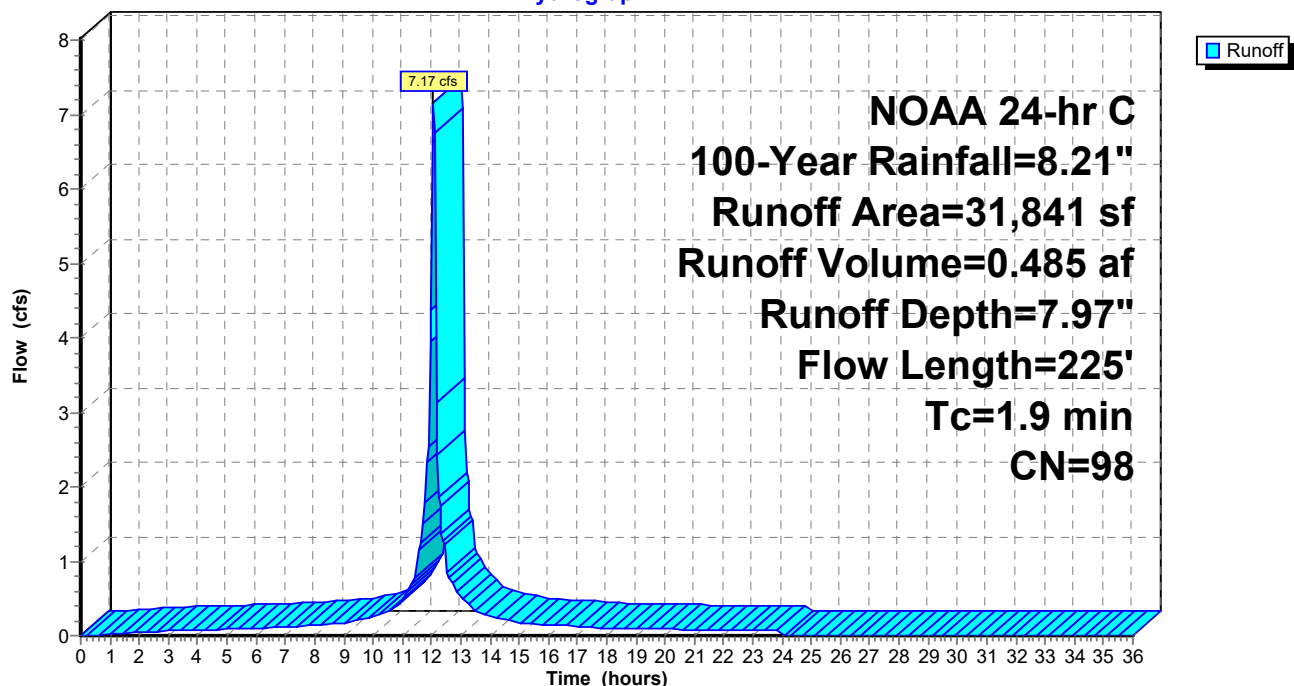

Prop 2 yr, 10 yr, 100 yr - Copy

Prepared by Dynamic Engineering

HydroCAD® 10.20-4b s/n 08640 © 2023 HydroCAD Software Solutions LLC

NOAA 24-hr C 100-Year Rainfall=8.21"

Printed 3/5/2024

Page 53

Hydrograph for Subcatchment 4S: Prop SA South Imp

Time (hours)	Precip. (inches)	Excess (inches)	Runoff (cfs)	Time (hours)	Precip. (inches)	Excess (inches)	Runoff (cfs)
0.00	0.00	0.00	0.00	26.00	8.21	7.97	0.00
0.50	0.04	0.00	0.00	26.50	8.21	7.97	0.00
1.00	0.09	0.01	0.02	27.00	8.21	7.97	0.00
1.50	0.14	0.03	0.04	27.50	8.21	7.97	0.00
2.00	0.19	0.06	0.05	28.00	8.21	7.97	0.00
2.50	0.24	0.10	0.06	28.50	8.21	7.97	0.00
3.00	0.29	0.14	0.06	29.00	8.21	7.97	0.00
3.50	0.34	0.18	0.07	29.50	8.21	7.97	0.00
4.00	0.40	0.23	0.07	30.00	8.21	7.97	0.00
4.50	0.46	0.28	0.08	30.50	8.21	7.97	0.00
5.00	0.52	0.34	0.08	31.00	8.21	7.97	0.00
5.50	0.59	0.40	0.09	31.50	8.21	7.97	0.00
6.00	0.65	0.46	0.09	32.00	8.21	7.97	0.00
6.50	0.72	0.52	0.10	32.50	8.21	7.97	0.00
7.00	0.80	0.60	0.12	33.00	8.21	7.97	0.00
7.50	0.89	0.68	0.13	33.50	8.21	7.97	0.00
8.00	0.98	0.78	0.14	34.00	8.21	7.97	0.00
8.50	1.09	0.88	0.15	34.50	8.21	7.97	0.00
9.00	1.20	0.98	0.17	35.00	8.21	7.97	0.00
9.50	1.33	1.12	0.21	35.50	8.21	7.97	0.00
10.00	1.50	1.28	0.26	36.00	8.21	7.97	0.00
10.50	1.69	1.47	0.30				
11.00	1.97	1.74	0.48				
11.50	2.43	2.20	0.81				
12.00	3.91	3.68	4.39				
12.50	5.78	5.55	1.20				
13.00	6.24	6.00	0.54				
13.50	6.52	6.28	0.34				
14.00	6.71	6.47	0.27				
14.50	6.88	6.64	0.22				
15.00	7.01	6.77	0.18				
15.50	7.12	6.88	0.16				
16.00	7.23	6.99	0.15				
16.50	7.32	7.08	0.14				
17.00	7.41	7.17	0.12				
17.50	7.49	7.25	0.11				
18.00	7.56	7.32	0.10				
18.50	7.62	7.39	0.09				
19.00	7.69	7.45	0.09				
19.50	7.75	7.51	0.09				
20.00	7.81	7.57	0.09				
20.50	7.87	7.63	0.08				
21.00	7.92	7.68	0.08				
21.50	7.97	7.73	0.08				
22.00	8.02	7.78	0.07				
22.50	8.07	7.83	0.07				
23.00	8.12	7.88	0.07				
23.50	8.17	7.93	0.06				
24.00	8.21	7.97	0.07				
24.50	8.21	7.97	0.00				
25.00	8.21	7.97	0.00				
25.50	8.21	7.97	0.00				

Prop 2 yr, 10 yr, 100 yr - Copy

Prepared by Dynamic Engineering

HydroCAD® 10.20-4b s/n 08640 © 2023 HydroCAD Software Solutions LLC

NOAA 24-hr C 100-Year Rainfall=8.21"

Printed 3/5/2024

Page 54


Summary for Subcatchment 5S: Prop SA South Perv

Runoff = 2.18 cfs @ 12.19 hrs, Volume= 0.169 af, Depth= 3.61"
Routed to Link 6L : Prop SA South

Runoff by SCS TR-20 method, UH=SCS, Weighted-CN, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs
NOAA 24-hr C 100-Year Rainfall=8.21"

Area (sf)	CN	Description
971	55	Woods, Good, HSG B
23,533	61	>75% Grass cover, Good, HSG B
24,504	61	Weighted Average
24,504		100.00% Pervious Area

Tc (min)	Length (feet)	Slope (ft/ft)	Velocity (ft/sec)	Capacity (cfs)	Description
11.0	70	0.0180	0.11		Sheet Flow, Sheet Flow Grass: Dense n= 0.240 P2= 3.34"

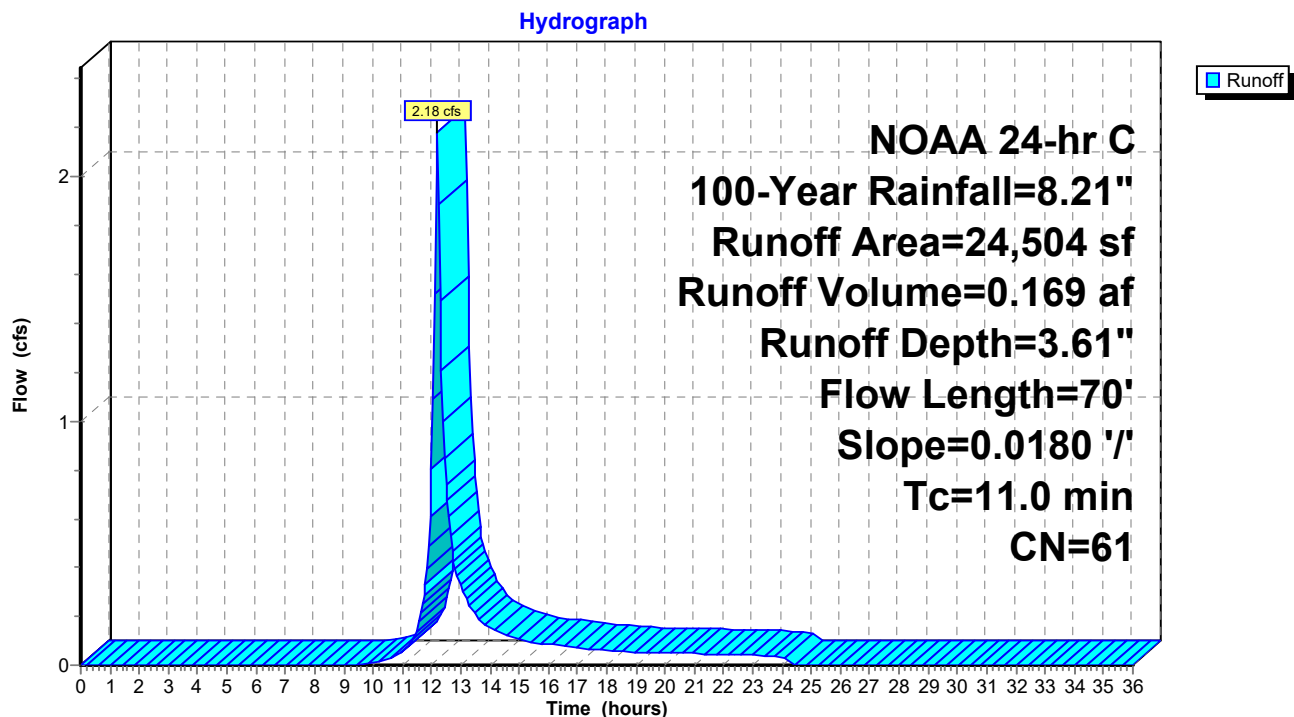Subcatchment 5S: Prop SA South Perv

Prop 2 yr, 10 yr, 100 yr - Copy

Prepared by Dynamic Engineering

HydroCAD® 10.20-4b s/n 08640 © 2023 HydroCAD Software Solutions LLC

NOAA 24-hr C 100-Year Rainfall=8.21"

Printed 3/5/2024

Page 55

Hydrograph for Subcatchment 5S: Prop SA South Perv

Time (hours)	Precip. (inches)	Excess (inches)	Runoff (cfs)	Time (hours)	Precip. (inches)	Excess (inches)	Runoff (cfs)
0.00	0.00	0.00	0.00	26.00	8.21	3.61	0.00
0.50	0.04	0.00	0.00	26.50	8.21	3.61	0.00
1.00	0.09	0.00	0.00	27.00	8.21	3.61	0.00
1.50	0.14	0.00	0.00	27.50	8.21	3.61	0.00
2.00	0.19	0.00	0.00	28.00	8.21	3.61	0.00
2.50	0.24	0.00	0.00	28.50	8.21	3.61	0.00
3.00	0.29	0.00	0.00	29.00	8.21	3.61	0.00
3.50	0.34	0.00	0.00	29.50	8.21	3.61	0.00
4.00	0.40	0.00	0.00	30.00	8.21	3.61	0.00
4.50	0.46	0.00	0.00	30.50	8.21	3.61	0.00
5.00	0.52	0.00	0.00	31.00	8.21	3.61	0.00
5.50	0.59	0.00	0.00	31.50	8.21	3.61	0.00
6.00	0.65	0.00	0.00	32.00	8.21	3.61	0.00
6.50	0.72	0.00	0.00	32.50	8.21	3.61	0.00
7.00	0.80	0.00	0.00	33.00	8.21	3.61	0.00
7.50	0.89	0.00	0.00	33.50	8.21	3.61	0.00
8.00	0.98	0.00	0.00	34.00	8.21	3.61	0.00
8.50	1.09	0.00	0.00	34.50	8.21	3.61	0.00
9.00	1.20	0.00	0.00	35.00	8.21	3.61	0.00
9.50	1.33	0.00	0.00	35.50	8.21	3.61	0.00
10.00	1.50	0.01	0.01	36.00	8.21	3.61	0.00
10.50	1.69	0.03	0.02				
11.00	1.97	0.07	0.05				
11.50	2.43	0.17	0.14				
12.00	3.91	0.77	0.80				
12.50	5.78	1.86	0.74				
13.00	6.24	2.17	0.32				
13.50	6.52	2.36	0.20				
14.00	6.71	2.50	0.15				
14.50	6.88	2.61	0.13				
15.00	7.01	2.71	0.11				
15.50	7.12	2.79	0.09				
16.00	7.23	2.87	0.08				
16.50	7.32	2.94	0.08				
17.00	7.41	3.00	0.07				
17.50	7.49	3.06	0.07				
18.00	7.56	3.11	0.06				
18.50	7.62	3.16	0.06				
19.00	7.69	3.21	0.05				
19.50	7.75	3.25	0.05				
20.00	7.81	3.30	0.05				
20.50	7.87	3.34	0.05				
21.00	7.92	3.38	0.05				
21.50	7.97	3.42	0.05				
22.00	8.02	3.46	0.04				
22.50	8.07	3.50	0.04				
23.00	8.12	3.54	0.04				
23.50	8.17	3.57	0.04				
24.00	8.21	3.61	0.04				
24.50	8.21	3.61	0.00				
25.00	8.21	3.61	0.00				
25.50	8.21	3.61	0.00				

Summary for Link 3L: Prop SA North

Inflow Area = 1.691 ac, 60.69% Impervious, Inflow Depth = 6.17" for 100-Year event


Inflow = 11.35 cfs @ 12.08 hrs, Volume= 0.869 af

Primary = 11.35 cfs @ 12.08 hrs, Volume= 0.869 af, Atten= 0%, Lag= 0.0 min

Primary outflow = Inflow, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs

Link 3L: Prop SA North

Hydrograph

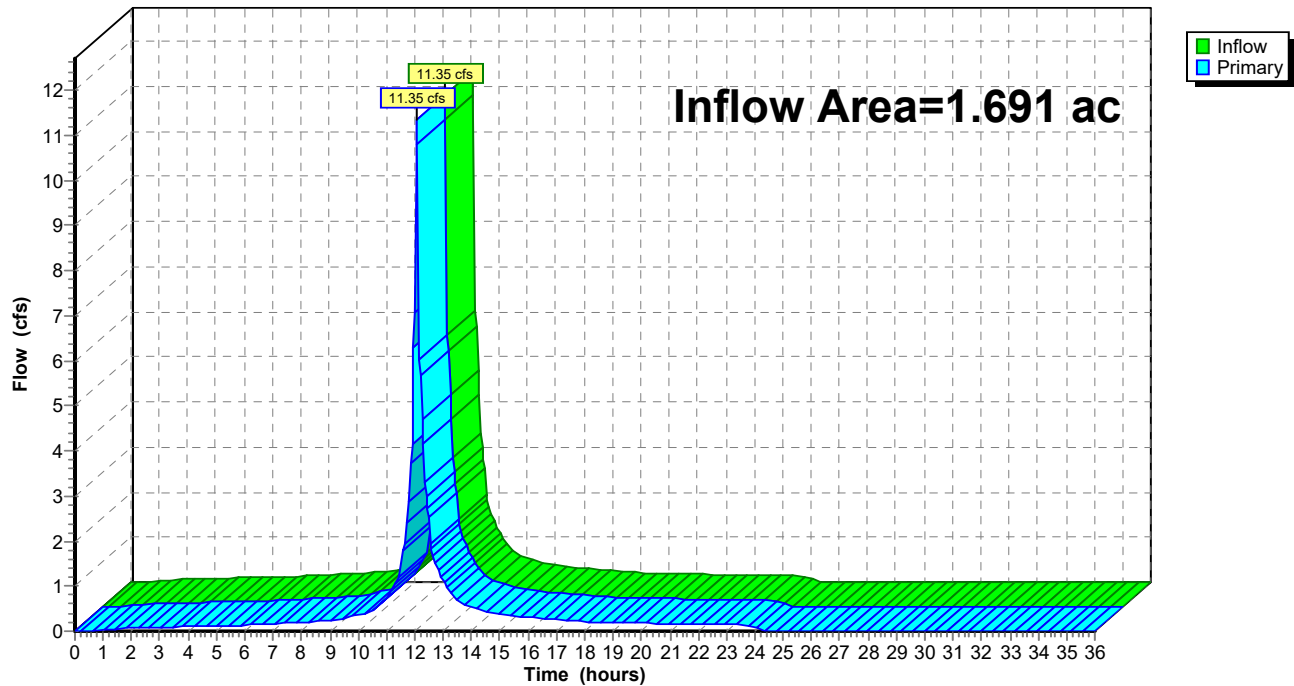

Prop 2 yr, 10 yr, 100 yr - Copy

Prepared by Dynamic Engineering

HydroCAD® 10.20-4b s/n 08640 © 2023 HydroCAD Software Solutions LLC

NOAA 24-hr C 100-Year Rainfall=8.21"

Printed 3/5/2024

Page 57


Hydrograph for Link 3L: Prop SA North

Time (hours)	Inflow (cfs)	Elevation (feet)	Primary (cfs)	Time (hours)	Inflow (cfs)	Elevation (feet)	Primary (cfs)
0.00	0.00	0.00	0.00	26.00	0.00	0.00	0.00
0.50	0.00	0.00	0.00	26.50	0.00	0.00	0.00
1.00	0.03	0.00	0.03	27.00	0.00	0.00	0.00
1.50	0.05	0.00	0.05	27.50	0.00	0.00	0.00
2.00	0.07	0.00	0.07	28.00	0.00	0.00	0.00
2.50	0.08	0.00	0.08	28.50	0.00	0.00	0.00
3.00	0.09	0.00	0.09	29.00	0.00	0.00	0.00
3.50	0.10	0.00	0.10	29.50	0.00	0.00	0.00
4.00	0.10	0.00	0.10	30.00	0.00	0.00	0.00
4.50	0.11	0.00	0.11	30.50	0.00	0.00	0.00
5.00	0.12	0.00	0.12	31.00	0.00	0.00	0.00
5.50	0.12	0.00	0.12	31.50	0.00	0.00	0.00
6.00	0.13	0.00	0.13	32.00	0.00	0.00	0.00
6.50	0.15	0.00	0.15	32.50	0.00	0.00	0.00
7.00	0.16	0.00	0.16	33.00	0.00	0.00	0.00
7.50	0.18	0.00	0.18	33.50	0.00	0.00	0.00
8.00	0.20	0.00	0.20	34.00	0.00	0.00	0.00
8.50	0.22	0.00	0.22	34.50	0.00	0.00	0.00
9.00	0.23	0.00	0.23	35.00	0.00	0.00	0.00
9.50	0.30	0.00	0.30	35.50	0.00	0.00	0.00
10.00	0.36	0.00	0.36	36.00	0.00	0.00	0.00
10.50	0.45	0.00	0.45				
11.00	0.72	0.00	0.72				
11.50	1.29	0.00	1.29				
12.00	7.08	0.00	7.08				
12.50	2.54	0.00	2.54				
13.00	1.13	0.00	1.13				
13.50	0.71	0.00	0.71				
14.00	0.55	0.00	0.55				
14.50	0.46	0.00	0.46				
15.00	0.37	0.00	0.37				
15.50	0.33	0.00	0.33				
16.00	0.30	0.00	0.30				
16.50	0.28	0.00	0.28				
17.00	0.26	0.00	0.26				
17.50	0.23	0.00	0.23				
18.00	0.21	0.00	0.21				
18.50	0.20	0.00	0.20				
19.00	0.19	0.00	0.19				
19.50	0.18	0.00	0.18				
20.00	0.18	0.00	0.18				
20.50	0.17	0.00	0.17				
21.00	0.17	0.00	0.17				
21.50	0.16	0.00	0.16				
22.00	0.15	0.00	0.15				
22.50	0.15	0.00	0.15				
23.00	0.14	0.00	0.14				
23.50	0.14	0.00	0.14				
24.00	0.14	0.00	0.14				
24.50	0.00	0.00	0.00				
25.00	0.00	0.00	0.00				
25.50	0.00	0.00	0.00				

Summary for Link 6L: Prop SA South

Inflow Area = 1.294 ac, 56.51% Impervious, Inflow Depth = 6.07" for 100-Year event
Inflow = 8.51 cfs @ 12.08 hrs, Volume= 0.655 af
Primary = 8.51 cfs @ 12.08 hrs, Volume= 0.655 af, Atten= 0%, Lag= 0.0 min

Primary outflow = Inflow, Time Span= 0.00-36.00 hrs, dt= 0.05 hrs

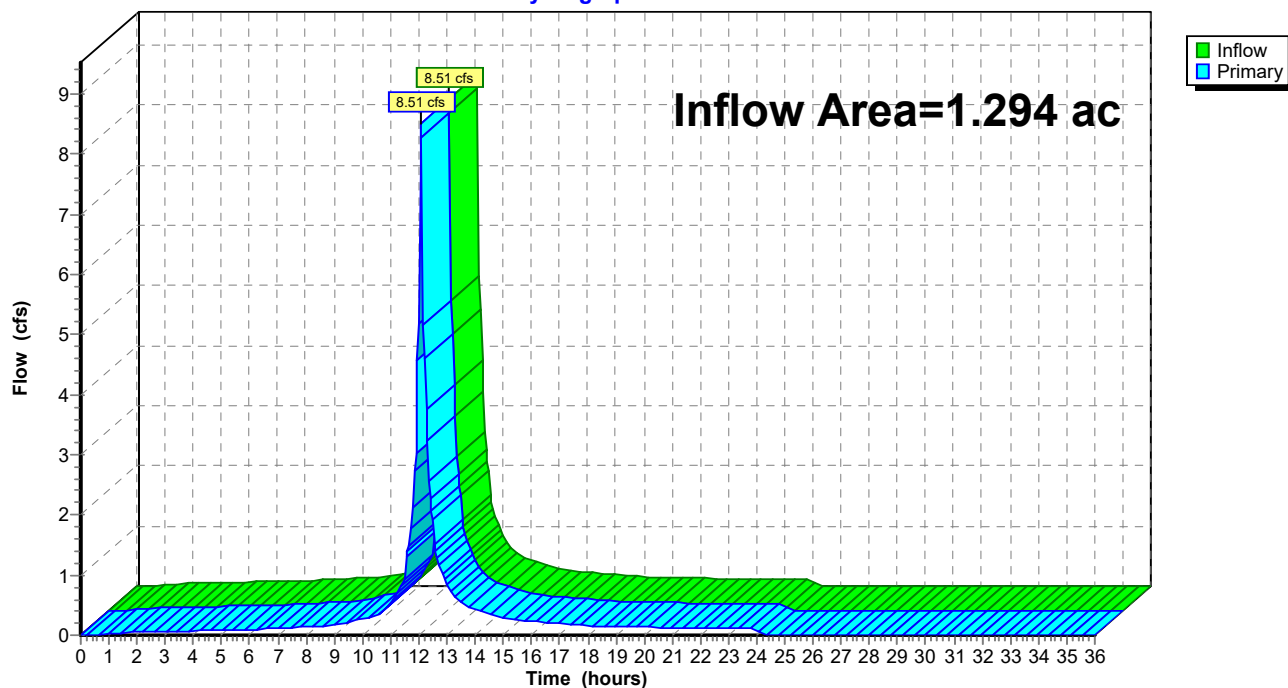Link 6L: Prop SA South**Hydrograph**

Prop 2 yr, 10 yr, 100 yr - Copy

Prepared by Dynamic Engineering

HydroCAD® 10.20-4b s/n 08640 © 2023 HydroCAD Software Solutions LLC

NOAA 24-hr C 100-Year Rainfall=8.21"

Printed 3/5/2024


Page 59

Hydrograph for Link 6L: Prop SA South

Time (hours)	Inflow (cfs)	Elevation (feet)	Primary (cfs)	Time (hours)	Inflow (cfs)	Elevation (feet)	Primary (cfs)
0.00	0.00	0.00	0.00	26.00	0.00	0.00	0.00
0.50	0.00	0.00	0.00	26.50	0.00	0.00	0.00
1.00	0.02	0.00	0.02	27.00	0.00	0.00	0.00
1.50	0.04	0.00	0.04	27.50	0.00	0.00	0.00
2.00	0.05	0.00	0.05	28.00	0.00	0.00	0.00
2.50	0.06	0.00	0.06	28.50	0.00	0.00	0.00
3.00	0.06	0.00	0.06	29.00	0.00	0.00	0.00
3.50	0.07	0.00	0.07	29.50	0.00	0.00	0.00
4.00	0.07	0.00	0.07	30.00	0.00	0.00	0.00
4.50	0.08	0.00	0.08	30.50	0.00	0.00	0.00
5.00	0.08	0.00	0.08	31.00	0.00	0.00	0.00
5.50	0.09	0.00	0.09	31.50	0.00	0.00	0.00
6.00	0.09	0.00	0.09	32.00	0.00	0.00	0.00
6.50	0.10	0.00	0.10	32.50	0.00	0.00	0.00
7.00	0.12	0.00	0.12	33.00	0.00	0.00	0.00
7.50	0.13	0.00	0.13	33.50	0.00	0.00	0.00
8.00	0.14	0.00	0.14	34.00	0.00	0.00	0.00
8.50	0.15	0.00	0.15	34.50	0.00	0.00	0.00
9.00	0.17	0.00	0.17	35.00	0.00	0.00	0.00
9.50	0.21	0.00	0.21	35.50	0.00	0.00	0.00
10.00	0.27	0.00	0.27	36.00	0.00	0.00	0.00
10.50	0.33	0.00	0.33				
11.00	0.53	0.00	0.53				
11.50	0.95	0.00	0.95				
12.00	5.19	0.00	5.19				
12.50	1.94	0.00	1.94				
13.00	0.86	0.00	0.86				
13.50	0.54	0.00	0.54				
14.00	0.42	0.00	0.42				
14.50	0.35	0.00	0.35				
15.00	0.28	0.00	0.28				
15.50	0.25	0.00	0.25				
16.00	0.23	0.00	0.23				
16.50	0.21	0.00	0.21				
17.00	0.20	0.00	0.20				
17.50	0.18	0.00	0.18				
18.00	0.16	0.00	0.16				
18.50	0.15	0.00	0.15				
19.00	0.15	0.00	0.15				
19.50	0.14	0.00	0.14				
20.00	0.14	0.00	0.14				
20.50	0.13	0.00	0.13				
21.00	0.13	0.00	0.13				
21.50	0.12	0.00	0.12				
22.00	0.12	0.00	0.12				
22.50	0.11	0.00	0.11				
23.00	0.11	0.00	0.11				
23.50	0.10	0.00	0.10				
24.00	0.11	0.00	0.11				
24.50	0.00	0.00	0.00				
25.00	0.00	0.00	0.00				
25.50	0.00	0.00	0.00				


**HydroCAD SUMMARY REPORTS – PRE VS POST
CONDITIONS 2 YR, 10 YR & 100 YR**

Study Area North (2-year Storm)

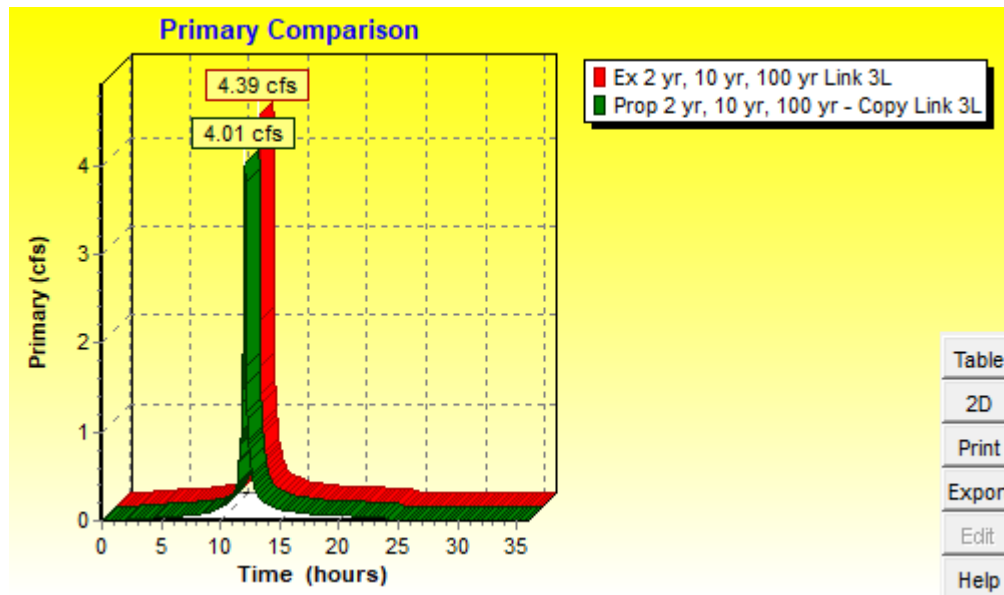


Time (hours)	Ex 2 yr, 10 yr, 100 yr Link 3L (cfs)	Prop 2 yr, 10 yr, 100 yr - Copy Link 3L (cfs)
0.00	0.00	0.00
1.00	0.00	0.00
2.00	0.01	0.01
3.00	0.02	0.02
4.00	0.03	0.03
5.00	0.04	0.04
6.00	0.05	0.04
7.00	0.06	0.06
8.00	0.08	0.07
9.00	0.09	0.09
10.00	0.15	0.14
11.00	0.28	0.26
12.00	2.65	2.53
13.00	0.38	0.37
14.00	0.19	0.18
15.00	0.13	0.12
16.00	0.10	0.10
17.00	0.09	0.09
18.00	0.07	0.07
19.00	0.07	0.06
20.00	0.06	0.06
21.00	0.06	0.06
22.00	0.05	0.05
23.00	0.05	0.05
24.00	0.05	0.05
25.00	0.00	0.00
26.00	0.00	0.00
27.00	0.00	0.00
28.00	0.00	0.00
29.00	0.00	0.00
30.00	0.00	0.00
31.00	0.00	0.00
32.00	0.00	0.00
33.00	0.00	0.00
34.00	0.00	0.00
35.00	0.00	0.00
36.00	0.00	0.00

Study Area North (10-year Storm)

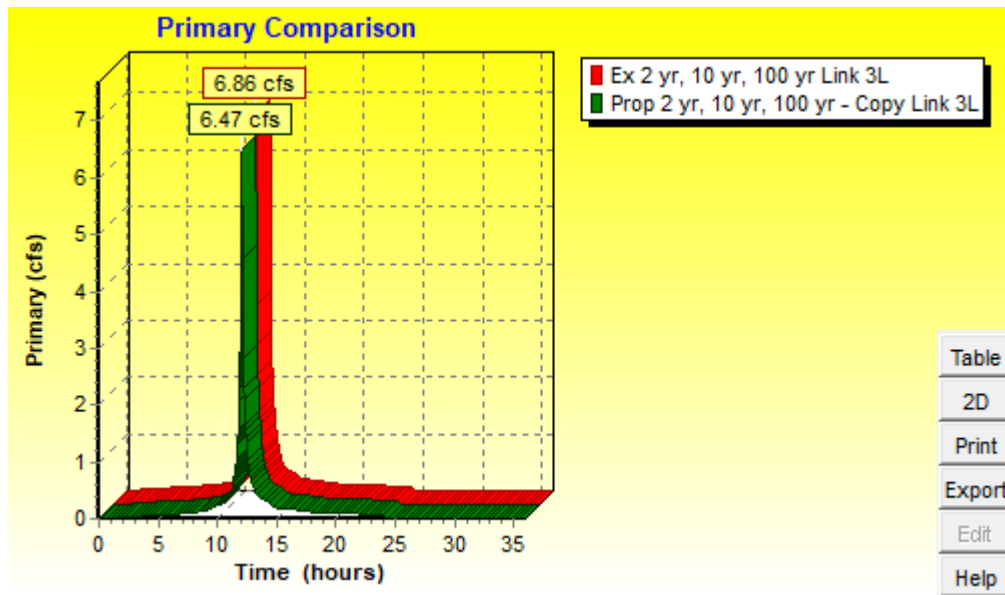


Time (hours)	Ex 2 yr, 10 yr, 100 yr Link 3L (cfs)	Prop 2 yr, 10 yr, 100 yr - Copy Link 3L (cfs)
0.00	0.00	0.00
1.00	0.01	0.01
2.00	0.03	0.03
3.00	0.05	0.04
4.00	0.06	0.05
5.00	0.07	0.06
6.00	0.08	0.07
7.00	0.10	0.09
8.00	0.13	0.12
9.00	0.15	0.14
10.00	0.23	0.22
11.00	0.44	0.41
12.00	4.13	4.01
13.00	0.62	0.61
14.00	0.31	0.30
15.00	0.21	0.20
16.00	0.17	0.17
17.00	0.14	0.14
18.00	0.12	0.12
19.00	0.11	0.11
20.00	0.10	0.10
21.00	0.09	0.09
22.00	0.09	0.09
23.00	0.08	0.08
24.00	0.08	0.08
25.00	0.00	0.00
26.00	0.00	0.00
27.00	0.00	0.00
28.00	0.00	0.00
29.00	0.00	0.00
30.00	0.00	0.00
31.00	0.00	0.00
32.00	0.00	0.00
33.00	0.00	0.00
34.00	0.00	0.00
35.00	0.00	0.00
36.00	0.00	0.00

Study Area North (100-year Storm)

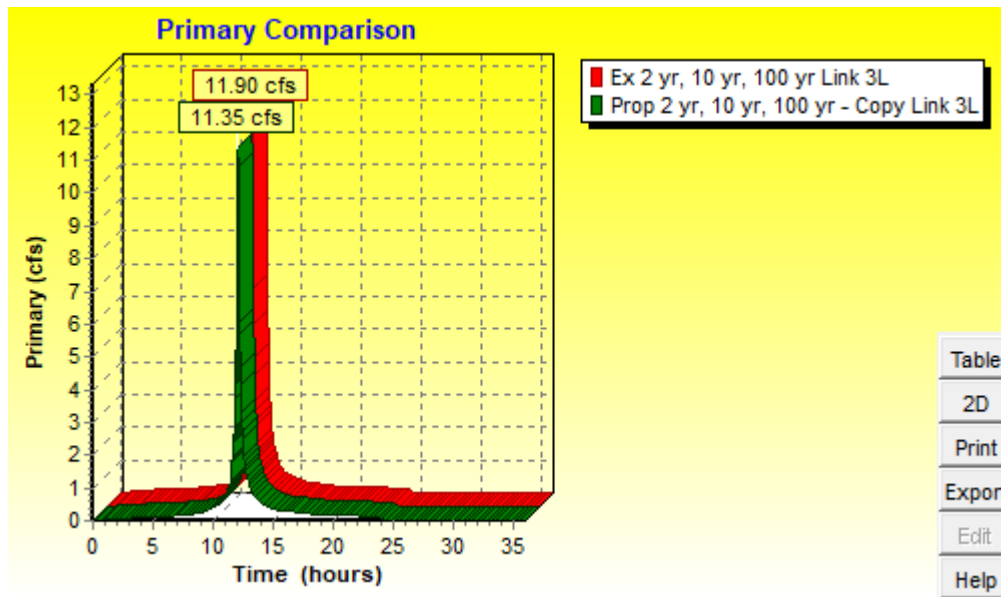


Time (hours)	Ex 2 yr, 10 yr, 100 yr Link 3L (cfs)	Prop 2 yr, 10 yr, 100 yr - Copy Link 3L (cfs)
0.00	0.00	0.00
1.00	0.03	0.03
2.00	0.07	0.07
3.00	0.10	0.09
4.00	0.11	0.10
5.00	0.13	0.12
6.00	0.14	0.13
7.00	0.18	0.16
8.00	0.21	0.20
9.00	0.25	0.23
10.00	0.39	0.36
11.00	0.76	0.72
12.00	7.21	7.08
13.00	1.13	1.13
14.00	0.55	0.55
15.00	0.37	0.37
16.00	0.30	0.30
17.00	0.26	0.26
18.00	0.21	0.21
19.00	0.19	0.19
20.00	0.18	0.18
21.00	0.17	0.17
22.00	0.15	0.15
23.00	0.14	0.14
24.00	0.15	0.14
25.00	0.00	0.00
26.00	0.00	0.00
27.00	0.00	0.00
28.00	0.00	0.00
29.00	0.00	0.00
30.00	0.00	0.00
31.00	0.00	0.00
32.00	0.00	0.00
33.00	0.00	0.00
34.00	0.00	0.00
35.00	0.00	0.00
36.00	0.00	0.00

Study Area South (2-year Storm)

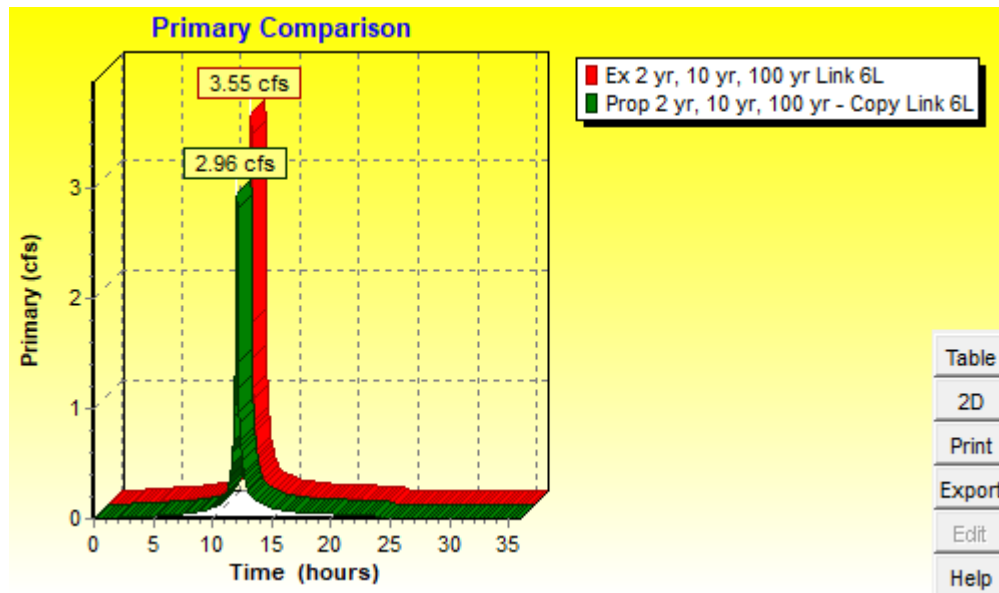


Time (hours)	Ex 2 yr, 10 yr, 100 yr Link 6L (cfs)	Prop 2 yr, 10 yr, 100 yr - Copy Link 6L (cfs)
0.00	0.00	0.00
1.00	0.00	0.00
2.00	0.01	0.01
3.00	0.02	0.02
4.00	0.03	0.02
5.00	0.03	0.03
6.00	0.04	0.03
7.00	0.05	0.04
8.00	0.06	0.05
9.00	0.08	0.06
10.00	0.12	0.10
11.00	0.23	0.19
12.00	2.14	1.78
13.00	0.30	0.28
14.00	0.15	0.14
15.00	0.10	0.09
16.00	0.08	0.08
17.00	0.07	0.07
18.00	0.06	0.05
19.00	0.05	0.05
20.00	0.05	0.05
21.00	0.05	0.04
22.00	0.04	0.04
23.00	0.04	0.04
24.00	0.04	0.04
25.00	0.00	0.00
26.00	0.00	0.00
27.00	0.00	0.00
28.00	0.00	0.00
29.00	0.00	0.00
30.00	0.00	0.00
31.00	0.00	0.00
32.00	0.00	0.00
33.00	0.00	0.00
34.00	0.00	0.00
35.00	0.00	0.00
36.00	0.00	0.00

Study Area South (10-year Storm)

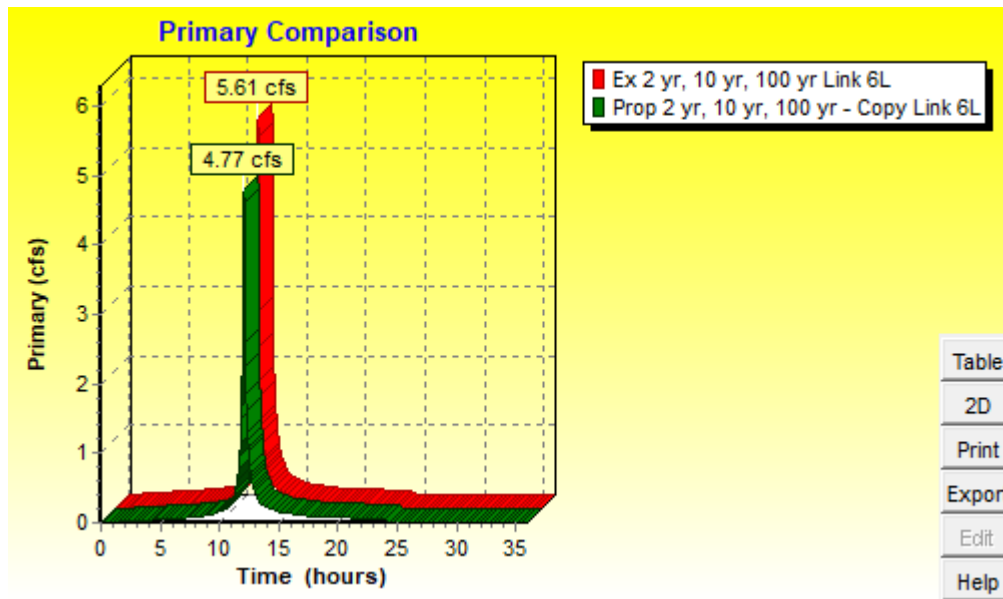

Time (hours)	Ex 2 yr, 10 yr, 100 yr Link 6L (cfs)	Prop 2 yr, 10 yr, 100 yr - Copy Link 6L (cfs)
0.00	0.00	0.00
1.00	0.01	0.00
2.00	0.02	0.02
3.00	0.04	0.03
4.00	0.05	0.04
5.00	0.06	0.05
6.00	0.06	0.05
7.00	0.08	0.07
8.00	0.10	0.08
9.00	0.12	0.10
10.00	0.19	0.15
11.00	0.35	0.29
12.00	3.40	2.88
13.00	0.50	0.47
14.00	0.25	0.23
15.00	0.17	0.16
16.00	0.14	0.13
17.00	0.12	0.11
18.00	0.09	0.09
19.00	0.09	0.08
20.00	0.08	0.08
21.00	0.08	0.07
22.00	0.07	0.07
23.00	0.06	0.06
24.00	0.07	0.06
25.00	0.00	0.00
26.00	0.00	0.00
27.00	0.00	0.00
28.00	0.00	0.00
29.00	0.00	0.00
30.00	0.00	0.00
31.00	0.00	0.00
32.00	0.00	0.00
33.00	0.00	0.00
34.00	0.00	0.00
35.00	0.00	0.00
36.00	0.00	0.00

Study Area South (100-year Storm)

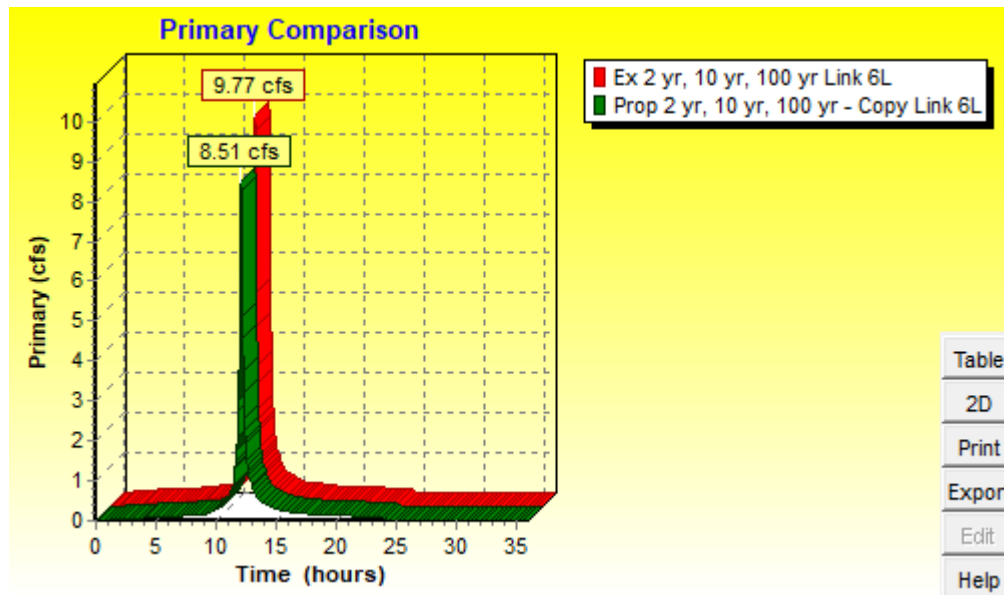

Time (hours)	Ex 2 yr, 10 yr, 100 yr Link 6L (cfs)	Prop 2 yr, 10 yr, 100 yr - Copy Link 6L (cfs)
0.00	0.00	0.00
1.00	0.03	0.02
2.00	0.06	0.05
3.00	0.08	0.06
4.00	0.09	0.07
5.00	0.10	0.08
6.00	0.11	0.09
7.00	0.14	0.12
8.00	0.17	0.14
9.00	0.20	0.17
10.00	0.32	0.27
11.00	0.62	0.53
12.00	5.95	5.19
13.00	0.89	0.86
14.00	0.44	0.42
15.00	0.29	0.28
16.00	0.24	0.23
17.00	0.20	0.20
18.00	0.16	0.16
19.00	0.15	0.15
20.00	0.14	0.14
21.00	0.13	0.13
22.00	0.12	0.12
23.00	0.11	0.11
24.00	0.12	0.11
25.00	0.00	0.00
26.00	0.00	0.00
27.00	0.00	0.00
28.00	0.00	0.00
29.00	0.00	0.00
30.00	0.00	0.00
31.00	0.00	0.00
32.00	0.00	0.00
33.00	0.00	0.00
34.00	0.00	0.00
35.00	0.00	0.00
36.00	0.00	0.00

**NEW JERSEY GROUNDWATER RECHARGE
SPREADSHEET (NJGRS) – VERSION 2**

Annual Groundwater Recharge Analysis (based on GSR-32)

Select Township ↓	Average Annual P (in)	Climatic Factor
SOMERSET CO., MONTGOMERY TWP	46.0	1.50

Project Name: Renard Management, Inc

Description: Proposed Self-Storage Facility

Analysis Date: 06/14/23

Pre-Developed Conditions

Land Segment	Area (acres)	TR-55 Land Cover	Soil	Annual Recharge (in)	Annual Recharge (cu.ft)
1	2	Impervious areas	Birdsboro	0.0	-
2	0.41	Woods	Birdsboro	14.7	21,863
3	0.58	Open space	Birdsboro	14.5	30,497
4					
5					
6					
7	0				
8	0				
9	0				
10	0				
11	0				
12	0				
13	0				
14	0				
15	0				
Total =	3.0			Total Annual Recharge (in)	Total Annual Recharge (cu-ft)
				4.8	52,360

Post-Developed Conditions

Land Segment	Area (acres)	TR-55 Land Cover	Soil	Annual Recharge (in)	Annual Recharge (cu.ft)
1	1.74	Impervious areas	Birdsboro	0.0	-
2	0.18	Woods	Birdsboro	14.7	9,598
3	1.07	Open space	Birdsboro	14.5	56,261
4					
5	0				
6	0				
7	0				
8	0				
9	0				
10	0				
11	0				
12	0				
13	0				
14	0				
15	0				
Total =	3.0			Total Annual Recharge (in)	Total Annual Recharge (cu.ft)
				6.1	65,860

Annual Recharge Requirements Calculation ↓

% of Pre-Developed Annual Recharge to Preserve =	100%	Total Impervious Area (sq.ft)	75,794
--	------	-------------------------------	--------

Post-Development Annual Recharge Deficit= -13,500

(cubic feet)

Recharge Efficiency Parameters Calculations (area averages)

RWC= 5.52	(in)	DRWC= 5.52	(in)
ERWC = 1.38	(in)	EDRWC= 1.38	(in)

Procedure to fill the Pre-Development and Post-Development Conditions Tables

For each land segment, first enter the area, then select TR-55 Land Cover, then select Soil. Start from the top of the table and proceed downward. Don't leave blank rows (with A=0) in between your segment entries. Rows with A=0 will not be displayed or used in calculations. For impervious areas outside of standard lots select "Impervious Areas" as the Land Cover. Soil type for impervious areas are only required if an infiltration facility will be built within these areas.

Project Name	Description	Analysis Date	BMP or LID Type
Renard Management, Inc	Proposed Self-Storage Facility	06/14/23	

Recharge BMP Input Parameters				Root Zone Water capacity Calculated Parameters				Recharge Design Parameters			
Parameter	Symbol	Value	Unit	Parameter	Symbol	Value	Unit	Parameter	Symbol	Value	Unit
BMP Area	ABMP	6656.0	sq.ft	Empty Portion of RWC under Post-D Natural Recharge	ERWC	1.38	in	Inches of Runoff to capture	Qdesign	0.46	in
BMP Effective Depth, this is the design variable	dBMP	5.2	in	ERWC Modified to consider dEXC	EDRWC	1.38	in	Inches of Rainfall to capture	Pdesign	0.58	in
Upper level of the BMP surface (negative if above ground)	dBMPu	-5.2	in	Empty Portion of RWC under Infil. BMP	RERWC	1.11	in	Recharge Provided Avg. over Imp. Area		15.2	in
Depth of lower surface of BMP, must be >= dBMPu	dEXC	0.0	in					Runoff Captured Avg. over imp. Area		22.4	in
Post-development Land Segment Location of BMP, Input Zero if Location is distributed or undetermined	SegBMP	0	unitless								

BMP Calculated Size Parameters				CALCULATION CHECK MESSAGES	
ABMP/Aimp	Aratio	0.09	unitless	Volume Balance--> Solve Problem to satisfy Annual Recharge dBMP Check----> OK dEXC Check----> OK BMP Location----> Location is selected as distributed or undetermined	
BMP Volume	VBMP	2,873	cu.ft		

Parameters from Annual Recharge Worksheet				System Performance Calculated Parameters			
Post-D Deficit Recharge (or desired recharge volume)	Vdef	(13,500)	cu.ft	Annual BMP Recharge Volume		95,825	cu.ft
Post-D Impervious Area (or target Impervious Area)	Aimp	75,794	sq.ft	Avg BMP Recharge Efficiency		67.7%	Represents % Infiltration Recharged
Root Zone Water Capacity	RWC	5.52	in	%Rainfall became Runoff		78.0%	%
RWC Modified to consider dEXC	DRWC	5.52	in	%Runoff Infiltrated		62.5%	%
Climatic Factor	C-factor	1.50	no units	%Runoff Recharged		42.3%	%
Average Annual P	Pavg	46.0	in	%Rainfall Recharged		33.0%	%
Recharge Requirement over Imp. Area	dr	(2.1)	in				

OTHER NOTES

Pdesign is accurate only after BMP dimensions are updated to make rech volume= deficit volume. The portion of BMP infiltration prior to filling and the area occupied by BMP are ignored in these calculations. Results are sensitive to dBMP, make sure dBMP selected is small enough for BMP to empty in less than 3 days. For land Segment Location of BMP if you select "impervious areas" RWC will be minimal but not zero as determined by the soil type and a shallow root zone for this Land Cover allowing consideration of lateral flow and other losses.

How to solve for different recharge volumes: By default the spreadsheet assigns the values of total deficit recharge volume "Vdef" and total proposed impervious area "Aimp" from the "Annual Recharge" sheet to "Vdef" and "Aimp" on this page. This allows solution for a single BMP to handle the entire recharge requirement assuming the runoff from entire impervious area is available to the BMP.

To solve for a smaller BMP or a LID-IMP to recharge only part of the recharge requirement, set Vdef to your target value and Aimp to impervious area directly connected to your infiltration facility and then solve for ABMP or dBMP. To go back to the default configuration click the "Default Vdef & Aimp" button.

STORMWATER COLLECTION SYSTEM CALCULATIONS (PIPE SIZING)



Computed By: BC
Checked By: DT
Date: 3/5/2024

[illegible]



NOTES:

1) Design method used is Rational Method, unless otherwise noted.

2) Refer to Weighted Runoff Coefficient table

for calculation of incremental areas and C values

for calculation of incremental areas and C values

[illegible]

**ATTACHMENT D – MAJOR DEVELOPMENT
STORMWATER SUMMARY**

Attachment D – Major Development Stormwater Summary


General Information			
1. Project Name: Proposed Self-Storage Facility			Lot & Block Info:
2. Municipality: Township of Montgomery	County: Somerset County		Block 29002
3. Site Location (State Plane Coordinates – NAD83)	E: 450,968	N: 571,814	Lots 49 & 50
4. Date of Final Approval for Construction by Municipality (MM/DD/YYYY): TBD Date of Certificate of Occupancy (MM/DD/YYYY): TBD			
5. Project Type (place an "x" after all that apply) Residential ☐ Commercial ☒ Industrial ☐ Other (please specify) _____			
6. Soil Conservation District Project #: TBD			
7. Did the project require a NJDEP Land Use Permit? Yes ☐ No ☒ Land Use Permit #: _____			
8. Did the project require any mitigation measures? Yes ☐ No ☒ If yes, which standard was mitigated? _____			

Site Design Specifications	
1. Site Area (acres): 2.99	Area of Disturbance (acres): 2.82 Area of Proposed Impervious (acres): 1.74
2. List all Hydrologic Soil Groups: B	
3. Identify the Quantities of Each Type of Best Management Practices (BMPs) Incorporated into the Site Design: Bioretention Systems _____ Constructed Wetlands _____ Dry Wells _____ Extended Detention Basins _____ Infiltration Basins _____ Combination Infiltration/Detention Basins _____ Manufactured Treatment Devices _____ Pervious Paving Systems _____ Sand Filters _____ Vegetative Filter Strips _____ Wet Ponds _____ Grass Swales _____ Subsurface Gravel Wetlands _____ Other: _____	




Storm Event Information	
1. Storm Event – Rainfall (inches) / Duration (hours) 2 year: 3.34 / 24 hr 10 year: 5.01 / 24 hr 100 year: 8.21 / 24 hr	Water Quality Design Storm: 1.25 / 2 hr
2. Runoff Computation Method (mark one): NRCS Dimensionless Unit Hydrograph ☒ NRCS Delmarva Unit Hydrograph ☐ Rational Method ☐ Modified Rational Method ☐ Other (describe): _____	

BMP Specifications (answer all that apply) - If more than one BMP, see reverse side	
1. BMP Name: _____ Location (mark one): Surface ☐ Subsurface ☐	Type of BMP: _____ Is forebay part of the design? Yes ☐ No ☐
2. Owner (mark one): Public ☐ Private ☐ If private, Owner's Name: _____ Owner's Telephone No.: _____	
3. BMP Completion Date (MM/DD/YYYY): _____	
4. Does the BMP have an underdrain? Yes ☐ No ☐	
5. What is the Water Quality Design Storm Drain Down Time (hours)? _____ What is the Design Soil Permeability (inches/hour): _____	
6. What is the Seasonal High Water Table Depth from the BMP bottom (feet)? _____ Month Obtained: _____	
7. Groundwater Recharge Methodology (mark one): 2-Year Difference ☐ NJGRS ☐ Other ☐ N/A ☐	
8. Was Groundwater Mounding analyzed? Yes ☐ No ☐ If yes, Methodology: _____	
9. Was a Maintenance Plan submitted? Yes ☐ No ☐ Is the BMP deed restricted? Yes ☐ No ☐	

Name of Person Completing This Form: Joshua M. Sewald
Title: PE, PP

Signature: 
Date: 03/08/2024

DRAINAGE AREA MAPS

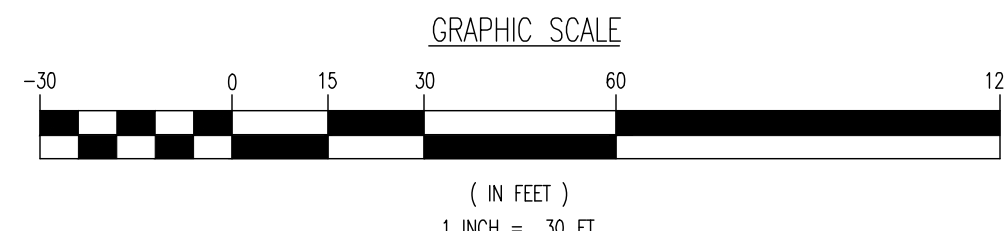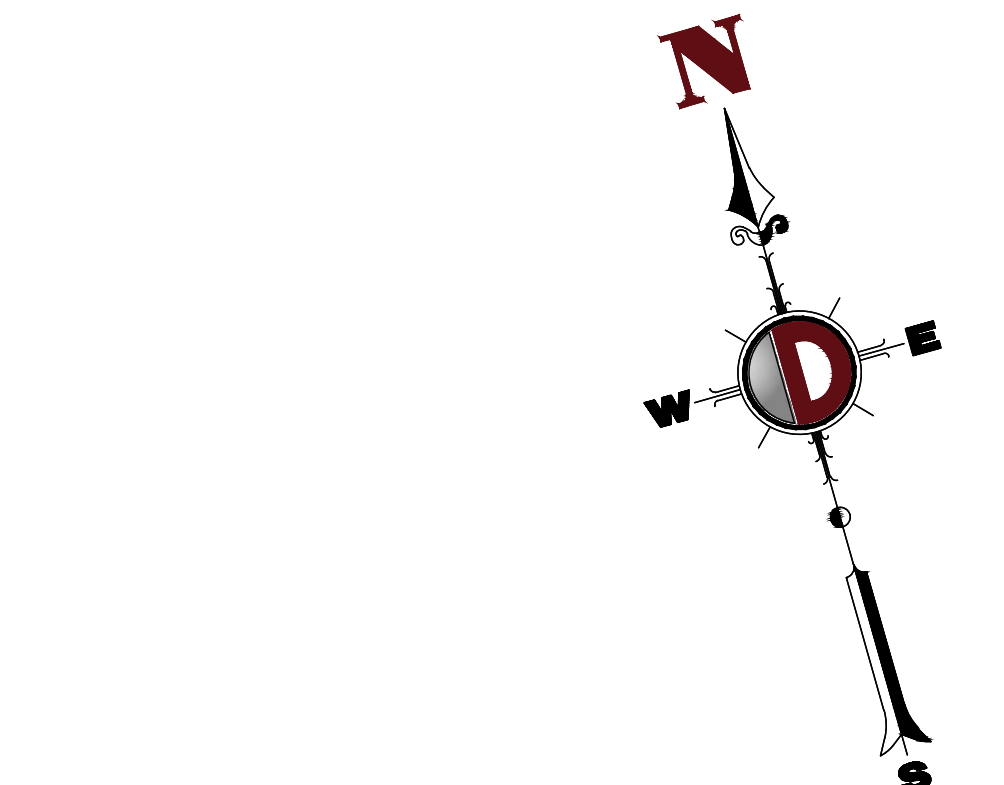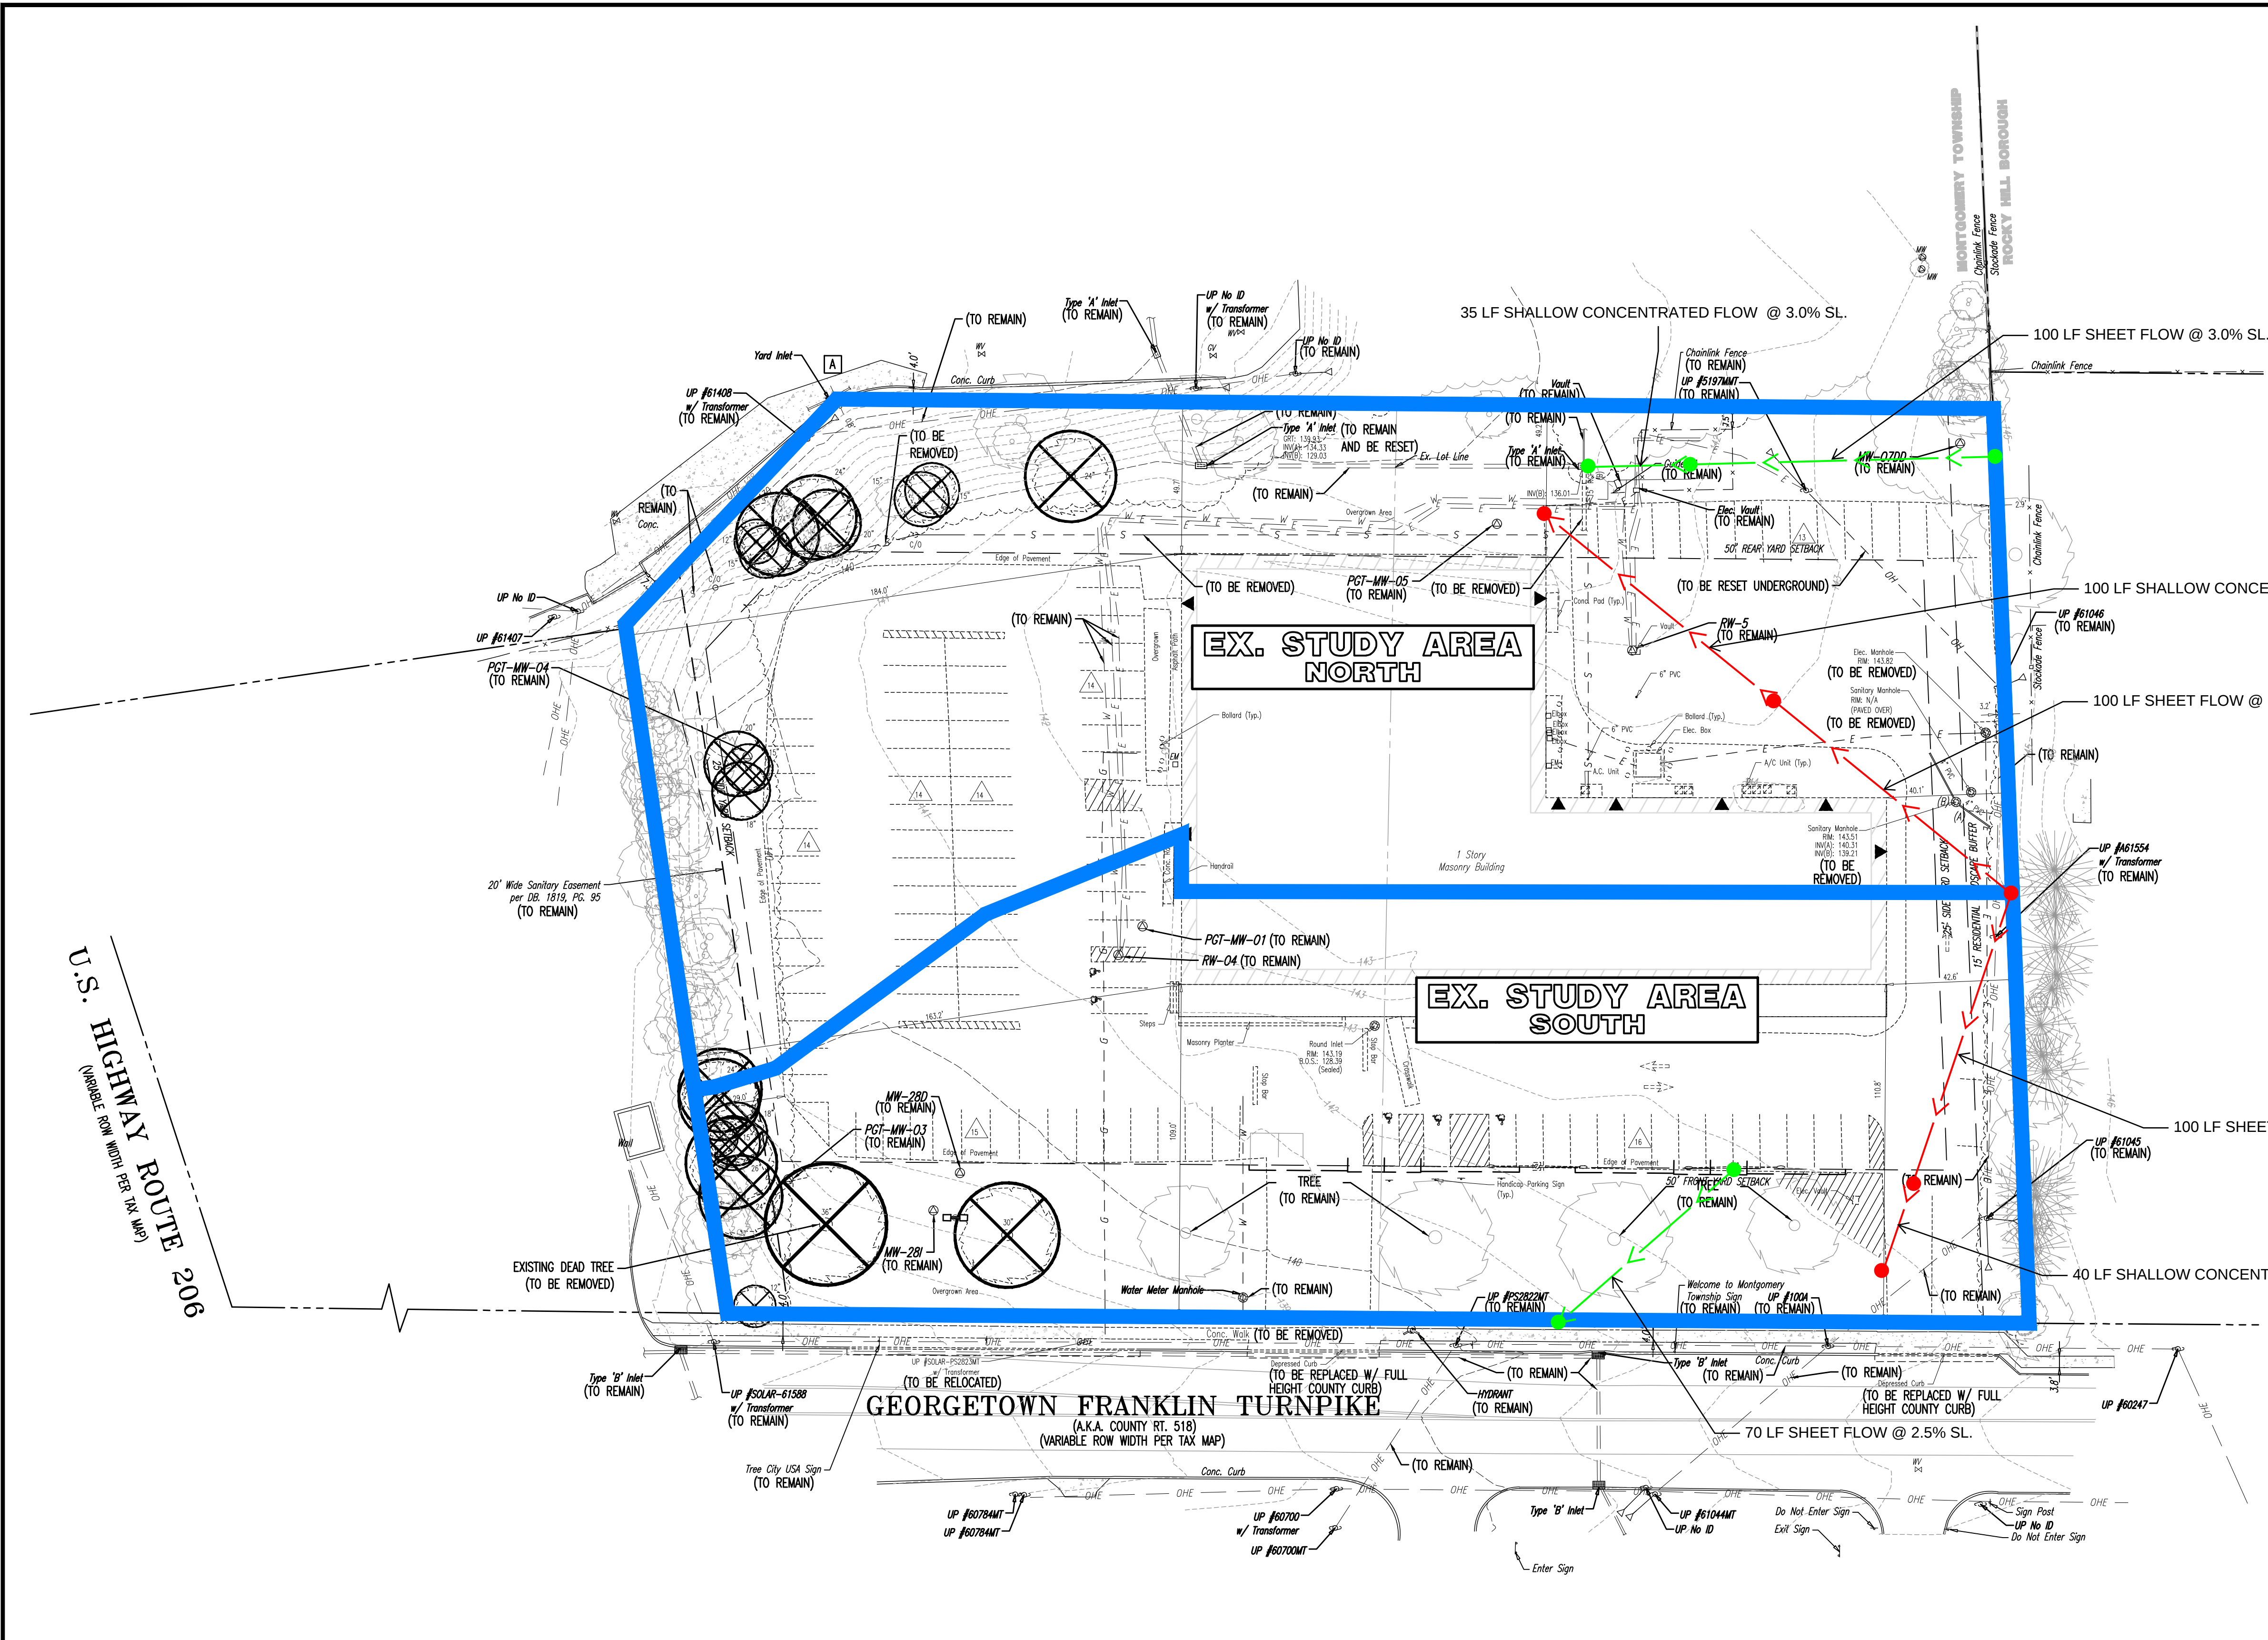

THIS PLAN SET IS FOR PERMITTING PURPOSES ONLY AND MAY NOT BE USED FOR CONSTRUCTION

DYNAMIC ENGINEERING
LAND DEVELOPMENT CONSULTING • PERMITTING • GEOTECHNICAL • ENVIRONMENTAL • SURVEY • PLANNING & ZONING

1954 Main Street
Lake Como, NJ 07719
T: 732.974.0198
F: 732.974.3521
www.dynamiceng.com


Job No: 2334-22-00894
DATE: 06/08/2023
DRAWN BY: KING
DESIGNED BY: BC
CHECKED BY: DT
SHEET No: 1 OF 3

PROJECT: **RENARD MANAGEMENT, INC.**
PROPOSED SELF-STORAGE FACILITY
BLOCK 29002, LOTS 49 & 50
1026 ROUTE 518
TOWNSHIP OF MONTGOMERY, SOMERSET COUNTY, NEW JERSEY

JOSHUA M. SEWALD
PROFESSIONAL ENGINEER
NEW JERSEY LICENSE No. 52985

KYLE C. KAVINSKI
PROFESSIONAL ENGINEER
NEW JERSEY LICENSE No. 52985

811 PROTECT YOURSELF
ALL STATES REQUIRE NOTIFICATION OF
CONSTRUCTIVE INTERESTS OF ANY DESIGN
PREPARED TO OBTAIN THE SERVICE
FOR STATE SPECIFIC DIRECT PHONE NUMBERS VISIT:
WWW.CALL811.COM

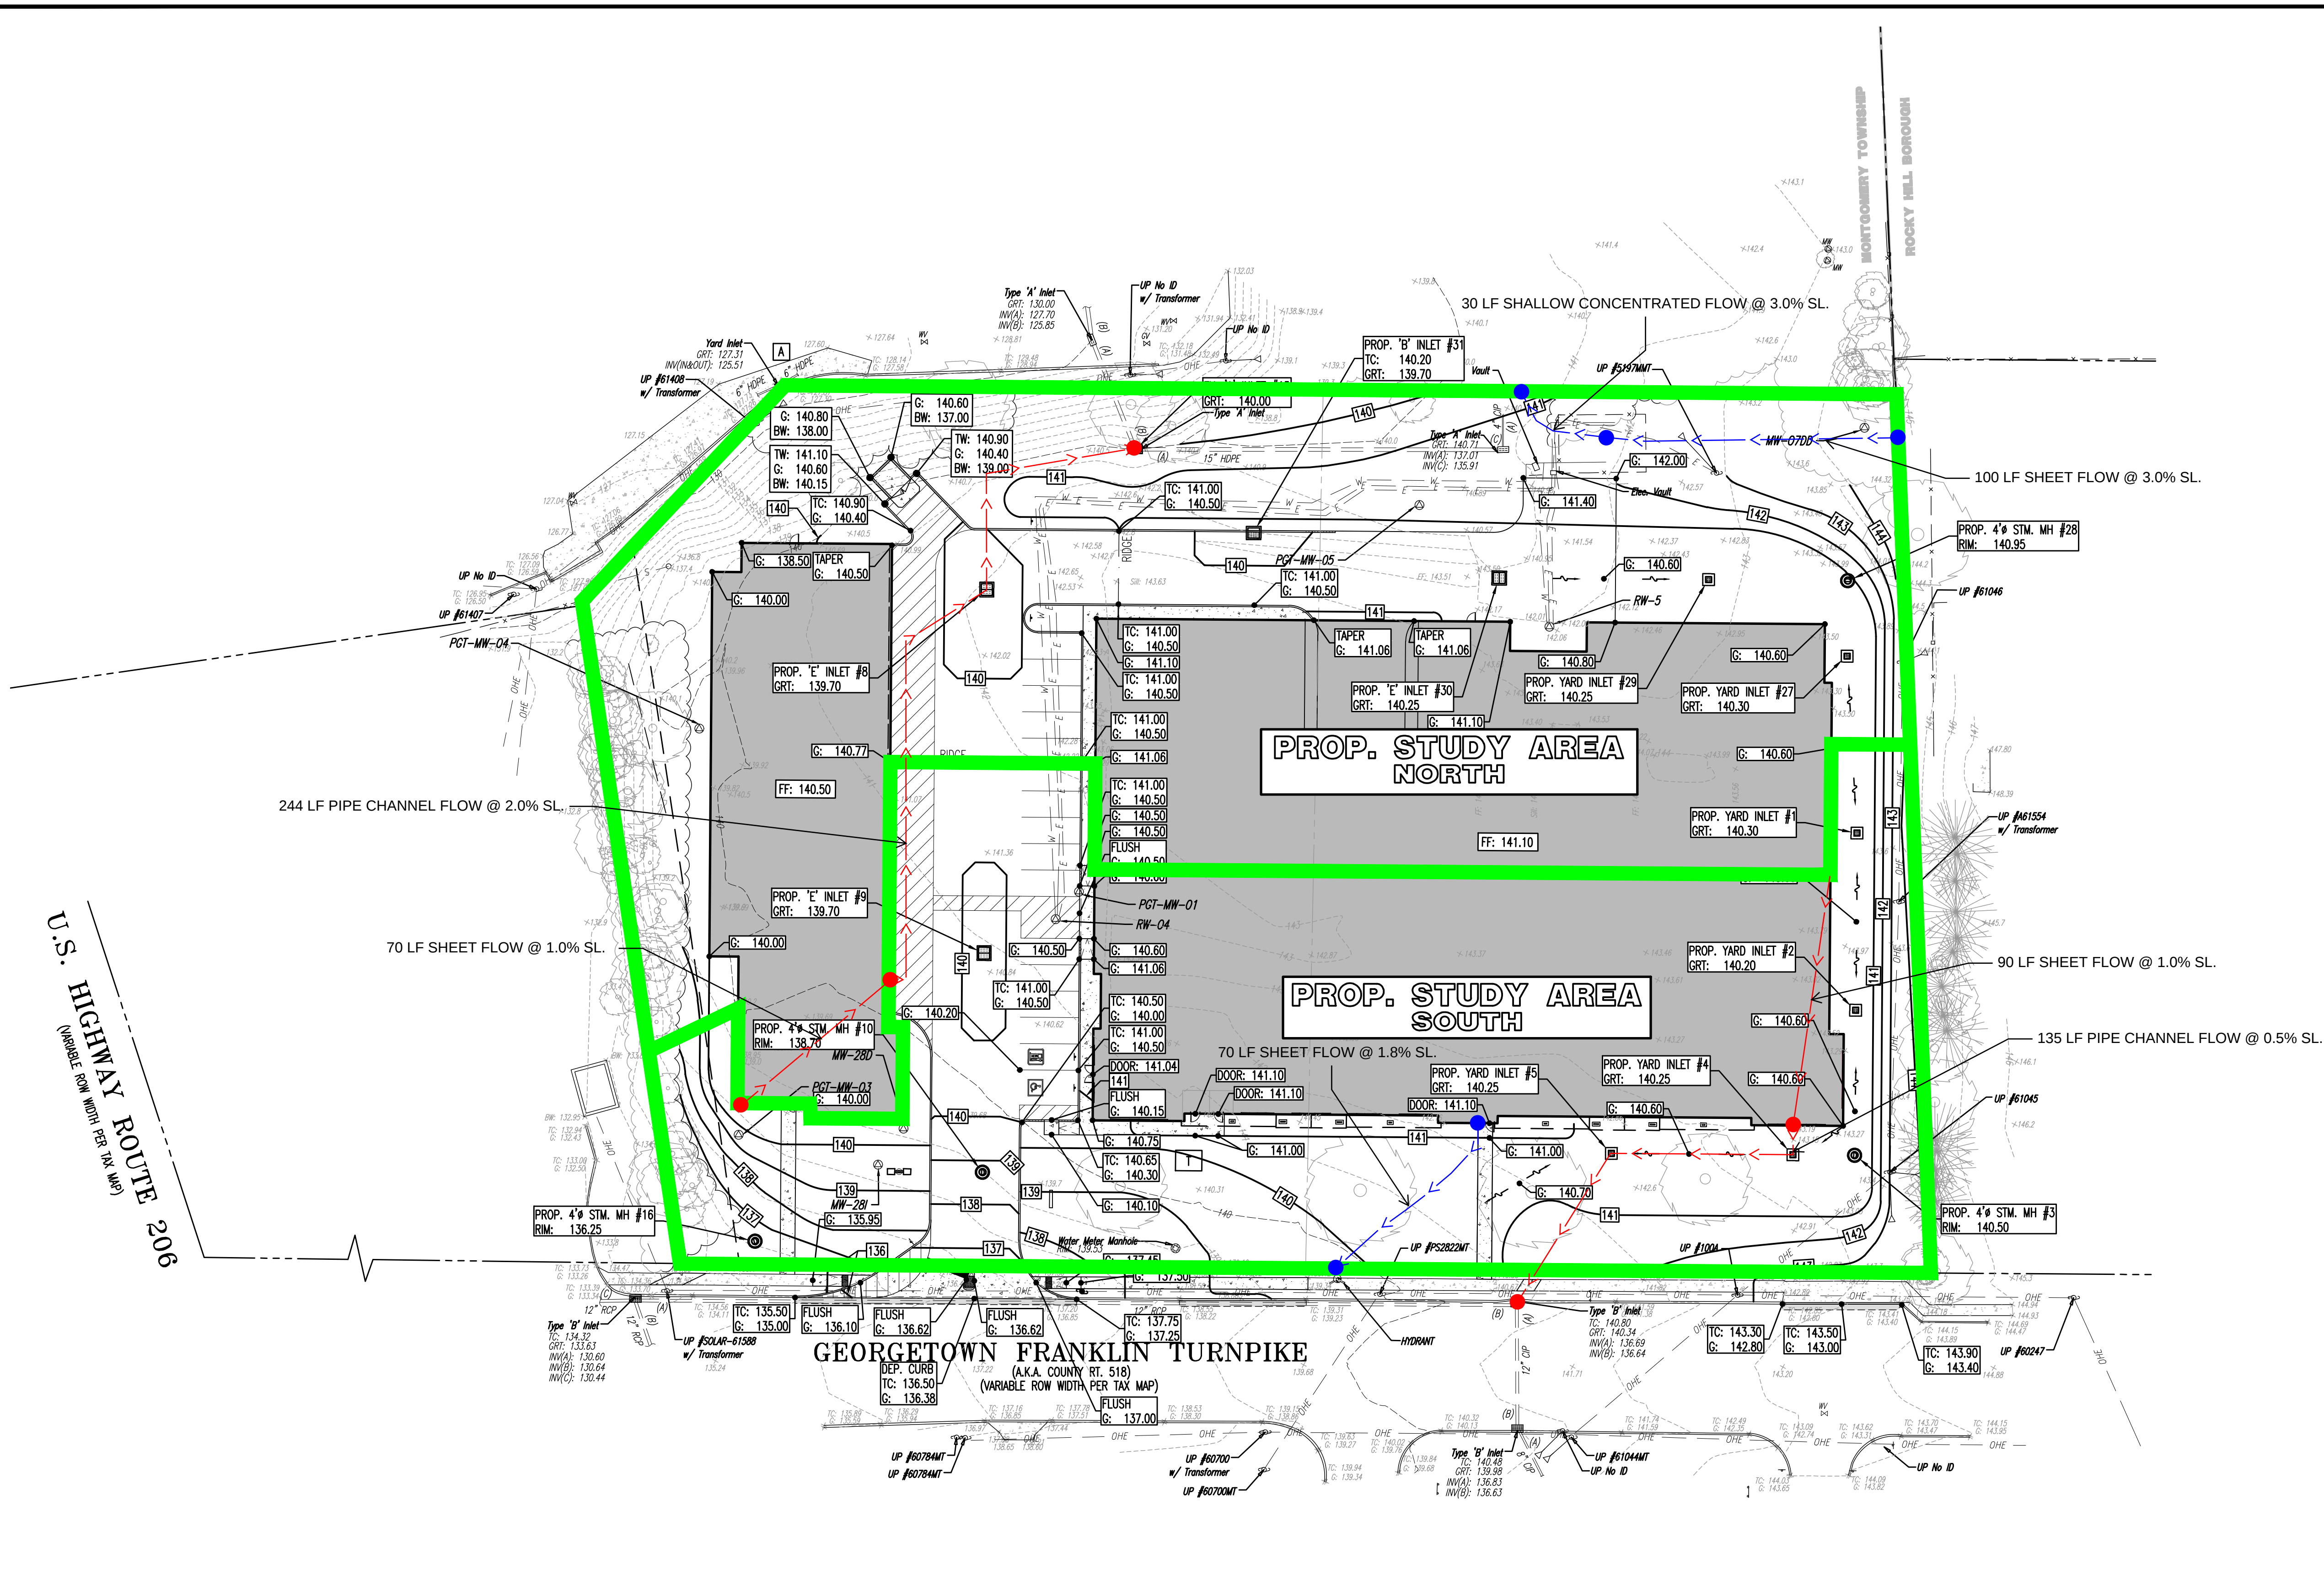


THIS PLAN SET IS FOR PERMITTING PURPOSES ONLY AND MAY NOT BE USED FOR CONSTRUCTION	
DYNAMIC ENGINEERING LAND DEVELOPMENT CONSULTING • PERMITTING • GEOTECHNICAL • ENVIRONMENTAL • SURVEY • PLANNING & ZONING 1954 Main Street Lake Como, NJ 07719 T: 732.974.0198 F: 732.974.3521 www.dynamiceng.com	
TITLE: PROPOSED DRAINAGE AREA MAP	
PROJECT: RENARD MANAGEMENT, INC. PROPOSED SELF-STORAGE FACILITY BLOCK 29002, LOTS 49 & 50 1026 ROUTE 518 TOWNSHIP OF MONTGOMERY, SOMERSET COUNTY, NEW JERSEY	JOB No: 2334-22-00894 DATE: 06/08/2023 DRAWN BY: KING DESIGNED BY: BC CHECKED BY: DT CHECKED BY: -
JOSHUA M. SEWALD PROFESSIONAL ENGINEER NEW JERSEY LICENSE No. 52985	KYLE C. KAVINSKI PROFESSIONAL ENGINEER NEW JERSEY LICENSE No. 52985
811 PROTECT YOURSELF ALL STATES REQUIRE NOTIFICATION OF CONCRETE, REBAR, OR ANY OTHER PREPARED TO LOCATE THE SERVICE FOR STATE SPECIFIC DIRECT PHONE NUMBERS VISIT: WWW.CALL811.COM	
2 OF 3 Rev. # 0	

Plotted: 03/05/24 - 10:57 AM, By: khespe, Product Ver: 24.3a (LMS Tech)
File: P:\BECPC PROJECTS\2334_Aco Murray\22-00894_Montgomery\DWG\DA_Maps\2334220089HAM0.dwg, ----> 03 INLET AREA MAP

COPYRIGHT © 2024 - DYNAMIC ENGINEERING CONSULTANTS, PC - ALL RIGHTS RESERVED

U.S. HIGHWAY ROUTE 206
(VARIABLE ROW WIDTH PER TAX MAP)

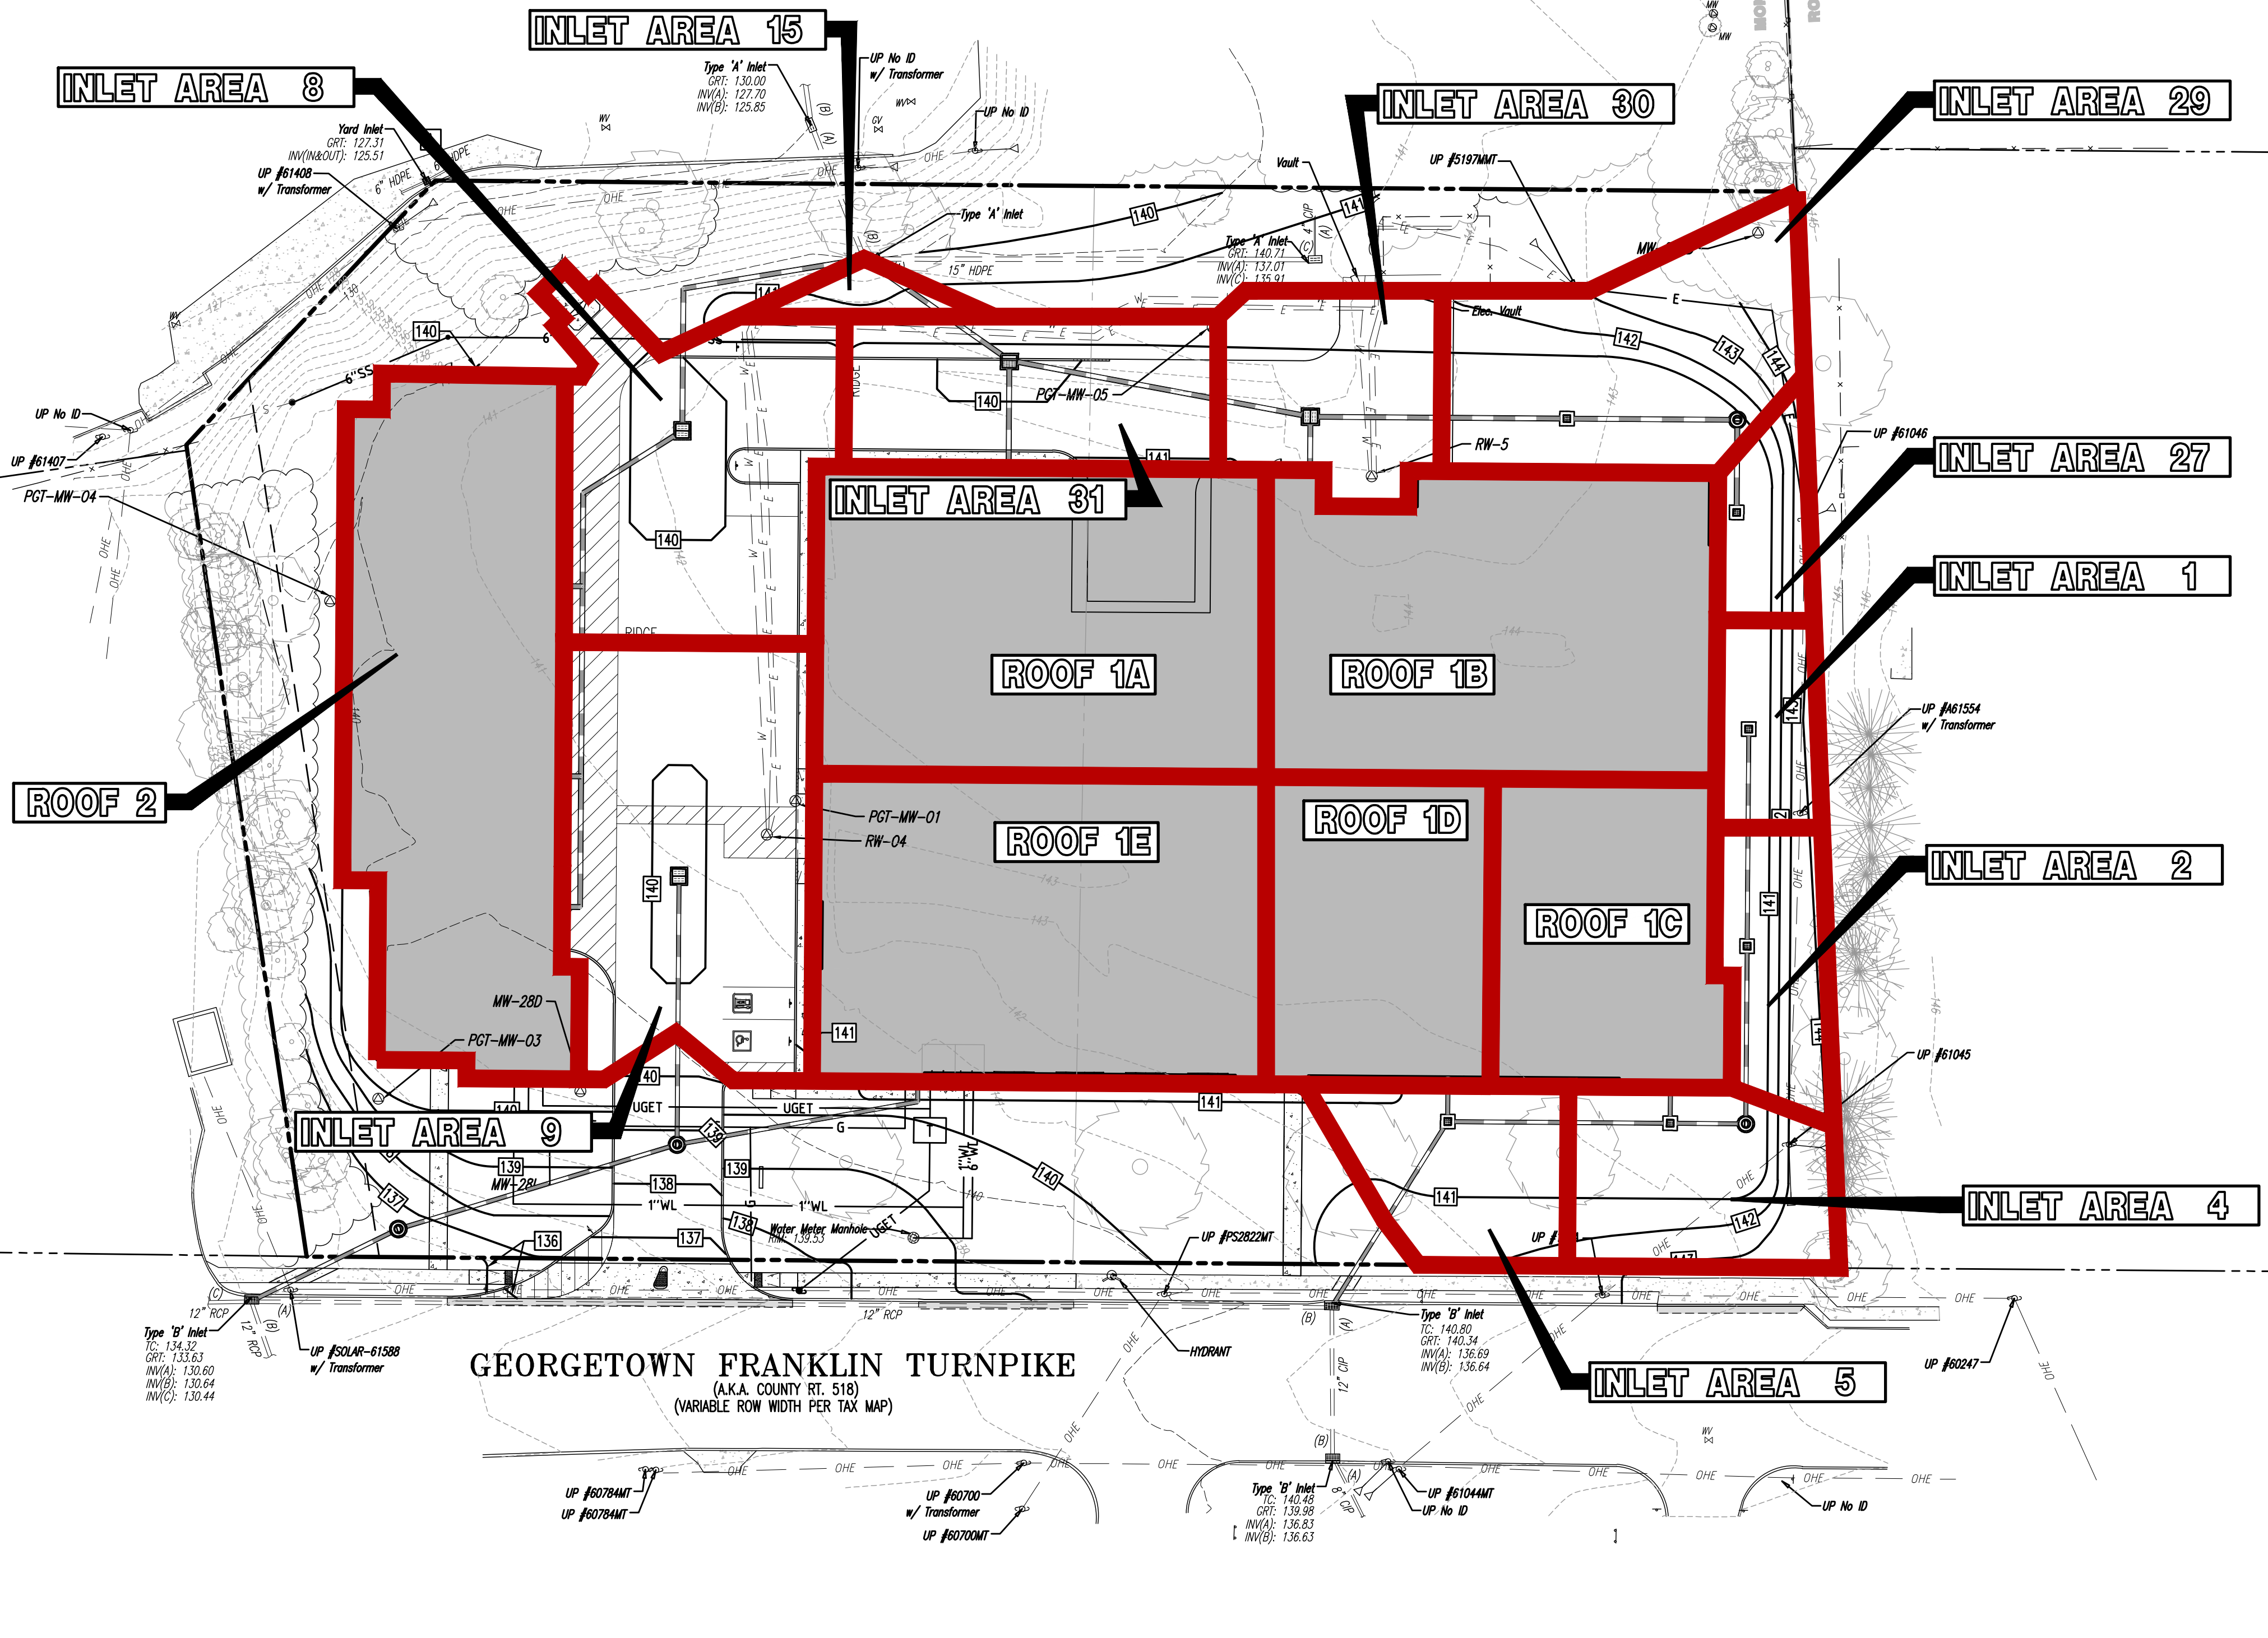

THIS PLAN SET IS FOR PERMITTING PURPOSES ONLY AND MAY NOT BE USED FOR CONSTRUCTION			
DYNAMIC ENGINEERING LAND DEVELOPMENT CONSULTING • PERMITTING • GEOTECHNICAL • ENVIRONMENTAL • SURVEY • PLANNING & ZONING Lake Como, New Jersey T: 732.974.0198 Chester, New Jersey T: 908.879.9229 Newark, New Jersey T: 973.353.7200 Toms River, New Jersey T: 732.478.0000 Aven, Texas T: 972.534.2100 Austin, Texas T: 512.244.2044 Houston, Texas T: 281.789.6400 Delray Beach, Florida T: 561.921.8570 Newtown, Pennsylvania T: 287.683.0274 Philadelphia, Pennsylvania T: 215.253.4868 Bethlehem, Pennsylvania T: 610.396.4400			
TITLE: INLET AREA MAP			
PROJECT: RENARD MANAGEMENT, INC. PROPOSED SELF-STORAGE FACILITY BLOCK 29002, LOTS 49 & 50 1026 ROUTE 518 TOWNSHIP OF MONTGOMERY, SOMERSET COUNTY, NEW JERSEY		JOB No: 2334-22-00894	DATE: 06/08/2023
DRAWN BY: UV		DESIGNED BY: BC	CHECKED BY: DT
JOSHUA M. SEWALD		KYLE C. KAVINSKI	PROFESSIONAL ENGINEER NEW JERSEY LICENSE No. 52985
PROFESSIONAL ENGINEER NEW JERSEY LICENSE No. 52985		PROFESSIONAL ENGINEER NEW JERSEY LICENSE No. 52985	
811 PROTECT YOURSELF ALL STATES REQUIRE NOTIFICATION OF UNDERGROUND UTILITIES BEFORE ANY CONSTRUCTION OR EXCAVATION WORK. TO OBTAIN THE SERVICE FOR STATE SPECIFIC DIRECT PHONE NUMBERS VISIT: WWW.CALL811.COM			
SHEET No: 3 OF 3			